

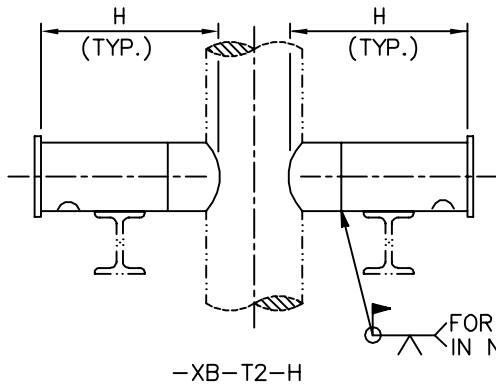
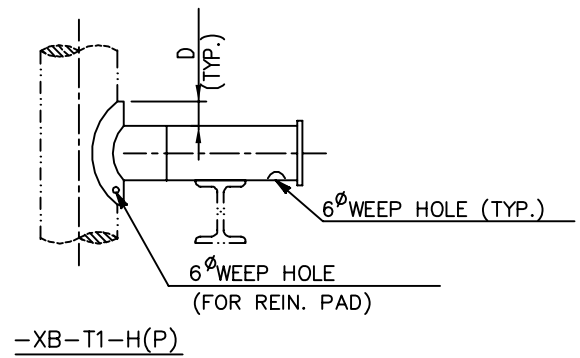
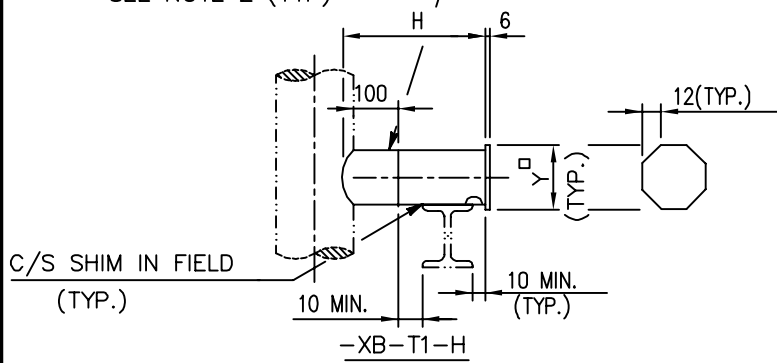



FOR SPECIAL MAIN LINE
SEE NOTE 2 (TYP.)

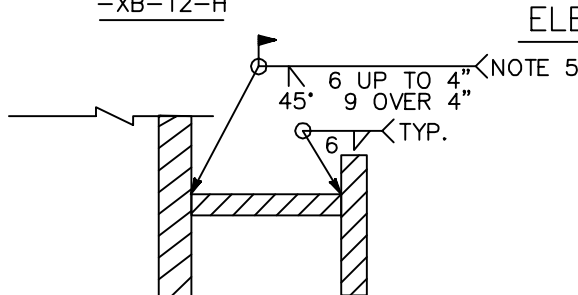

ELEV.

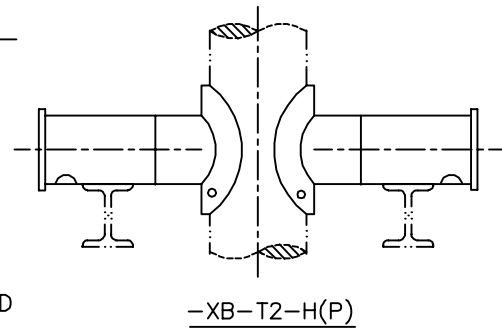

WELD DETAIL
(NO PAD REQ'D)

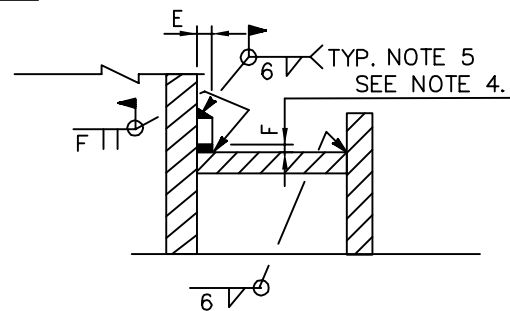

WELD DETAIL
(PAD REQ'D)

NOTES :

- DESIGNATION NUMBER DENOTE AS FOLLOWS :

61-3B-T1-05(P4)

DENOTE TYPE NO. ———
 DENOTE NOM. TRUNN. PIPE SIZE ———
 DENOTE MAIN LINE SIZE ———
 DENOTE REIN. PAD IS REQ'D. ———
 DENOTE THE LG. OF TRUNN. (IN 100mm) ———
 DENOTE ONE-TRUNN. TYPE ———

- FOR ALLOY STEEL, STAINLESS STEEL & STRESS RELIEF LINES, THE MATERIALS SHALL BE THE SAME AS MAIN LINES, AND IT SHALL BE FABRICATED TOGETHER WITH MAIN LINES IN SHOP.
- THE MOMENT CAPACITY OF THE TABLE ARE FOR ONE-TRUNN. TYPE, FOR TWO-TRUNN. TYPE THE CAPACITIES SHALL BE DOUBLED.
- DIMENSION "F" : ALLOY OR STAINLESS TAKES 6 mm
CARBON STEEL TAKES 9 mm
- ALL WELDED CONNECTIONS SHALL BE MADE WITH 6mm WELDS, BUT FOR ALL WELDS WITH PIPE, THE WELDING THICKNESS SHALL NOT EXCEED THE THICKNESS OF PIPE UNLESS OTHERWISE NOTED.



中鼎工程股份有限公司
CTCI CORPORATION

DETAIL OF PIPE SUPPORT

TYPE-61

(1 OF 3)

ENGINEERING STANDARD

D7TS-701-E

D-72

REV.
1

BY		CHK.	
DATE		APPR.	