


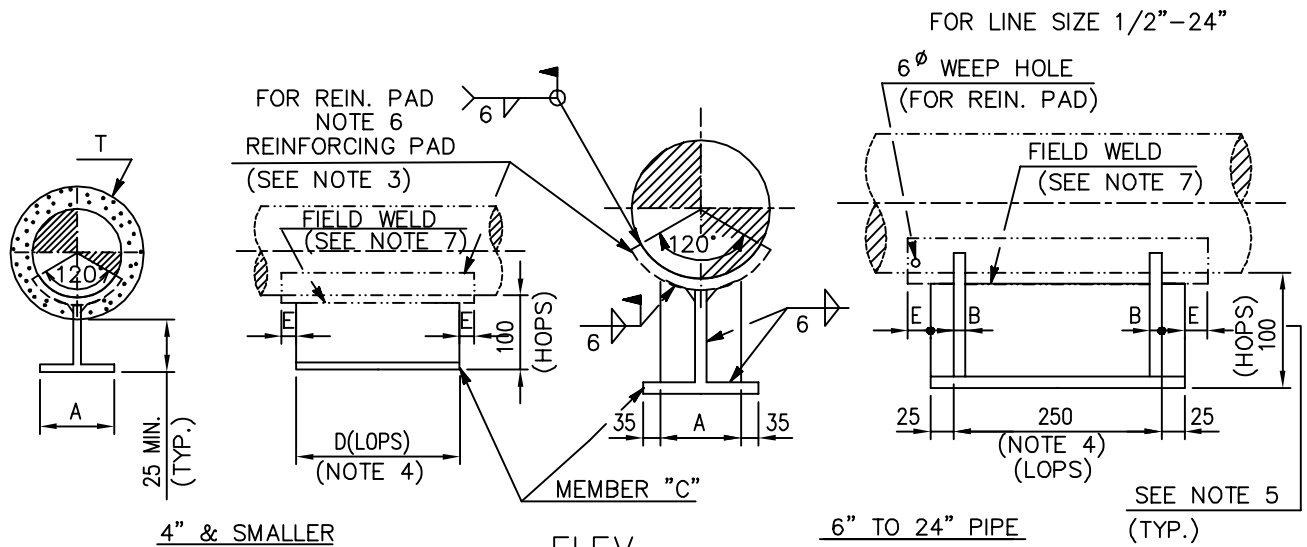

DIMENSION (mm)

LINE SIZE	A	B	C (NOTE 1)	D (NOTE 4)	E
1/2"	100	—	CUT FROM H-200X100X5.5X8	150	—
3/4"	100	—		150	—
1"	100	—		150	—
1 1/2"	100	—		150	—
2"	100	—		150	50
2 1/2"	100	—		150	50
3"	100	—		250	50
4"	100	—		250	50
5"	100	—		250	50
6"	130	9	CUT FROM H-200X200X8X12	—	50
8"	130	9		—	50
10"	130	9		—	50
12"	130	9		—	50
14"	130	9		—	50
16"	250	12	FAB. FROM 12 ^t PLATE	—	50
18"	250	12		—	50
20"	250	12		—	50
24"	300	12		—	50

NOTES : (FOR SH'T D-80,80A ONLY)

1. SHOES FOR PIPES 1 1/2" & SMALLER MAY BE FABRICATED FROM 6^t PLATE, 2" THRU. 14" FROM 9^t PLATE, 16" THRU. 24" FROM 12^t PLATE

2. DESIGNATION NUMBER DENOTE AS FOLLOWS :

66-1 1/2B(P)-A(A)-130-500

DENOTE TYPE NO. —

DENOTE LINE SIZE —

DENOTE REIN. PAD IS REQ'D —

MODIFY LOPS=500 (IN mm) IF ANY

MODIFY HOPS=130 (IN mm) IF ANY

SEE SH'T D-80A TABLE "A" —

SEE SH'T D-80A TABLE "B"

3. FOR PADS MATERIAL USE PIPE MATERIAL THAT CUT FROM THE PIPE OR EQUIVALENT TO THE PIPE.

4. LONGITUDINAL LENGTH OF PIPE SHOE (SAY LOPS)

SHALL BE CALCULATED IN THE CASE WITH PIPE STOP OR THERMAL MOVEMENT.



中鼎工程股份有限公司

CTCI CORPORATION

DETAIL OF PIPE SUPPORT

TYPE-66

(1 OF 4)

ENGINEERING STANDARD

D7TS-701-E

D-80

REV.
1

BY
DATE

CHK.
APPR.