


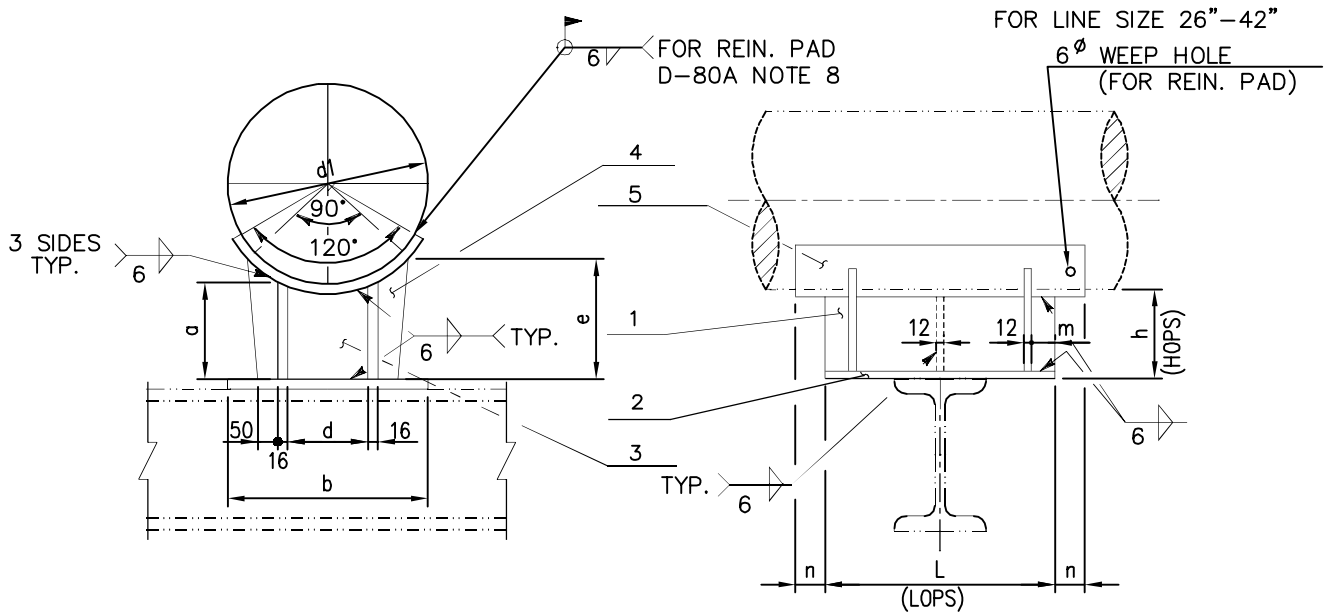

(FOR OTHER WELDS, SEE SH'T D-80A NOTE 7)

DIMENSION (mm)

NO	1			2	3	4	5	DIMENSION										
PIECE	2			1	1	4	1											
PIPE SIZE	(NOTE 4) FOOT a			FOOT PLATE	PLATE	PLATE	PAD											
	A	B	C					b	d	e (NOTE 2,4)			h (NOTE 2)			L	m	n
	(NOTE 2)	(NOTE 2)	(NOTE 2)							A	B	C	A	B	C			
26"	148	198	298	16 TH'K	12 TH'K	12 TH'K	NOTE 6	430	230	222	272	372	150	200	300	540	35	50
28"	148	198	298					440	240	230	280	380	150	200	300	540	35	50
30"	148	198	298					450	250	237	287	387	150	200	300	540	35	50
32"	148	198	298					460	260	244	294	394	150	200	300	540	35	50
34"	150	200	300					480	280	252	302	402	150	200	300	540	35	50
36"	152	202	302					500	300	259	309	409	150	200	300	540	35	50
40"	156	206	306					535	335	274	324	424	150	200	300	540	35	50
42"	156	206	306					550	350	281	331	431	150	200	300	540	35	50

NOTES : (FOR SH'T D-80B ONLY)

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

66-28B-A(A)-130-500

DENOTE TYPE NO.

DENOTE LINE SIZE

SEE NOTE 2

MODIFY LOPS=500 (IN mm) IF ANY

MODIFY HOPS=130 (IN mm) IF ANY

SEE SH'T D-80A TABLE "B"

2. TYPE-A FOR INSULATION THICKNESS ≤ 100 TYPE-B FOR INSULATION THICKNESS > 100 AND ≤ 150 TYPE-C FOR INSULATION THICKNESS > 150 OR SPECIAL USED

3. LOADING CONDITION: CARBON STEEL SADDLE WITH MAX. LINE TEMPERATURE 371°C

4. DIMENSION "a" & "e" ARE CALCULATED BASE ON PIPE SHOE WITH 12 mm TH'K REINF. PAD.

5. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE

6. REINFORCING PAD MATERIALS ARE CUT FROM PIPES.



中鼎工程股份有限公司

CTCI CORPORATION

DETAIL OF PIPE SUPPORT

TYPE-66

(3 OF 4)

ENGINEERING STANDARD

D7TS-701-E

D-80B

REV.
1BY
DATECHK.
APPR.