


FOR LINE SIZE 44"-78"

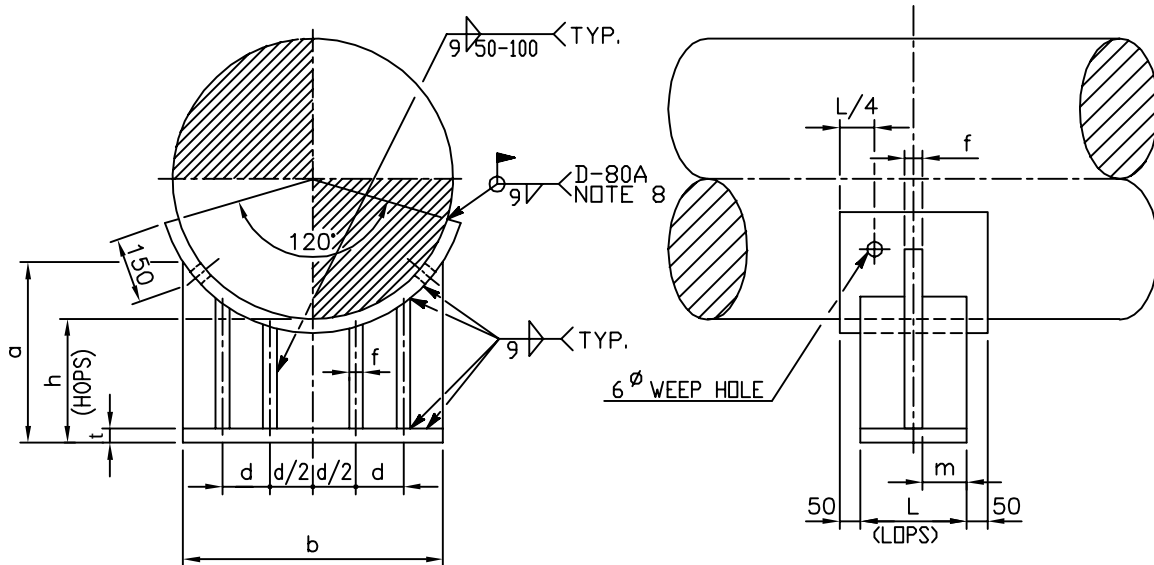

PIPE SIZE	a			b	t	d	h			PIPE SHOE			R. PAD
	A	B	C				A	B	C	f	L	m	
44"	376	426	576	950	16	260	150	200	300	16	600	292	NOTE 6
46"	358	408	508	950	16	260							
48"	374	424	524	1000	16	280							
54"	390	440	540	1100	16	310							
56"	407	457	557	1150	16	320							
60"	404	454	554	1200	19	330							
64"	436	486	586	1300	19	360							
66"	462	512	612	1300	19	360							
72"	469	519	619	1450	19	410							
76"	501	551	651	1550	19	440							
78"	536	586	686	1600	19	450							

NOTES : < FOR SH'T D-80C ONLY>

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

66-60B-A(A)-130-600

DENOTE TYPE NO. _____

DENOTE LINE SIZE _____

SEE NOTE 2 _____

MODIFY LOPS=600 (IN mm) IF ANY

MODIFY HOPS=130 (IN mm) IF ANY

SEE SH'T D-80A TABLE "B"

2. TYPE-A FOR INSULATION THICKNESS ≤ 100 TYPE-B FOR INSULATION THICKNESS $> 100 \leq 150$ TYPE-C FOR INSULATION THICKNESS > 150 OR SPECIAL USED

3. LOADING CONDITION: CARBON STEEL SADDLE WITH MAX. LINE TEMPERATURE 371°C

4. DIMENSION "a" IS CALCULATED BASE ON PIPE SHOE WITH 12 mm TH'K REINF. PAD.

5. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE

6. REINFORCING PAD MATERIALS ARE CUT FROM PIPES.



中鼎工程股份有限公司

CTCI CORPORATION

DETAIL OF PIPE SUPPORT

TYPE-66

< 4 OF 4 >

ENGINEERING STANDARD

D7TS-701-E

D-80C

REV.
1BY
DATECHK.
APPR.