


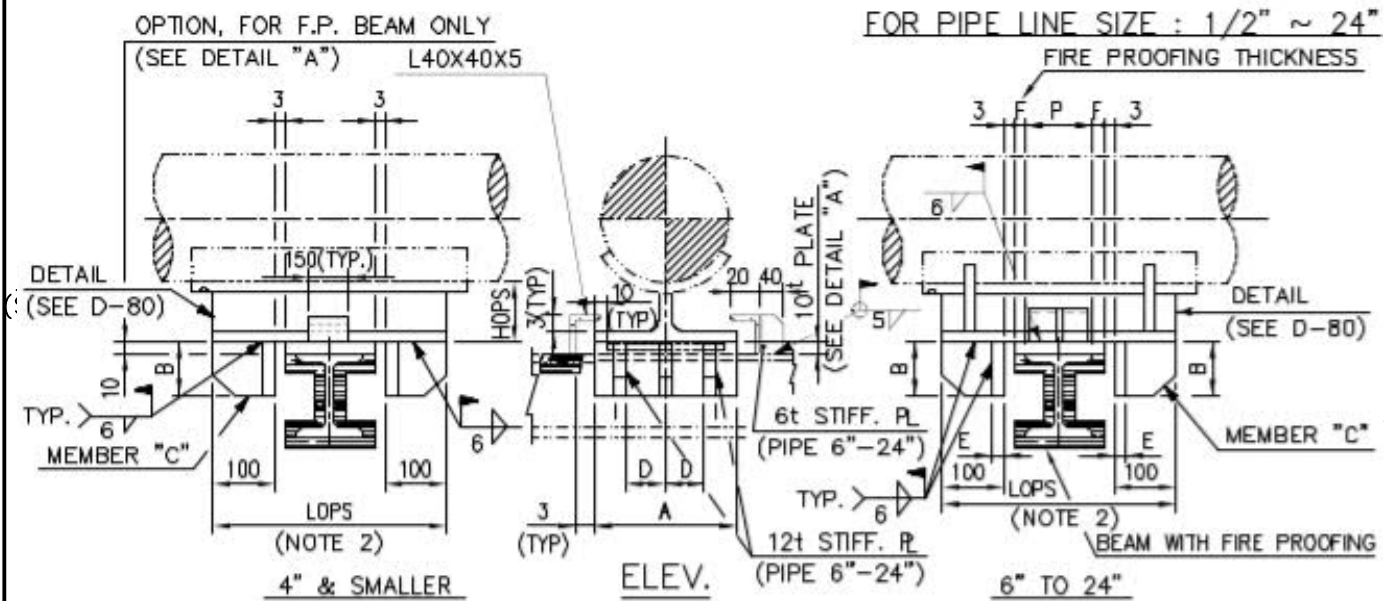

DIMENSIONS (mm)

LINE SIZE	A	B	C	D	E
1/2"	100	100	CUT FROM H200X100X5.5X8	-	-
3/4"	100	100		-	-
1"	100	100		-	-
1 1/2"	100	100		-	-
2"	100	100		-	-
2 1/2"	100	100		-	-
3"	100	100		-	-
4"	100	100		-	-
5"	100	100	CUT FROM H200X200X8X12	-	-
6"	200	100		70	-
8"	200	100		70	-
10"	200	200		70	-
12"	200	200		70	-
14"	200	200		70	-
16"	320	200	FAB. FORM 12 ^t PLATE	100	12
18"	320	200		100	12
20"	320	200		100	12
24"	370	200		100	12

NOTES :

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

83-2B(P)-A(A)-130-500

DENOTE TYPE NO.

DENOTE LINE SIZE

DENOTE REIN. PAD IS REQ'D

MODIFY LOPS=500 (IN mm) IF ANY

MODIFY HOPS=130 (IN mm) IF ANY


SEE SH'T D-80A TABLE "B"

SEE SH'T D-80A TABLE "A"

2. THE MAX. LENGTH OF THIS MEMBER SHALL NOT EXCEED THE WIDTH OF BEAM.

3. PIPE SHOE LENGTH (SAY LOPS) TO SUIT BEAM WIDTH IN FIELD.

4. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE.

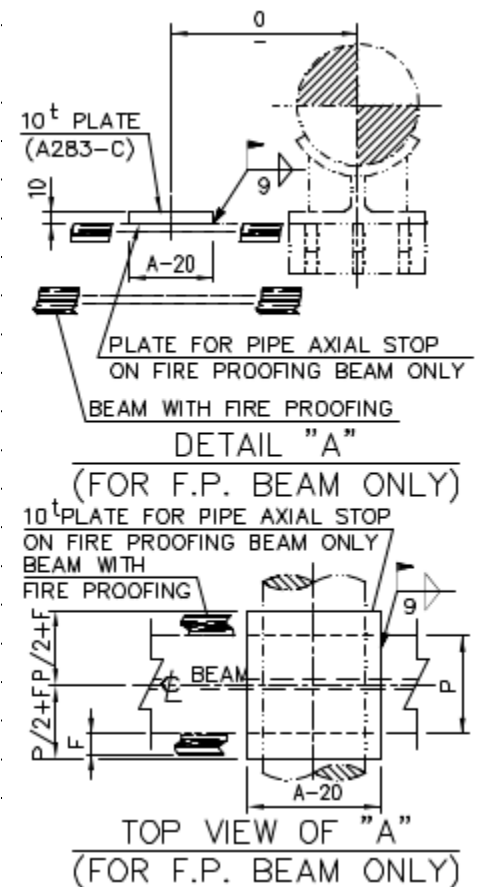

中鼎工程股份有限公司

CTCI CORPORATION

DETAIL OF PIPE SUPPORT

TYPE-83

(1 OF 2)

ENGINEERING STANDARD

D7TS-701-E

D-101

REV.
1BY
DATECHK.
APPR.