


FOR LINE SIZE 26"-42"

PIPE SHOE DETAIL
SEE SH'T D-80B

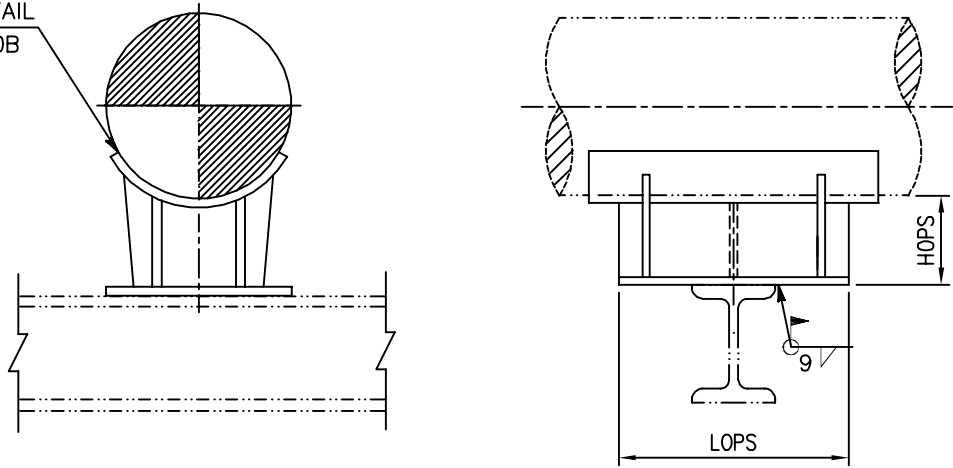

ELEV.

NOTES :

1. FOR DIMENSIONS AND INFORMATION NOT SHOWN ON THIS DWG. SEE SH'T D-80B.

2. DESIGNATION NUMBER DENOTE AS FOLLOWS :

85-30B-A(A)-130-500

DENOTE TYPE NO. ————
DENOTE LINE SIZE ————

MODIFY LOPS=500 (IN mm) IF ANY
MODIFY HOPS=130 (IN mm) IF ANY
SEE SH'T D-80A TABLE "B"
SEE NOTE 3

3. TYPE-A FOR INSULATION THICKNESS ≤ 100
TYPE-B FOR INSULATION THICKNESS > 100 AND ≤ 150
TYPE-C FOR INSULATION THICKNESS > 150 OR SPECIAL USED.

4. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE.



中鼎工程股份有限公司
CTCI CORPORATION

DETAIL OF PIPE SUPPORT
TYPE-85

(2 OF 2)

ENGINEERING STANDARD

D7TS-701-E

D-106

REV.
1

BY		CHK.	
DATE		APPR.	