


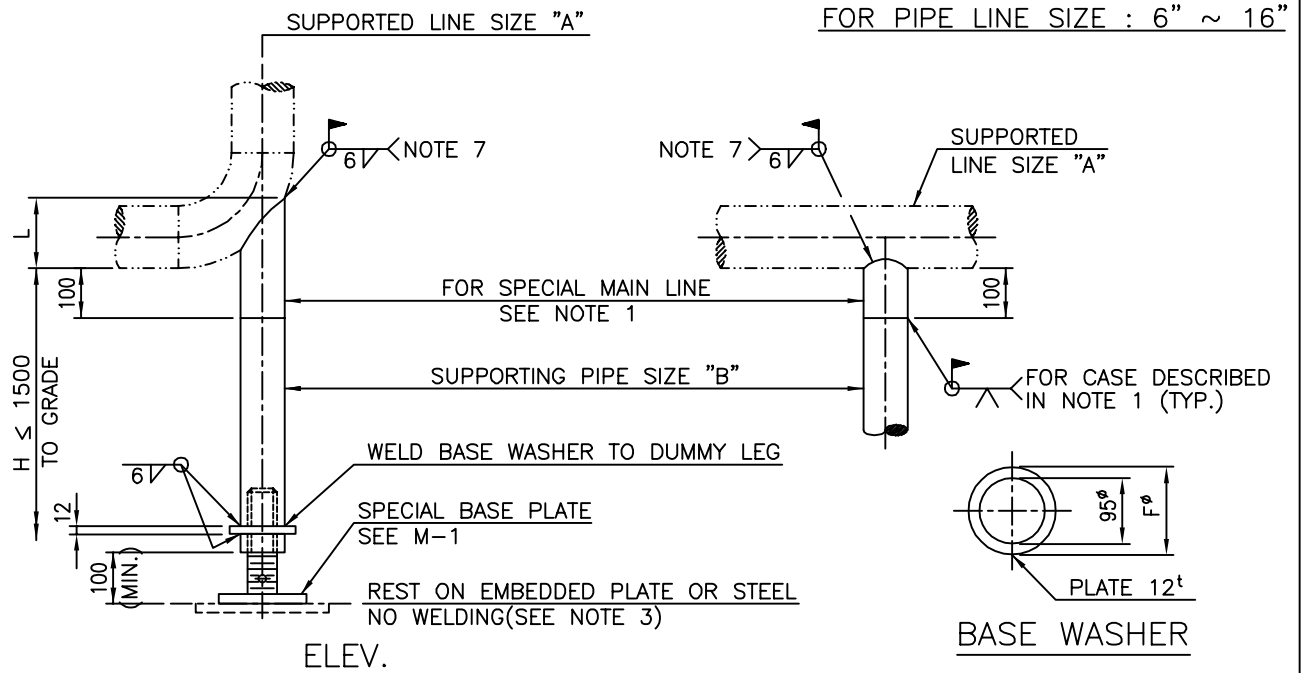

NOTES:

- FOR ALLOY STEEL, STAINLESS STEEL & STRESS RELIEF LINES, THE MATERIAL CLASS SHALL BE THE SAME AS MAIN LINES, AND IT SHOULD BE FABRICATED TOGETHER WITH MAIN LINE IN SHOP.
- DIMENSION "H" SHALL BE CUT TO SUIT IN FIELD.
- THIS TYPE SHALL BE USED WITH M-42 TO DETERMINE THE LOWER COMPONENT TYPE. IN THIS DETAIL, USE TYPE-B, C & H ONLY.
- DESIGNATION NUMBER DENOTE AS FOLLOWS:
 10-6B-05B
 — DENOTE THE LOWER COMPONENT TYPE SEE M-42
 — DENOTE DIMENSION "H" (IN 100mm) (SEE NOTE 6)
 — DENOTE SUPPORTED LINE SIZE "A"
 — DENOTE TYPE NO.
- DIMENSION "L" IS BASED ON LONG RADIUS ELBOW TO WHICH DUMMY PIPE IS WELDED.
- IF THE LOWER COMPONENT TYPE-B IS USED, DIMENSION "H" SHALL BE COUNTED FROM THE ELEVATION OF THE LOWEST POINT OF PAVING.
- ALL WELDED CONNECTIONS SHALL BE MADE WITH 6mm FILLET WELDS, BUT FOR ALL WELDS WITH PIPE, THE WELDING THICKNESS SHALL NOT EXCEED THE THICKNESS OF PIPE UNLESS OTHERWISE NOTED.

D-010M.DWG

CTCI 中鼎工程股份有限公司
俊鼎機械廠股份有限公司

BY		CHK.	
DATE		APPR.	

DETAIL OF PIPE SUPPORT
TYPE-10

(1 OF 1)

ENGINEERING STANDARD

STM-05.01

D-10

REV.
1