

NOTES : (CONT'D)

5.

TABLE "A"

(FOR NORMAL INSULATION LINE)

INSULATION TH'K (mm)	HEIGHT OF SHOE (mm) (SAY HOPS)	SYMBOL
75 & LESSER	100	NONE
80 THRU. 125	150	A
130 THRU. 175	200	B
180 THRU. 225	250	C

(FOR TRACING INSULATION LINE)

INSULATION TH'K (mm)	HEIGHT OF SHOE (mm) (SAY HOPS)	SYMBOL
50 & LESSER	100	NONE
55 THRU. 100	150	A
105 THRU. 150	200	B
155 THRU. 200	250	C

TABLE "B"


PIPE MATERIAL	PAD MATERIAL	SHOE DATA		
		MAT'L OF SHOE	FABRICATED FROM (NOTE 1)	SYMBOL
C. S. PIPE	CUT FROM SAME PIPE IF REQUIRED	CARBON STEEL 	SHAPE STEEL OR C. S. PLATE	NONE
L. T. C. S. PIPE	CUT FROM SAME PIPE IF REQUIRED			(R)
S. S. PIPE	CUT FROM SAME PIPE (S.S. PIPE)			(S)

6. FOR MATERIAL SPECIFICATION SEE SH'T P-2.


7. FIELD WELD OF PIPE SHOE .

8. HEIGHT OF SHOE IS 220, BUT IT CAN BE EXTENDED TO 250.

9. W= THE LESS OF PIPE THICKNESS OR 6mm.

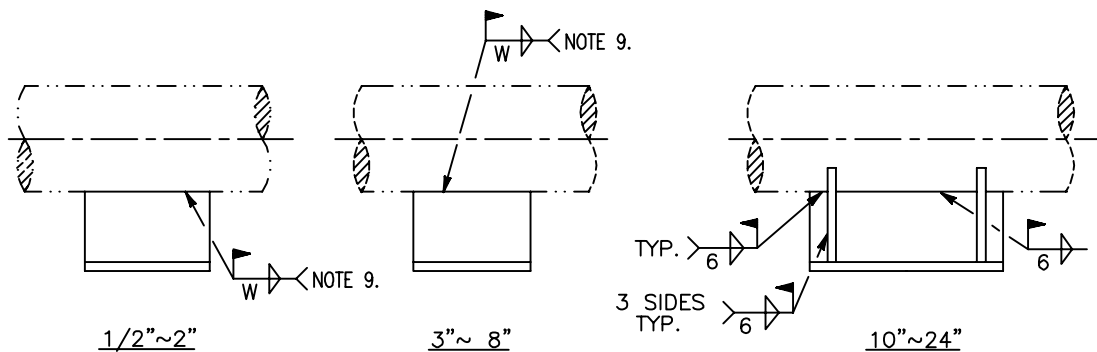

10. CONDITION OF NOTCH TO JUMP OVER WELDING ON PIPE.

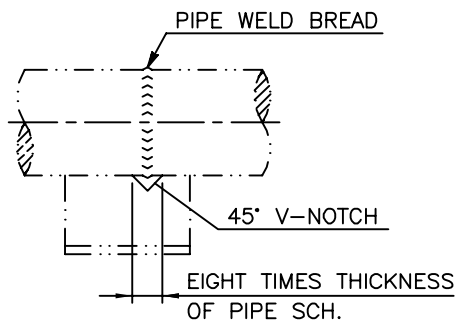

D-080AM.DWG

CTCI中鼎工程股份有限公司
俊鼎機械廠股份有限公司

DETAIL OF PIPE SUPPORT

TYPE-66

(2 OF 3)

ENGINEERING STANDARD

STM-05.01

D-80A

REV.
1ABY
DATECHK.
APPR.