


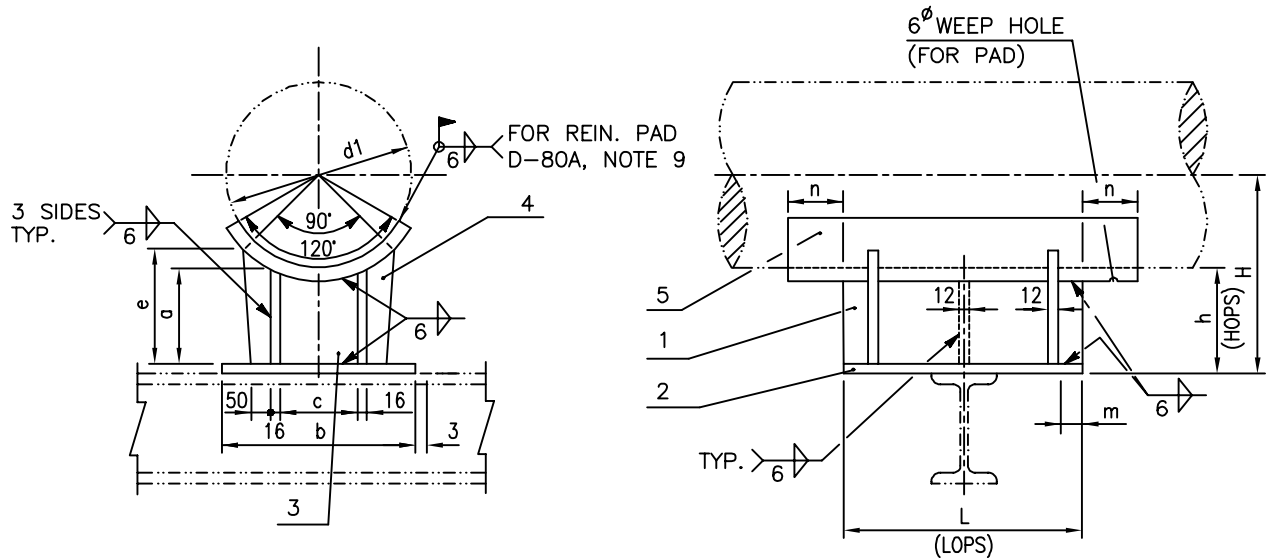

ELEV.

DIMENSION (mm)

NO	1		2	3	4	5	DIMEMSION										
PIECE	2		1	1	4	1											
PIPE SIZE	(NOTE 4) FOOT a		FOOT PLATE	PLATE	PLATE	PAD											
	A	B					b	c	e (NOTE 2,4)		h (NOTE 2)		H (NOTE 2)		L	m	n
	(NOTE 2)	(NOTE 2)							A	B	A	B	A	B			
26"	148	198	16 TH'K	12 TH'K	12 TH'K	NOTE 6	430	230	222	272	150	200	480	530	540	35	75
28"	148	198					440	240	230	280	150	200	506	556	540	35	75

NOTES : (FOR SH'T D-80B ONLY)

1. DESIGNATION NUMBER DENOTE AS FOLLOWS :

66-28B-A(A)-130-500

DENOTE TYPE NO. ————
 DENOTE LINE SIZE ————
 SEE NOTE 2 ————

MODIFY LOPS=500 (IN mm) IF ANY
 MODIFY HOPS=130 (IN mm) IF ANY
 SEE SH'T D-80A TABLE "B"

2. TYPE-A FOR INSULATION THICKNESS ≤ 100 TYPE-B FOR INSULATION THICKNESS $> 100 \leq 150$ TYPE-C FOR INSULATION THICKNESS > 150 OR SPECIAL USED.

3. LOADING CONDITION: CARBON STEEL SADDLE WITH LINE MAX. TEMP.: 370°C,

4. DIMENSION "a" & "e" ARE CALCULATED BASE ON PIPE SHOE WITH 12 mm TH'K REINF. PAD.

5. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE

6. REINFORCING PAD MATERIALS ARE CUT FORM PIPES.

D-080BM.DWG

CTCI

 中鼎工程股份有限公司
 俊鼎機械廠股份有限公司

DETAIL OF PIPE SUPPORT

TYPE-66

(3 OF 3)

ENGINEERING STANDARD

STM-05.01

D-80B

REV.
1BY
DATECHK.
APPR.