


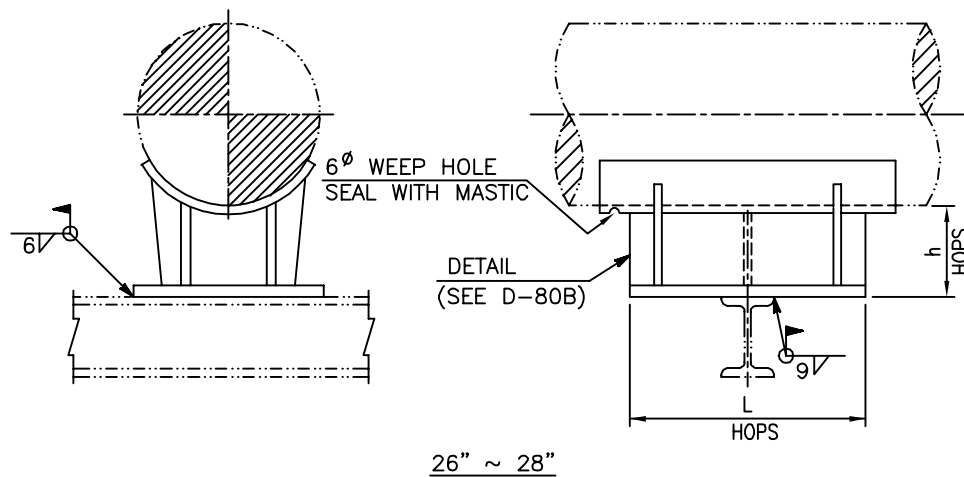

ELEV.

NOTES :

1. FOR DIMENSIONS AND INFORMATION NOT SHOWN ON THIS DWG. SEE SH'T D-80B.

2. DESIGNATION NUMBER DENOTE AS FOLLOWS :

85-30B-A(A)-130-500

DENOTE TYPE NO. ————

DENOTE LINE SIZE ————

MODIFY LOPS=500 (IN mm) IF ANY

MODIFY HOPS=130 (IN mm) IF ANY

SEE SH'T D-80A TABLE "B"

SEE NOTE 3

3. TYPE-A FOR INSULATION THICKNESS ≤ 100 TYPE-B FOR INSULATION THICKNESS $> 100 \leq 150$

4. HOPS=HEIGHT OF PIPE SHOE, LOPS=LENGTH OF PIPE SHOE

D-106M.DWG

CTCI

 中鼎工程股份有限公司
 俊鼎機械廠股份有限公司

DETAIL OF PIPE SUPPORT

TYPE-85

(2 OF 2)

ENGINEERING STANDARD

STM-05.01

BY

CHK.

DATE

APPR.

D-106

REV.
1