
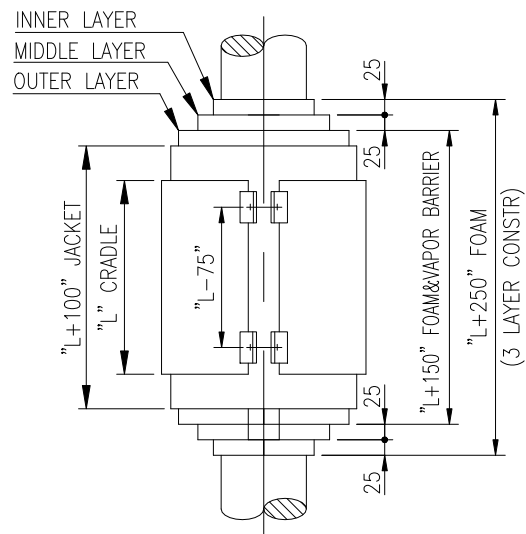



適用於 1/2"~24" 保冷管

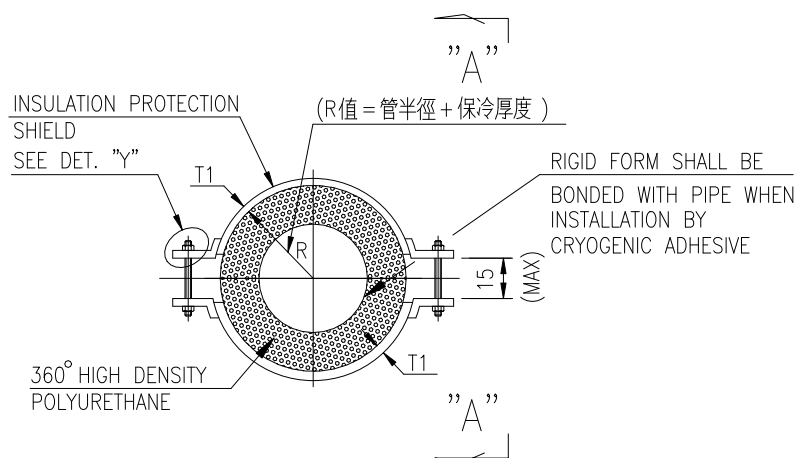

SECTION "A-A"

TABLE "1"

PIPE SIZE	SYMBOL	CRADLE LENGTH "L"	T1
1/2"~4"	NONE	300	3
	A	600	
6"~24"	NONE	300	5
	A	600	

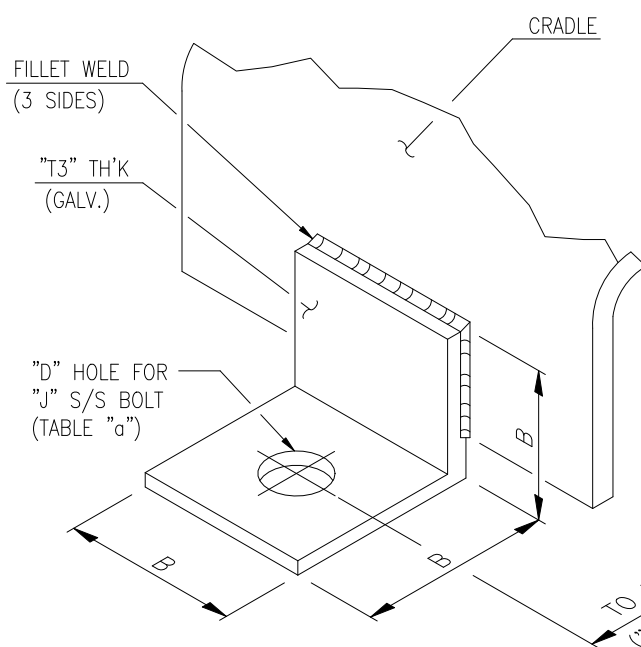

DETAIL "Y"

DIMENSION (mm)

PIPE SIZE	T3	J	B	D
1/2"~4"	5	1/4" x 40	30	8
6"~14"	6	3/8" x 40	40	12
16"~24"	10	1/2" x 50	50	15

TABLE "a"

NOTES: 1. DESIGNATION NUMBER DENOTE AS FOLLOW:

CS2-□"-C□-□

DENOTE CRADLE LENGTH (SEE TABLE "1")

保冷厚度

配管管徑

2. FOR PIPE SIZE 4" AND LARGER , MIDDLE STIFFENER IS ADDED FOR CRADLE SHORTER THAN 300 MM (300 MM INCLUSIVE), THE END STIFFENERS ARE ADDED FOR 600 MM LONG CRADLES

益高工程有限公司
E-KO ENGINEERING, LTD

COLD INSULATION CRADLE
保冷管鞍座

BY	CHK.	APP.	DATE	CONTRACT	DWG. NO. CS2	SH'T NO. 1 OF 1	REV.
----	------	------	------	----------	-----------------	--------------------	----------