


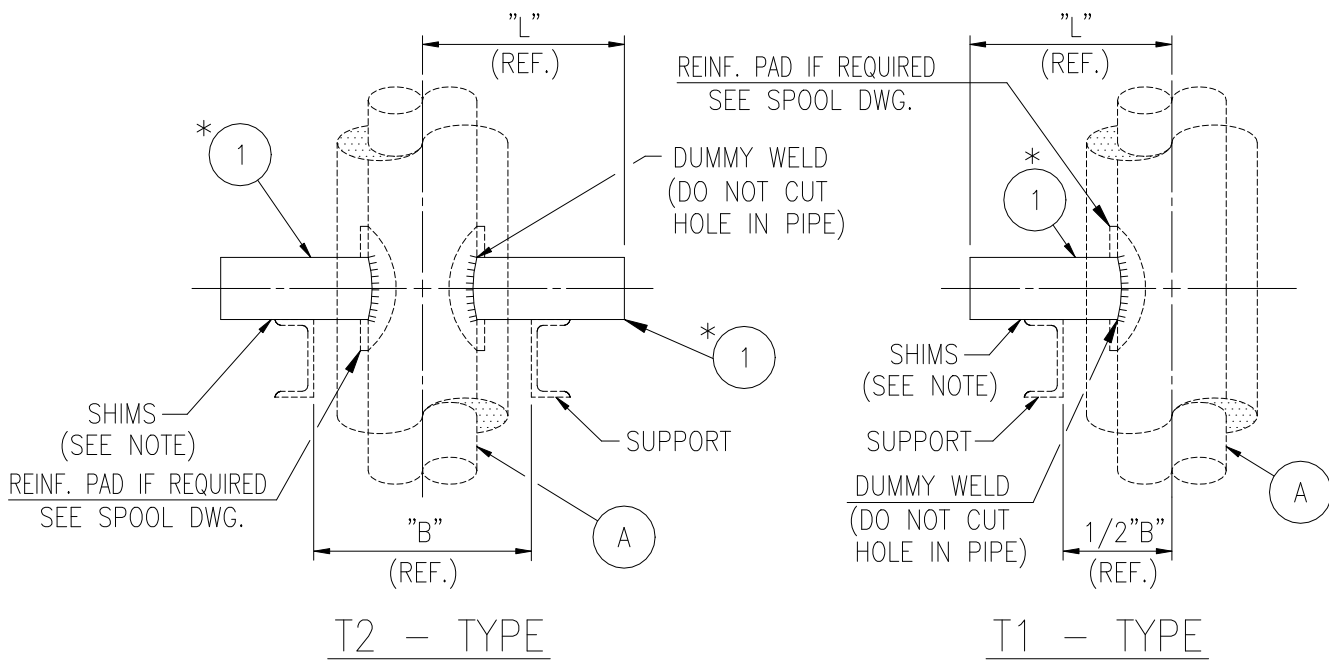

件號	名稱	材質	數量	REMARK
1	PIPE (SIZE PER TABLE)	SAME MAT'L AS PIPE (A)		

(A) PIPE SIZE	L	B	(1) TRUNNION SIZE
2"	200	105	2"
3"	200	130	2"
4"	230	165	3"
6"	250	230	4"
8"	280	305	6"
10"	300	360	6"
12"	330	410	6"
14"	350	435	6"
16"	380	485	8"
18"	400	535	8"
20"	430	585	10"
24"	480	685	10"

* BE CUT SUIT IN FIELD

NOTE: 1. 12 MM CLR FOR SHIM IF REQUIRED

2. SHIMS ARE NOT REQUIRED FOR TRUNNIONS INSTALLED IN PLACE DISREGARD. SPOOL DIMENSION AND LOCATION TO SUIT.

3. REINF. PAD IF REQUIRED,SEE SPOOL DWG.

4. REINF. PAD 之材質及 SCH. 均與主管相同

5. TRUNNION 之材質及 SCH. 均與主管相同

6. 本表 "L" 值依 "B" 值大小設定,若開口大小與 "B" 值不同時, "L" 值須另外設定.

7. DESIGNATION NUMBER:

ST-□"-□L-T□

1 FOR ONE-TRUNNION
2 FOR TWO-TRUNNION

LENGTH OF TRUNNION

TRUNNION SIZE

PLAN	SPOOL
	ST-6"-280L-T2

益高工程有限公司
E-KO ENGINEERING., LTD

SUPPORT TRUNNION

BY	CHK.	APP.	DATE	CONTRACT	DWG. NO. ST	SH'T NO. 1 OF 1	REV.
----	------	------	------	----------	----------------	--------------------	----------