


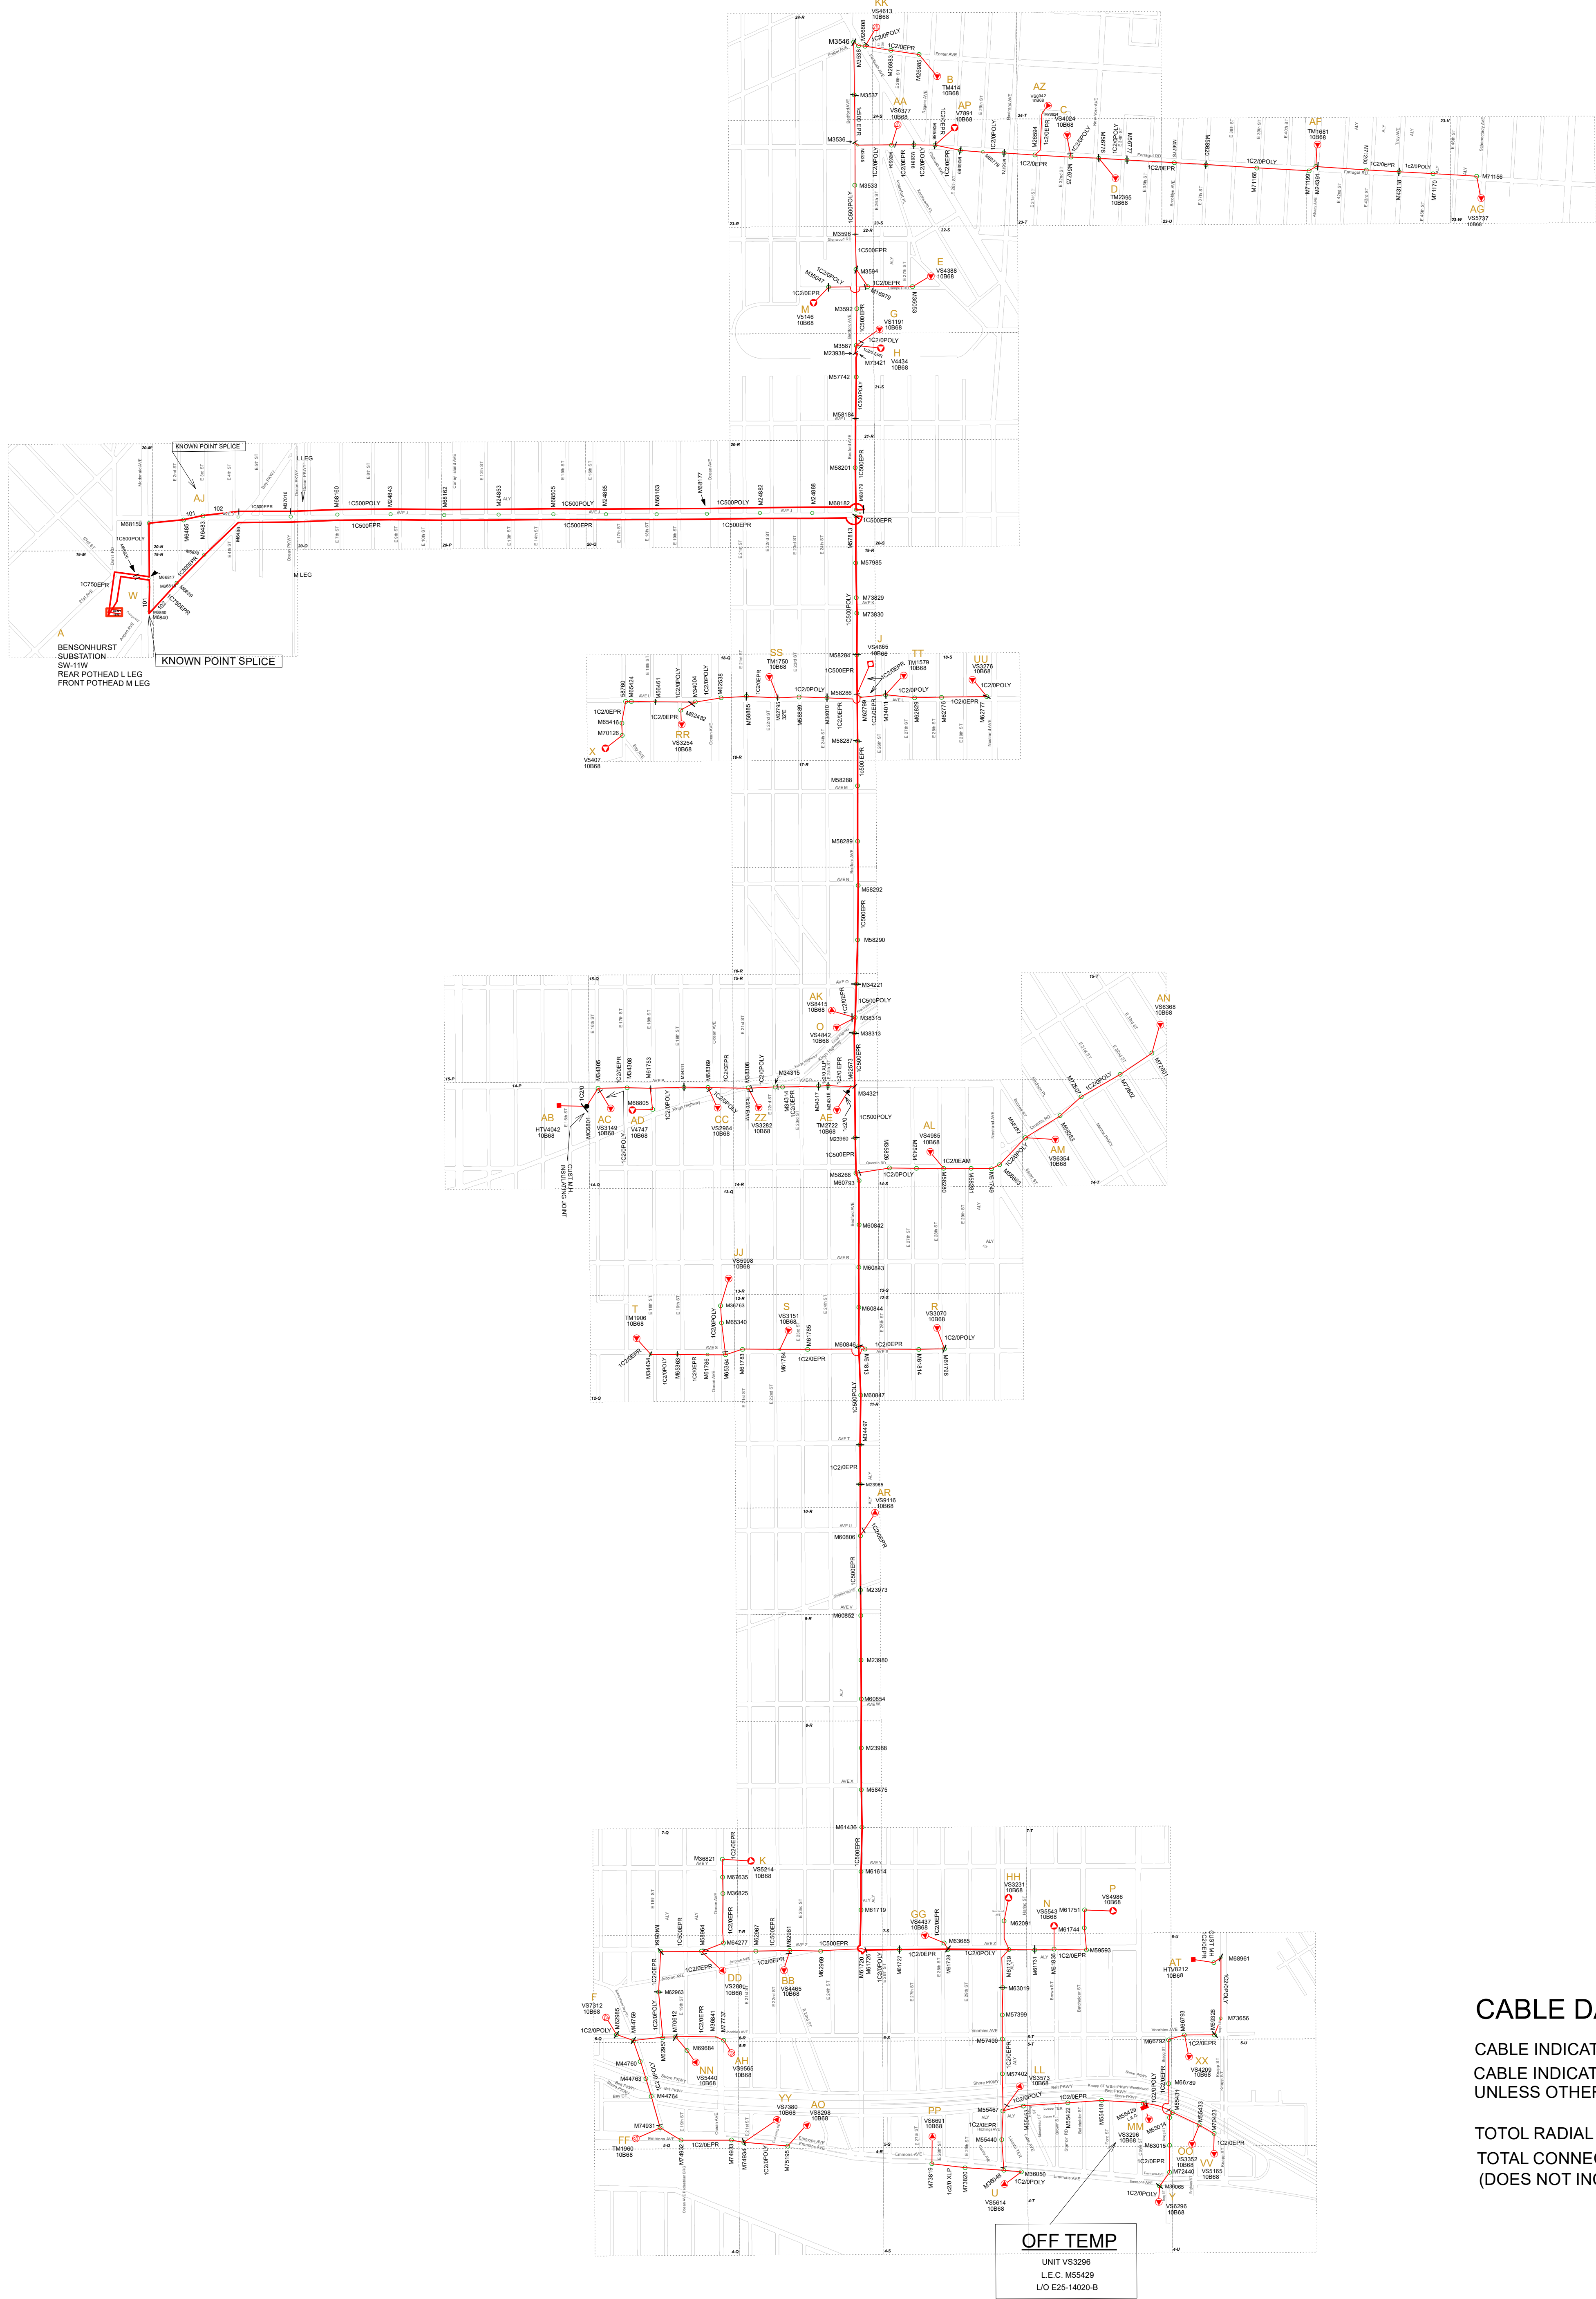

CABLE DATA

CABLE INDICATED BY A HEAVY LINE - 1C500
CABLE INDICATED BY A LIGHT LINE - 1C2/0
UNLESS OTHERWISE INDICATED

TOTAL RADIAL CONNECTED CUSTOMERS 0
TOTAL CONNECTED K.V.A. CAPACITY 33,350
(DOES NOT INCLUDE H T CUSTOMERS)

FEEDER PASSES THRU SERVICE BOX

V OR TM NO	LOCATION	N O T E	AREA	EQUIP	V OR TM NO	LOCATION	N O T E	AREA	EQUIP
A0	VS 8298 CAMBRIDGE HOUSE EMMONS AVE N.S. 517 E/O E 21 ST ELY SDWK. GRTG. ISO NW 18868 <-----> VS-7459 18863 -----> VS-8301 18864	E	5-R	500 F S Y	A	TM 414 B FOSTER AVE CENTER 38 E/O ROGERS AVE	E	19-M	500 F S Y
AP	V 7891 B FARRAGUT RD N.S 85 E/O ROGERS AVE SDWK. GRTG.	E	23-S	1000 F S Y	C	VS 4024 B E 32ND ST E.S. 35 NO FARRAGUT RD SDWK. GRTG.	E	23-T	500 F S Y
AR	VS 9116 B BEDFORD AVE E.S. 31 NO AVE U	E	10-R	500 F S Y	D	TM 2395 B FARRAGUT RD S.S. 50 E/O NEW YORK AVE	E	23-T	500 F S Y
AT	HTV 8212 CONEY ISLAND WATER POLLUTION CONTROL PLANT KNAPP ST & AVE Z PAD MOUNTED ON PRIV. PROP IN PLANT FOR ACCESS CALL 718-891-4000 18861 <-----> 18862 HTV-8212 183 HTV-8212 182 18868 <-----> 18865 VS-3438 18864 <-----> 18865 HTV-8212 181 HTV-8212 185	HT	6-U	7 30	E	VS 4388 B CAMPUS RD NO N.S. 46 E/O E 27TH ST ELY SDWK. GRTG. 18868 <-----> 18865 VS-3438	E	22-S	500 F S Y
AZ	VS 6942 B FARRAGUT PL. N.S. 112 E/O E 31 ST (R5002 FOSTER AVE.) ISO. NET. 18868 <-----> 18867 VS-8651 (FUTURE) -----> 18872 VS-8765	E	24-T	2 5	G	V 1191 B BROOKLYN COLLEGE (SCIENCE BLDG) 2935-67 BEDFORD AVE 133 NO CAMPUS RD SO 2ND SLY SDWK. GRTG. SPOT NW 18868 <-----> VS-1189 18865 -----> VS-1192 18867 -----> VS-1198 18870	E	22-S	500 F S Y
BB	VS 4465 B AVE Z S.S. 27 E/O E 22ND ST SDWK. GRTG.	E	6-R	500 F S Y	H	VS 4434 B SPOT NW 18868 <-----> 18865 V-4518 -----> 18870 VS-4687	E	21-S	500 F S Y
CC	VS 2964 B AVE P S.S. 15 W/O OCEAN AVE SDWK. GRTG.	E	14-Q	500 F S Y	J	VS 4665 B BEDFORD AVE E.S. 60 NO AVE L SHUNT REACTOR	E	16-R	600 SHUNT
DD	VS 2889 B OCEAN AVE W.S. 25 S/O AVE Z SDWK. GRTG.	E	6-Q	500 F S Y	K	VS 5214 B OCEAN AVE E.S. 47 NO AVE Y SLY SDWK. GRTG. SPOT NW 18868 <-----> 18866 VS-3743 -----> 18863 VS-5222	E	7-R	1000 F S Y
FF	TM 1960 B EMMONS AVE N.S. 40 W/O SHEEPSHEAD BAY RD	E	5-Q	750 F S Y	M	V 5148 B BROOKLYN COLLEGE CAMPUS RD NO S.S. 233 W/O BEDFORD AVE WLY SDWK. GRTG. ISOL NW 18868 <-----> 18866 VS-1578 -----> 18867 VS-1733 VS-1733	E	22-R	1000 F S Y
GG	VS 4437 B E 28TH ST W.S. 41 NO AVE Z SDWK. GRTG.	E	6-S	500 F S Y	N	VS 5543 B AVE Z N.S. 219 E/O HARING ST SDWK. GRTG.	E	7-T	1000 F S Y
HH	VS 3231 B NOSTRAND AVE E.S. 255 NO AVE Z SLY SDWK. GRTG. ISOL NW 18868 <-----> 18866 VS-1578 -----> 18867 VS-1733	E	7-S	2 5	O	VS 4842 B KINGS HWY N.S. 62W BEDFORD AVE SDWK. GRTG.	E	15-R	500 F S Y
JJ	VS 5998 B OCEAN AVE E.S. 376 S/O AVE R SDWK. GRTG.	E	13-Q	500 F S Y	P	VS 4986 B BATCHELDER ST E.S. 405 S/O AVE Y SLY SDWK. GRTG. 18868 <-----> 18865 VS-5516	E	7-T	1000 F S Y
KK	VS 4613 B FOSTER AVE N.S. 38 W/O E 25TH ST SDWK. GRTG.	E	24-S	750 F S Y	R	VS 3070 B E 28TH ST E.S. 35 NO AVE S SDWK. GRTG.	E	12-S	500 F S Y
LL	VS 3573 B NOSTRAND AVE E.S. 19 NO SHORE PKWY SDWK. GRTG. SCADA	E	5-S	500 FF S Y	S	VS 3151 B E 22ND ST E.S. 35 NO AVE S SDWK. GRTG.	E	12-R	500 FF S Y
MM	VS 3296 B SHORE PKWY S.S. 39E COYLE ST SDWK. GRTG.	E	5-T	500 F S Y	T	TM 1906 B AVE S CENTER 45 W/O E 18TH ST	E	12-Q	500 F S Y
NN	VS 5440 B E 19TH ST E.S. 17 S/O VOORHIES AVE SLY SDWK. GRTG. 18868 <-----> 18867 VS-5425	E	5-Q	500 F S Y	U	VS 5614 B EMMONS AVE S.S. 141 E/O NOSTRAND AVE SDWK. GRTG.	E	4-S	500 F S Y
OO	VS 3352 B SHORE PKWY (SO SERV RD) 44 E/O BRIGHAM ST SDWK. GRTG.	E	5-U	500 F S Y	V	VS 5174 B E 17TH ST W.S. 3175 NO AVE L NLY SDWK. GRTG. ISOL NW 18868 <-----> 18867 V-5336 -----> 18869 V-5271	E	18-Q	1000 F S Y
PP	VS 6691 B EMMONS AVE N.S. 45 E/O E 27TH ST	E	5-S	500 F S Y	X	VS 5407 B EMMONS AVE S.S. 49 W/O BRAGG ST SDWK. GRTG.	E	4-T	500 F S Y
RR	VS 3254 B E 19TH ST E.S. 39 S/O AVE L SDWK. GRTG.	E	18-Q	500 F S Y	Y	VS 6296 B FARRAGUT RD N.S. 116 E/O E 26TH ST SDWK. GRTG.	E	23-S	750 F S Y
SS	TM 1750 B E 22ND ST W.S. 37 NNC AVE L	E	18-R	500 F S Y	AA	VS 6377 B NYC TRANSIT AUTHORITY QUENTIN SUBSTATION E 16TH ST & AVE P ARRANGE FOR ACCESS W/ D.O. IN DISTRICT INVOLVED 18868 <-----> 18867 HTV-4842 184	E	14-P	1000 F S Y
TT	TM 1579 B AVE L N.S. 14 E/O E 26TH ST	E	18-S	500 F S Y	AB	VS 101 B CUSTOMER SUBSTATION	E	7	500 FF S Y
UU	VS 3276 B AVE L N.S. 58 W/O NOSTRAND AVE SDWK. GRTG.	E	18-S	500 F S Y	AC	VS 3149 B E 16TH ST E.S. 41 S/O AVE P SDWK. GRTG.	E	14-Q	500 FF S Y
VV	VS 5165 B ZIMCO REALTY CO NURSING HOME SHORE PKWY (SO SERV RD) S.S. 61 W/O KNAPP ST WLY SDWK. GRTG. SPOT NW 18868 <-----> 18864 VS-5465 -----> 18867 VS-5318	E	4-U	500 F S Y	AD	V 4747 B E 16TH ST W.S. 59 NO KINGS HWY SDWK. GRTG.	E	14-Q	1000 F S Y
XX	VS 4209 B VOORHIES AVE S.S. 167 E/O BRAGG ST WLY SDWK. GRTG. SCADA	E	5-U	500 F S Y	AE	TM 2722 B AVE P CENTER 29 W/O BEDFORD AVE	E	14-R	500 FF S Y
YY	VS 7380 B E 21TH ST E.S. 29 NO EMMONS AVE SDWK. GRTG.	E	5-R	500 F S Y	AF	TM 1681 B ALBANY AVE W.S. 42 NO FARRAGUT RD	E	23-V	500 F S Y
W	M 6860 B MCDONALD AVE E.S. 22 NNC BAY PKWY 181 TO M-66818 X 182 TO v M-6840	KNOWN POINT SPICE	19-M	500 F S Y	AG	VS 5737 B FARRAGUT RD S.S. 29 W/O SCHEMECTADY AVE SDWK. GRTG.	E	23-W	500 F S Y
AJ	M 6483 B AVENUE J N.S. 27 W/O BAY PKWY 181 TO <-----> X-----> 182 TO M-6485 TO M-6486	KNOWN POINT SPICE	20-N	500 F S Y	AH	VS 9565 B OCEAN AVE E.S. 93 S/O VOORHIES AVE SDWK. GRTG.	E	5-Q	750 F S Y
ZZ	VS 3282 B E 21 ST E.S. 40 S/O AVE. P SDWK. GRTG.	E	14-R	500 F S Y	AK	VS 8415 B BEDFORD AVE W.S. 57 NO KINGS HWY SDWK. GRTG.	E	15-R	500 F S Y
					AL	VS 4985 B E 28TH ST W.S. 24 NO QUENTIN RD SDWK. GRTG.	E	14-S	500 F S Y
					AM	VS 6354 B QUENTIN RD S.S. 31 E/O BURNETT ST SDWK. GRTG.	E	14-T	500 F S Y
					AN	VS 6368 B QUENTIN RD N.S. 40 E/O E 38RD ST SDWK. GRTG.	E	15-T	500 F S Y

NOTES:
30. Notify transit authority to disconnect auxiliary equipment prior to applying high potential test.
45. Remote Control Operating Capable Via SCADA In Control Center

NOTES:
7. Inspection of P.T.'s on customer's premises required prior to restoring feeder to service if an open phase fault occurs between the customer and the location where tracing current is applied & there is no transformer solidly connected between the fault and the customer.
NOTE: 4KV for HTV. No Longer Required with Post

NOTES:
If feeder clears within 15 minutes, the inspection of network protector for blown fuses is required, although feeder clears automatically within one minute after opening.
5. Isolated Network - See Specification EO-4007 for operation details

REVISION:

M66792 M66793 M69328 V54209
REPL. EX. W/NEW 1C2/0 EPR. CABLE
M66793 REM. LEC TO PICK UP V54209 LOC. "XX"
UPDATE GRAPHICS TO LOC. "AG"

FEEDER 10B68
27,000 Volts
SHEEPSHEAD BAY
SCALE 1" = 750'

