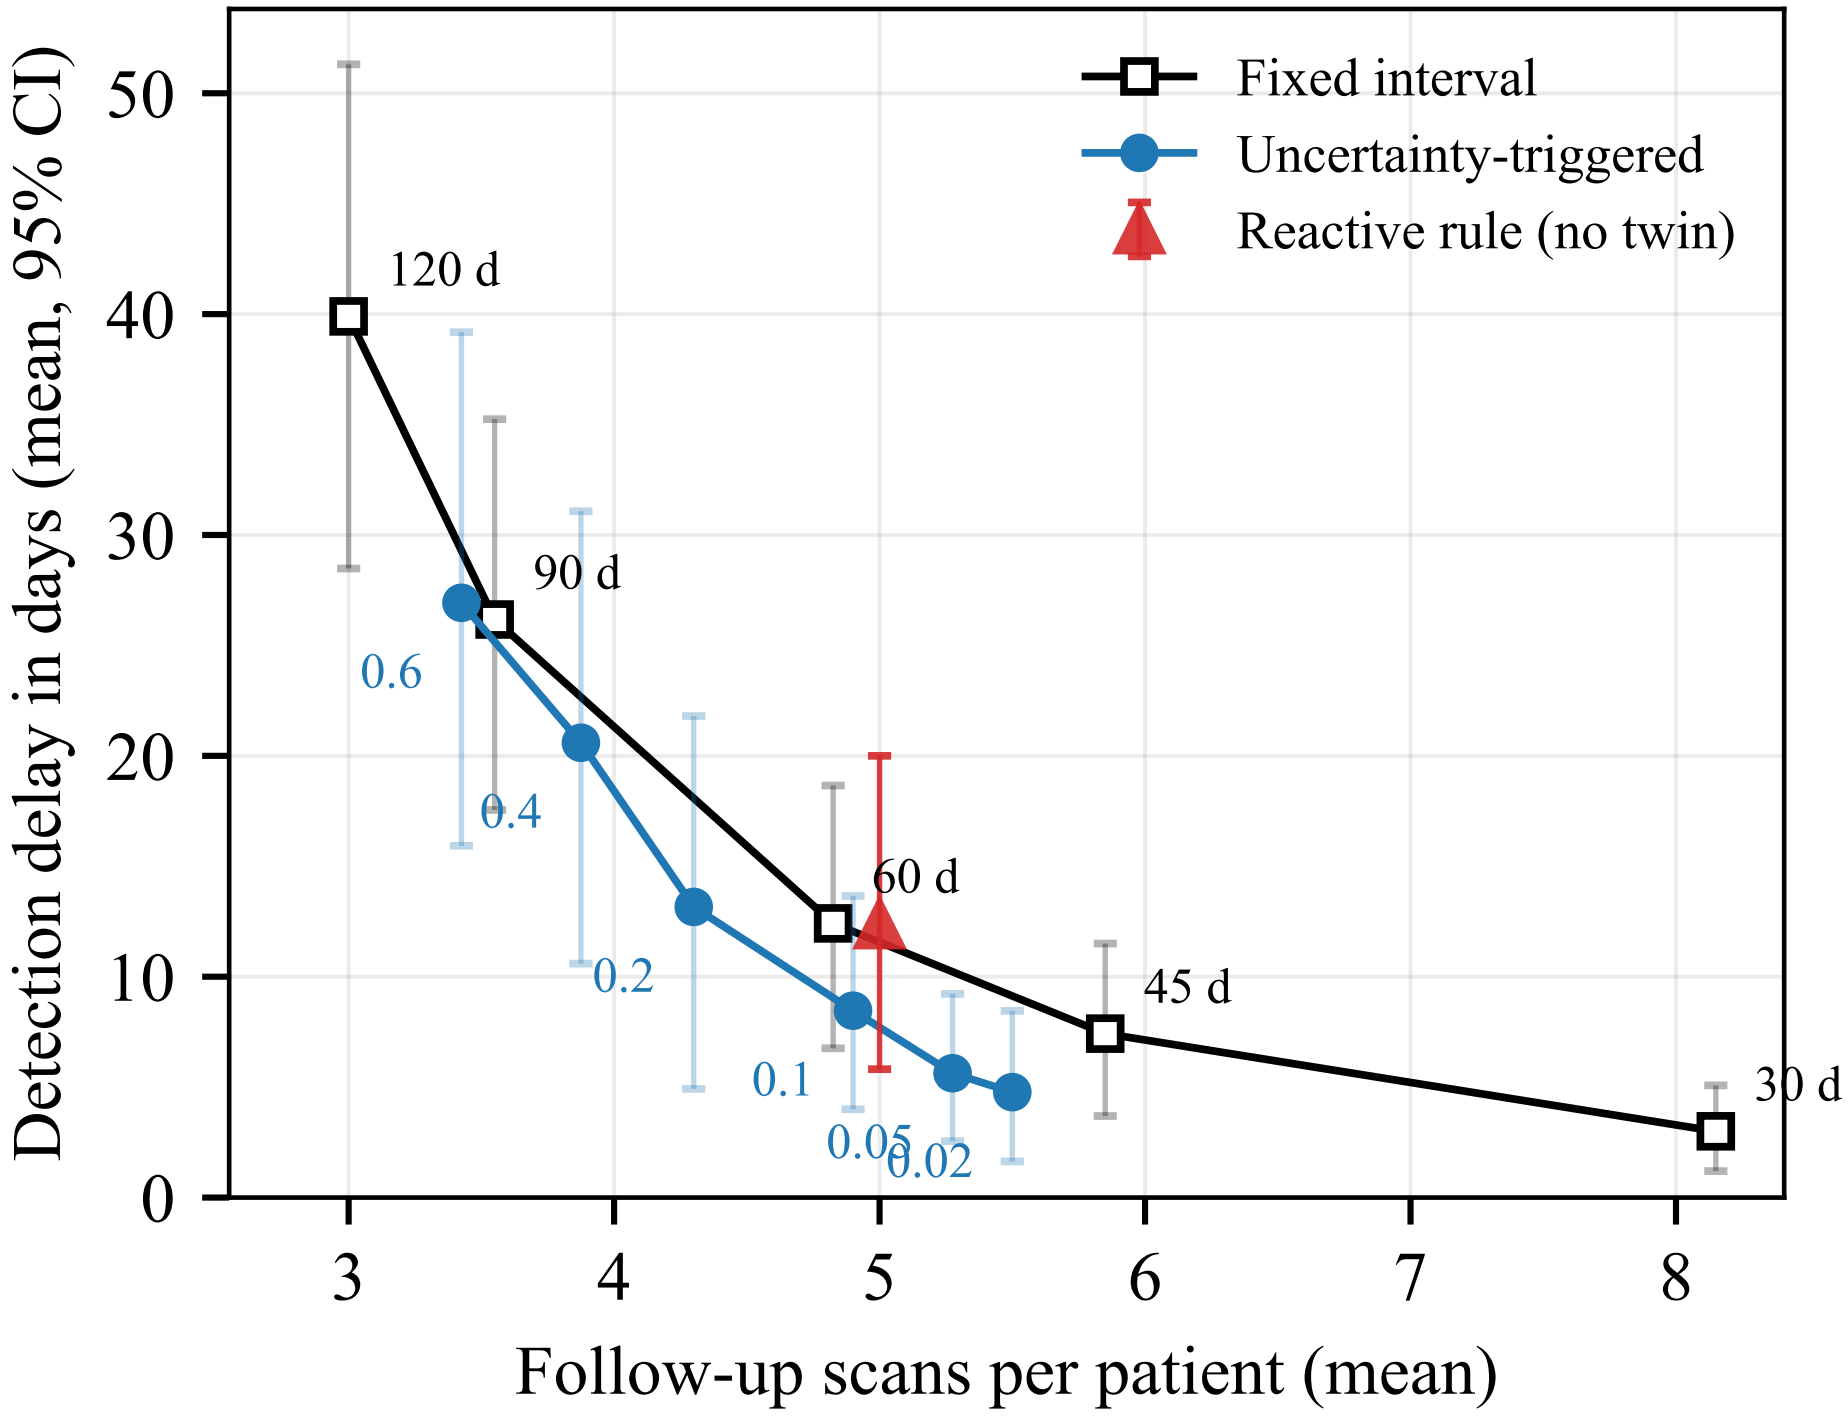
Fixed interval
Uncertainty-triggered
Reactive rule (no twin)
120 d
90 d
60 d
45 d
30 d
0.6
0.4
0.2
0.1
0.05
0.02
Detection delay in days (mean, 95% CI)
Follow-up scans per patient (mean)
0
10
20
30
40
50
3
4
5
6
7
8