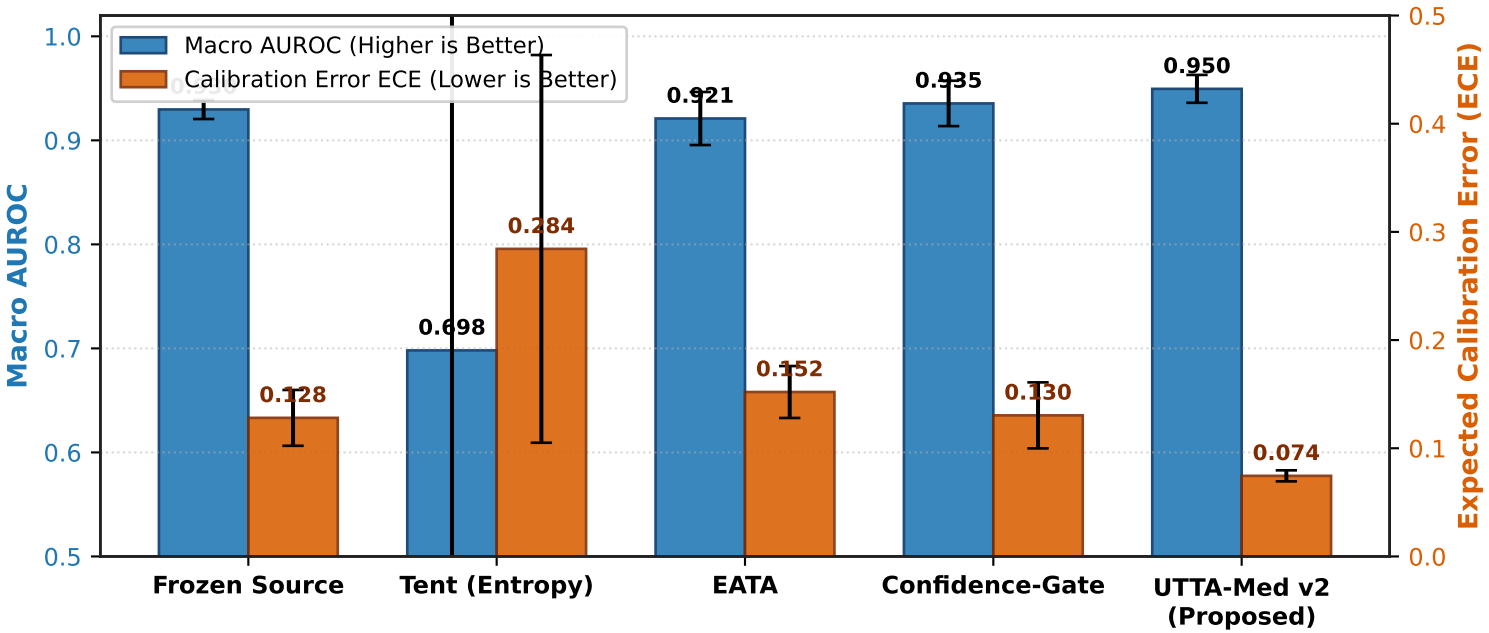
Camelyon17 Hospital 2 Benchmark: AUROC Elevation & Calibration Sharpness (5 Seeds)
Macro AUROC (Higher is Better)
Calibration Error ECE (Lower is Better)
Macro AUROC
Expected Calibration Error (ECE)
1.0
0.9
0.8
0.7
0.6
0.5
0.5
0.4
0.3
0.2
0.1
0.0
0.128
0.698
0.284
0.921
0.152
0.935
0.130
0.950
0.074
Frozen Source
Tent (Entropy)
EATA
Confidence-Gate
UTTA-Med v2
(Proposed)