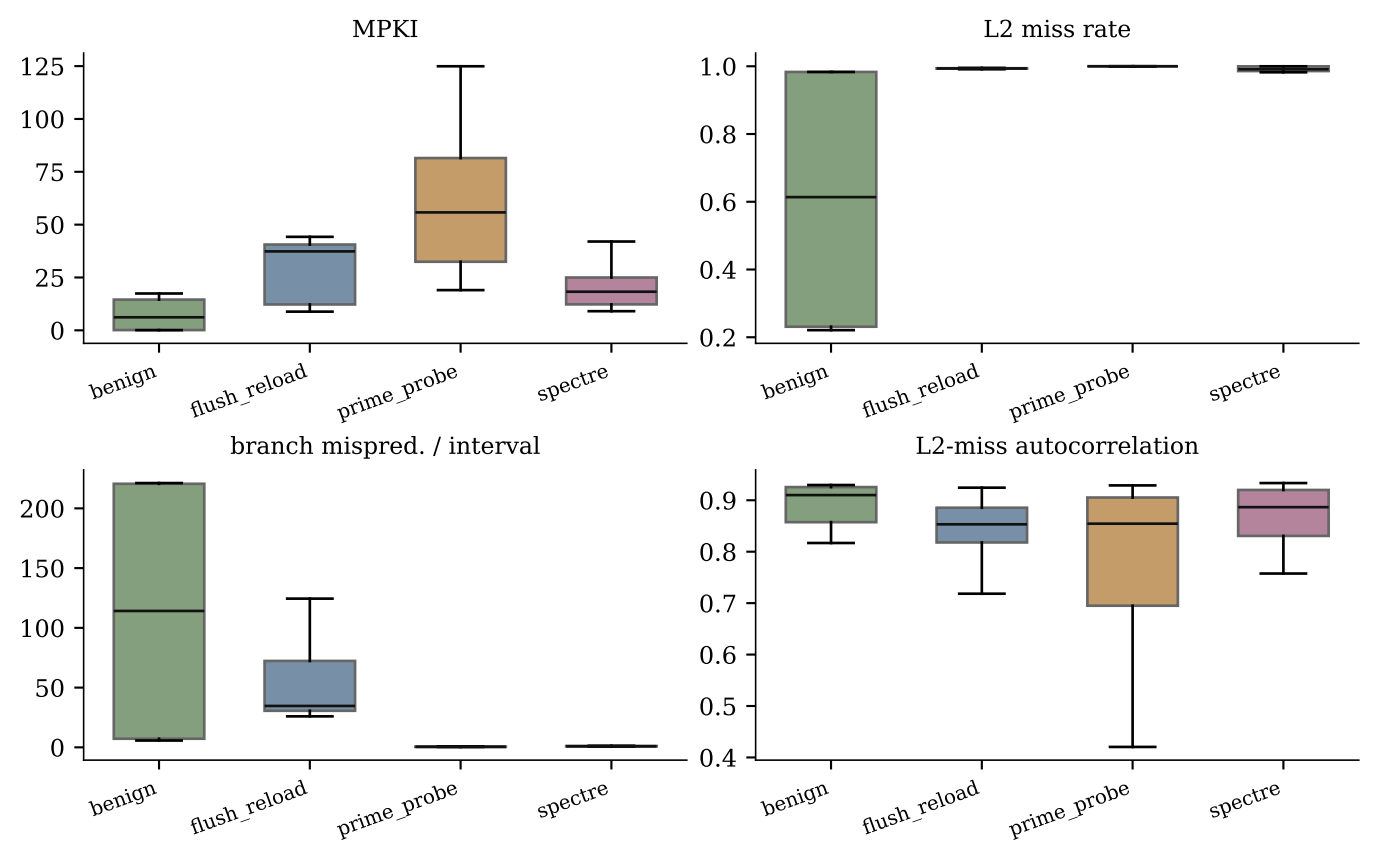
MPKI
125
100
75
50
25
0
benign
flush_reload
prime_probe
spectre
L2 miss rate
1.0
0.8
0.6
0.4
0.2
benign
flush_reload
prime_probe
spectre
branch mispred. / interval
200
150
100
50
0
benign
flush_reload
prime_probe
spectre
L2-miss autocorrelation
0.9
0.8
0.7
0.6
0.5
0.4
benign
flush_reload
prime_probe
spectre