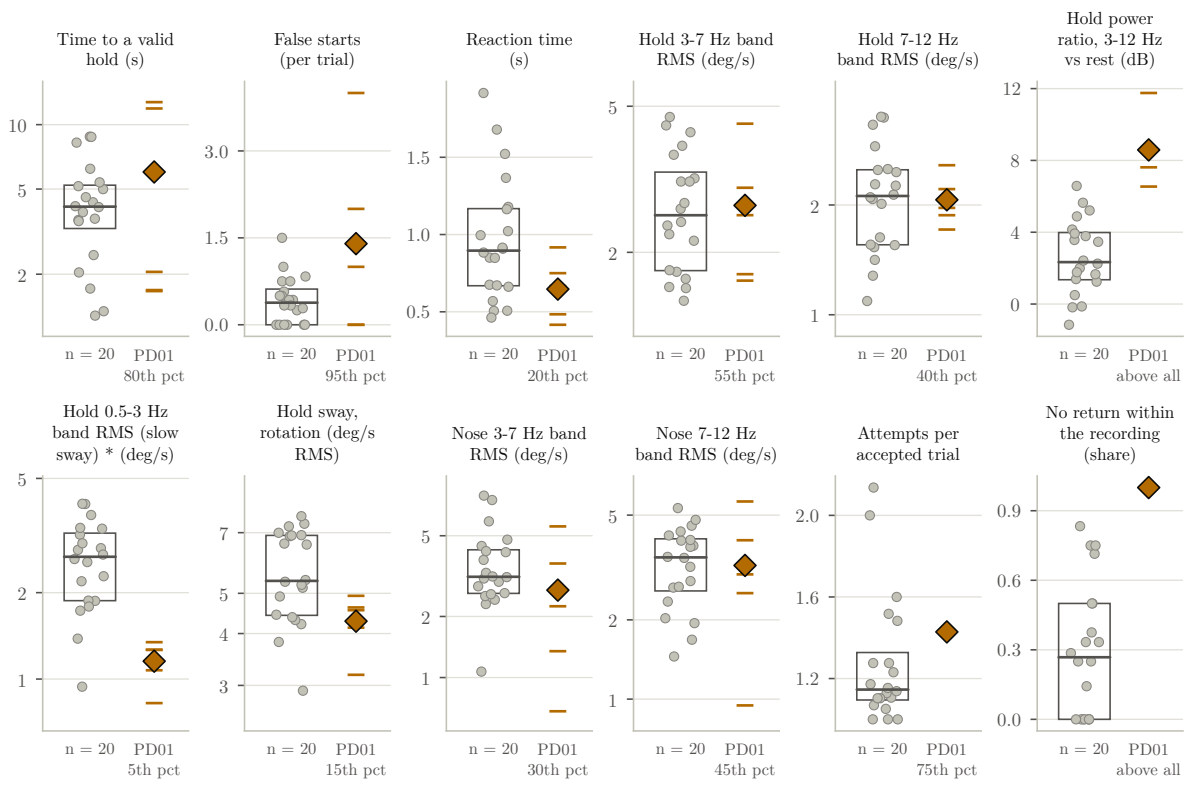
Time to a valid hold (s)
False starts (per trial)
Reaction time (s)
Hold 3-7 Hz band RMS (deg/s)
Hold 7-12 Hz band RMS (deg/s)
Hold power ratio, 3-12 Hz vs rest (dB)
Hold 0.5-3 Hz band RMS (slow sway) * (deg/s)
Hold sway, rotation (deg/s RMS)
Nose 3-7 Hz band RMS (deg/s)
Nose 7-12 Hz band RMS (deg/s)
Attempts per accepted trial
No return within the recording (share)
n = 20
PD01
80th pct
95th pct
20th pct
55th pct
40th pct
above all
5th pct
15th pct
30th pct
45th pct
75th pct