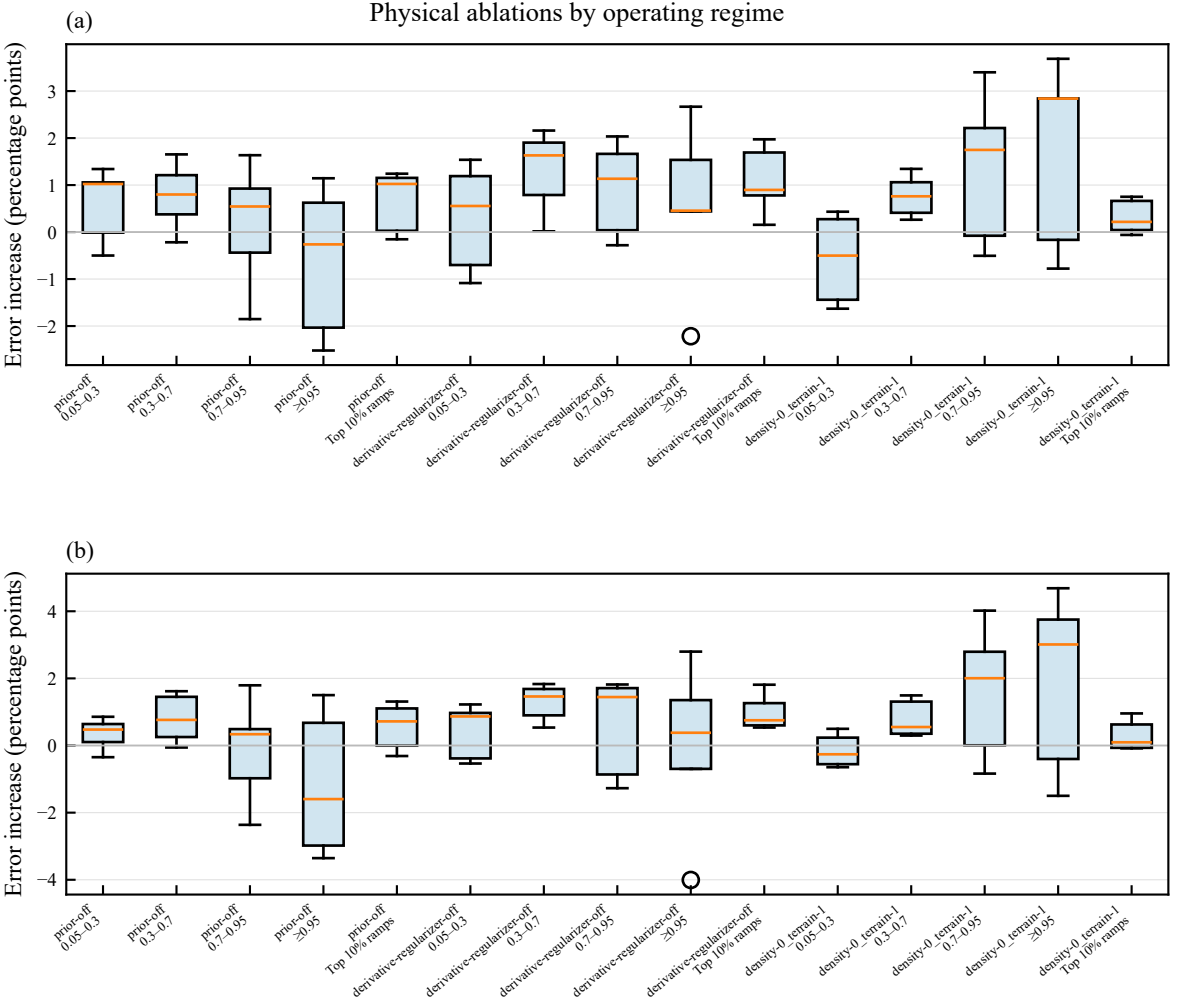
Physical ablations by operating regime
(a)
Error increase (percentage points)
3
2
1
0
−1
−2
prior-off 0.05–0.3
prior-off 0.3–0.7
prior-off 0.7–0.95
prior-off ≥0.95
prior-off Top 10% ramps
derivative-regularizer-off 0.05–0.3
derivative-regularizer-off 0.3–0.7
derivative-regularizer-off 0.7–0.95
derivative-regularizer-off ≥0.95
derivative-regularizer-off Top 10% ramps
density-0_terrain-1 0.05–0.3
density-0_terrain-1 0.3–0.7
density-0_terrain-1 0.7–0.95
density-0_terrain-1 ≥0.95
density-0_terrain-1 Top 10% ramps
(b)
Error increase (percentage points)
4
2
0
−2
−4
prior-off 0.05–0.3
prior-off 0.3–0.7
prior-off 0.7–0.95
prior-off ≥0.95
prior-off Top 10% ramps
derivative-regularizer-off 0.05–0.3
derivative-regularizer-off 0.3–0.7
derivative-regularizer-off 0.7–0.95
derivative-regularizer-off ≥0.95
derivative-regularizer-off Top 10% ramps
density-0_terrain-1 0.05–0.3
density-0_terrain-1 0.3–0.7
density-0_terrain-1 0.7–0.95
density-0_terrain-1 ≥0.95
density-0_terrain-1 Top 10% ramps