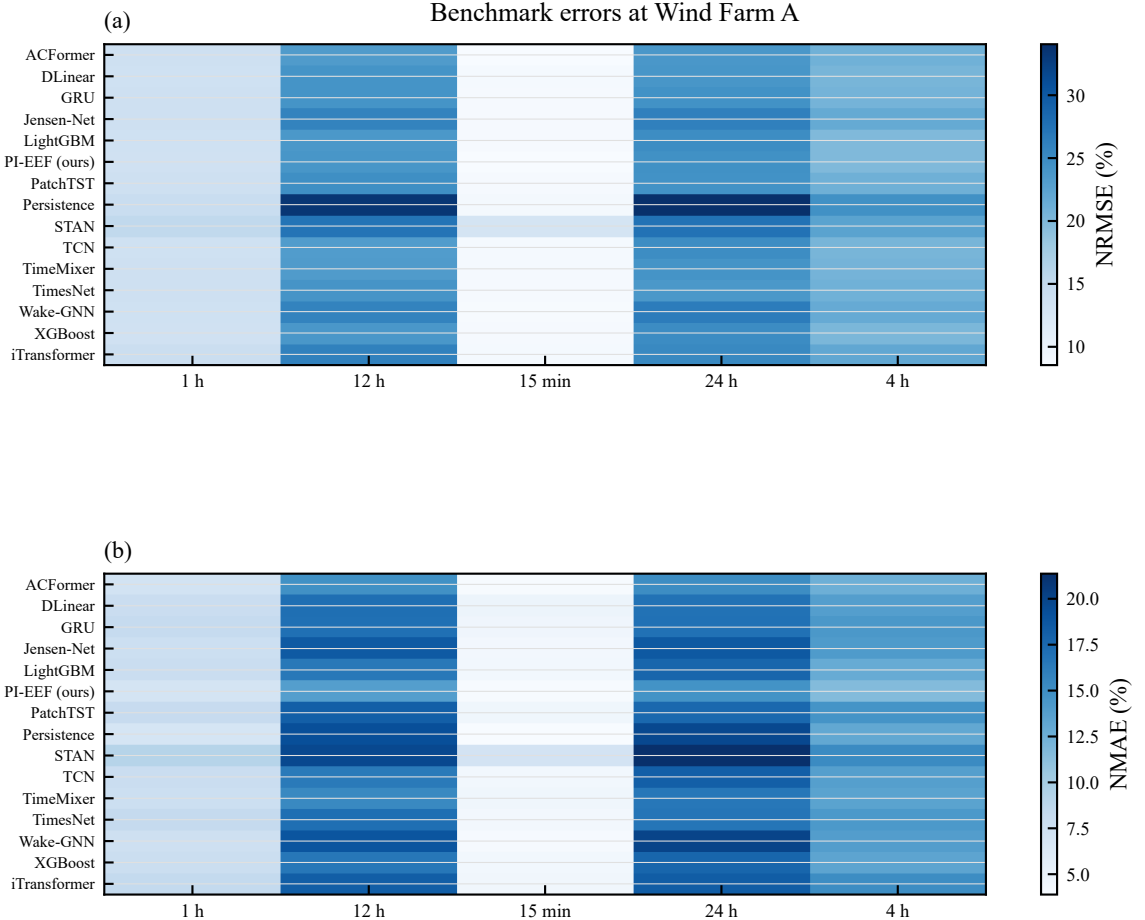

Benchmark errors at Wind Farm A
(a)
ACFormer
DLinear
GRU
Jensen-Net
LightGBM
PI-EEF (ours)
PatchTST
Persistence
STAN
TCN
TimeMixer
TimesNet
Wake-GNN
XGBoost
iTransformer
1 h
12 h
15 min
24 h
4 h
30
25
20
15
10
NRMSE (%)
(b)
ACFormer
DLinear
GRU
Jensen-Net
LightGBM
PI-EEF (ours)
PatchTST
Persistence
STAN
TCN
TimeMixer
TimesNet
Wake-GNN
XGBoost
iTransformer
1 h
12 h
15 min
24 h
4 h
20.0
17.5
15.0
12.5
10.0
7.5
5.0
NMAE (%)