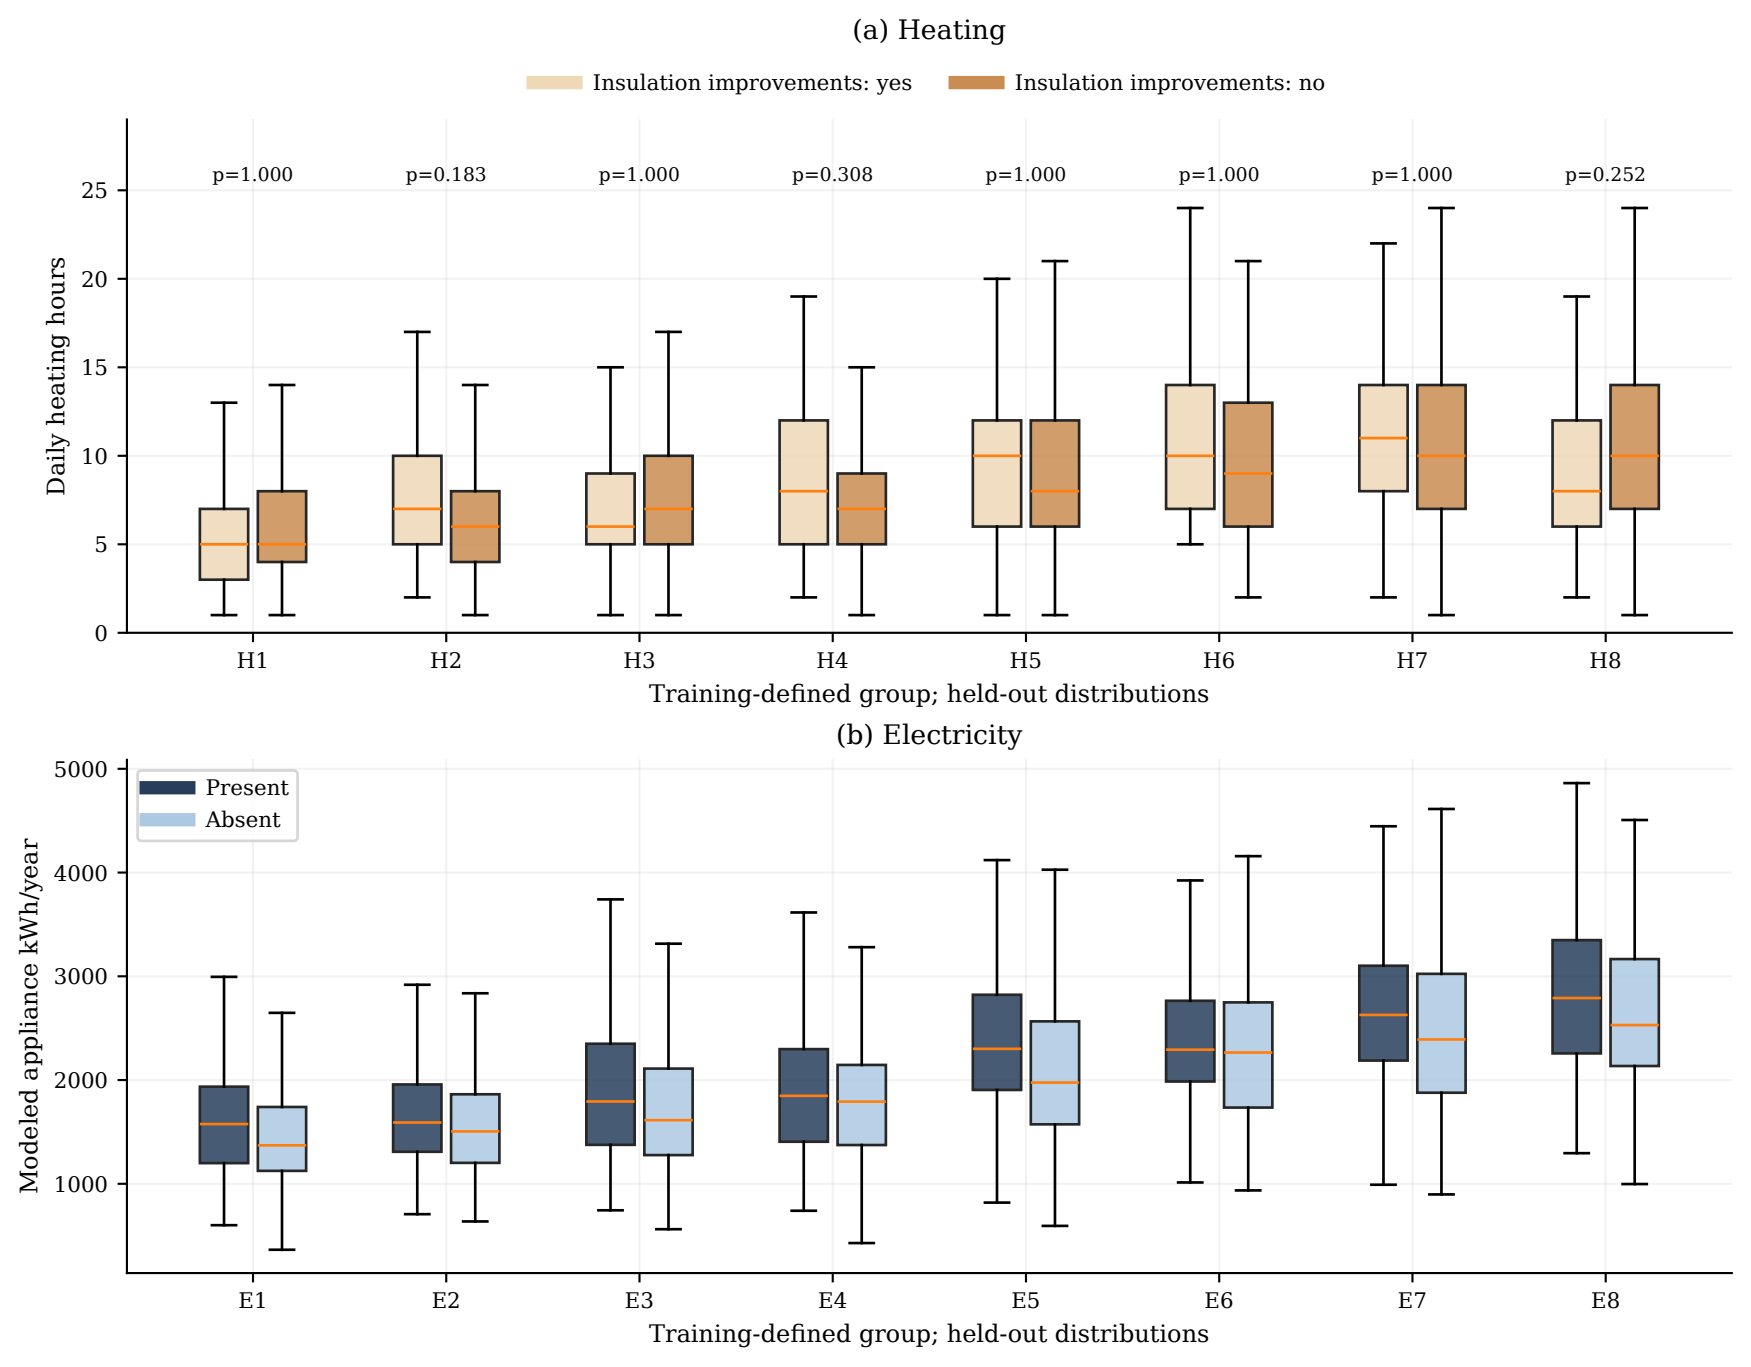
(a) Heating
Insulation improvements: yes
Insulation improvements: no
p=1.000
p=0.183
p=1.000
p=0.308
p=1.000
p=1.000
p=1.000
p=0.252
Daily heating hours
0
5
10
15
20
25
H1
H2
H3
H4
H5
H6
H7
H8
Training-defined group; held-out distributions
(b) Electricity
Present
Absent
Modeled appliance kWh/year
1000
2000
3000
4000
5000
E1
E2
E3
E4
E5
E6
E7
E8
Training-defined group; held-out distributions