



Cadillac Utilities Department

August, 2023

Claire Lowe
Michigan Department of Environment, Great Lakes, and Energy
Gaylord District Office
2100 M-32
Gaylord, MI 49735

RE: City of Cadillac Proposed MAHL and Local Limits

Dear Claire:

The purpose of this letter is to formally request EGLE review and approval of the proposed local limits and Sewer Use Ordinance updates, IPP procedures updates, and industrial permits based on the updated MAHL evaluation required by EGLE. The requested limits compared to the current limits for the non-compatible pollutants are summarized as follows:

Table 1 – Draft Standard Local Limits – Non-compatible Pollutants (Table 14 in the MAHL Report)

POLLUTANT	Current Local Limit (Daily Max) (µg/L)	Calculated Local Limit (Daily Max) (µg/L)	Proposed Local Limit (Daily Max) (µg/L)
Arsenic	26	2	2
Cadmium	2	6	2
Chromium	369	373	370
Copper	99	58	58
Cyanide, Total	4	32	4
Lead	100	29	29
Mercury	ND*	-	ND*
Molybdenum	118	33**	33**
Nickel	185	76	76
Selenium	-	13	13
Silver	3	10	3
Zinc	835	156	156
Phenols	1236	912	Report
Bis(2-ethylhexylphthalate)	-	25	Report

* Monitoring for mercury shall be in accordance with the following test methods: The discharge of mercury at or above the quantification level of 0.2 ug/l shall represent an exceedance of the local limit. Mercury sampling procedures, preservation and handling, and analytical protocol for compliance monitoring shall be in accordance with U.S. EPA Method 245.1, unless screening using Method 1631 is required by the City. The quantification level shall be 0.2 ug/l for Method 245.1 or 0.5 nanograms/liter (ng/l) for Method 1631, unless higher levels are appropriate due to sampling matrix interference.

** Molybdenum based on uniform allocation. Cadillac Castings Inc. recently requested a non-uniform allocation of the MAIL, which the City is currently evaluating.

We have chosen to allocate the MAIL uniformly for BOD₅, TSS, phosphorus and ammonia. Non-domestic users who do not have an industrial permit will be subject to standard local limits. The proposed standard local limits are summarized in Table 2 below.


Table 2 – Compatible MAHL, MAIL, and Safety Factor (Table 19 in the MAHL Report)

PARAMETER	Safety Factor	MAHL (lb/day)	Background Loading (lb/day)	Reserve Loading (lb/day)	MAIL (lb/day)	Daily Max (mg/L)
BOD ₅	-	4,366	1,452	50	2,864	400
TSS	10%	6,537	1,430	100	5,007	700
Ammonia	5%	471	238	-	233	33
Phosphorus	5%	129	40	-	89	12

Revised industrial permits, proposed changes to the Sewer Use Ordinance, and a revised IPP Procedures Manual have also been uploaded to MiEnviro Portal for review. Once the final versions are approvable, we will work with our City attorney to provide the required attorney certification.

Sincerely,

CITY OF CADILLAC

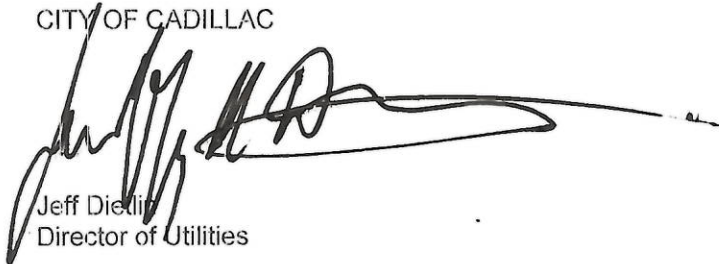

Jeff Dietlin
Director of Utilities

CC: Patrick Miller, Cadillac WWTP
Elaine Venema, Fleis & VandenBrink