

Cadillac WWTP District Compliance File — Pages 1–48, Chronological Compilation

Compiled: August 8, 2026. Source: the four searchable extracts (pages 001–048 of “2010-2016_Cadillac WWTP_District Compliance File.pdf”). Pages are re-sequenced by **document date and time** (oldest first). Original scan-file page numbers ("CF p.____") are given so every page remains traceable to the source. No page content was altered.

Ordering rules applied: email-thread pages are placed at the date/time of their newest message, with earlier thread content noted; attachments and system printouts follow the correspondence that transmitted or discusses them; undated administrative pages are grouped at the end; one blank page is retained last for completeness.

Seq.	Doc. date / time	Record	CF p.
1	12/16/2014 2:42 PM	Email, Dietlin to Wade (RE: Cadillac)	45
2	12/17/2014 9:52 AM	Email, Dietlin to Wade	41
3–4	12/17/2014 2:30 PM	Email, Wade to Wilson (FW: E2 Reporting) + E2 processing status	39–40
5–9	2014 (system printouts)	E2 submission/report records accompanying the Dec 2014 correspondence	43–44, 46–48
10–13	March 2015	Emails “FW: Current Compliance Status-QNCR” (Jankowski et al.) + QNCR spreadsheets	36–38, 42
14–21	5/14/2015 (inspection date)	Pretreatment Compliance Inspection interview forms & worksheets	28–35
22–23	6/26/2015	DEQ PCI letter (Lowe to Rahbarnoohi)	26–27
24–25	7/8/2015	City IPP response (Rahbarnoohi to Lowe)	24–25
26	10/16/2015	DEQ note to file (Michigan Rubber; “Hamid left”)	23
27	12/17/2015	City AMP schedule letter	20
28	12/21/2015	City degreaser-incident letter (12/18/2015 event)	19
29–30	1/5–1/6/2016	Email, Veldkamp FY15 SNC list (sent 1/5 5:41 PM; forwarded 1/6 9:54 AM) + list continuation	7–8
31	1/7–1/8/2016	Emails, Wade/Jankowski/Veldkamp (VN decision)	6
32–33	1/6–1/7/2016 (created)	DEQ handwritten call notes & 2015 exceedance tally	2–3
34	1/12/2016	City spill-notification letter — leachate spill during offloading (DEQ stamp 1/19/2016)	5

Seq.	Doc. date / time	Record	CF p.
35	~Jan–Feb 2016 (created)	DEQ handwritten exceedance table, Oct–Dec 2014 data	9
36–39	undated (blank forms)	Blank exceedance-table forms accompanying CF p.9	10–13
40–42	2/26/2016	City response to Violation Notice VN-006346 (DEQ stamp 2/29/2016)	14–16
43	undated	Operator certification, Jeffrey M. Dietlin	17
44	dated in part (form)	Responsible-operator designation form	18
45	undated	Stantec O&M Manual §5.0 Personnel (excerpt)	21
46	undated (compilation cover)	File cover/index sheet	1
47	undated (~Oct 2015–Jan 2016)	DEQ working notes (“Handled through IPP, all Mi Rubber”)	4
48	—	Blank page	22

Wade, Jamie (DEQ)

From: Jeff Dietlin <utilities@Cadillac-MI.net>
Sent: Tuesday, December 16, 2014 2:42 PM
To: Wade, Jamie (DEQ)
Subject: RE: Cadillac WWTP QNCR
Attachments: 201412161437.pdf

Here is the E-2 Submission report. Last page has information on it.

JEFFREY M. DIETLIN

City of Cadillac
Director of Utilities
(231) 779-7346(Direct)
(231)775-0906 (Fax)

From: Wade, Jamie (DEQ) [mailto:WadeJ@michigan.gov]
Sent: Tuesday, December 16, 2014 11:25 AM
To: Jeff Dietlin
Subject: Cadillac WWTP QNCR

Jeff,
Permits Section has compiled their Quarterly Non-Compliance Report (QNCR) and the Cadillac WWTP appears on that list. I have attached what parameters we are missing. Please take a look and address as possible. You can call or email me to discuss.
Thanks
Jamie

Jamie Wade, P.E.
Environmental Engineer
Water Resources Division, Cadillac
Dept. of Environmental Quality

231-876-4478
wadej@michigan.gov

Wade, Jamie (DEQ)

From: Jeff Dietlin <utilities@Cadillac-MI.net>
Sent: Wednesday, December 17, 2014 9:52 AM
To: Wade, Jamie (DEQ)
Subject: RE: Cadillac WWTP QNCR
Attachments: 201412161518.pdf; Current Violations_QNCR_All Districts-Cadillac WWTP.PDF

Jamie,

Attached is the form that shows only one of the December 2013 monthly reports were turned in on the State's E-2 site. I will have Hamid submit the other one as it is done but wasn't submitted.

The May and June exceedances were actual numbers and were caused by operational issues in February which killed off a majority of our nitrifiers,. Although we purchased some to restock our aeration basins they took longer than expected to establish themselves.

JEFFREY M. DIETLIN

City of Cadillac
Director of Utilities
(231) 779-7346(Direct)
(231)775-0906 (Fax)

From: Wade, Jamie (DEQ) [mailto:WadeJ@michigan.gov]
Sent: Tuesday, December 16, 2014 11:25 AM
To: Jeff Dietlin
Subject: Cadillac WWTP QNCR

Jeff,
Permits Section has compiled their Quarterly Non-Compliance Report (QNCR) and the Cadillac WWTP appears on that list. I have attached what parameters we are missing. Please take a look and address as possible. You can call or email me to discuss.

Thanks
Jamie

Jamie Wade, P.E.
Environmental Engineer
Water Resources Division, Cadillac
Dept. of Environmental Quality

231-876-4478
wadej@michigan.gov

Wade, Jamie (DEQ)

From: Wade, Jamie (DEQ)
Sent: Wednesday, December 17, 2014 2:30 PM
To: Wilson, Tiffany (DEQ)
Subject: FW: E2 Reporting: Processing Status for EDMR Submission

Tiffany,
I spoke with the operator and superintendent for the Cadillac WWTP. He did have the data and resubmitted today.
Thanks
Jamie Wade

-----Original Message-----

From: Hamid Rahbarnoohi [mailto:hrahbarnoohi@Cadillac-MI.net]
Sent: Wednesday, December 17, 2014 1:28 PM
To: Wade, Jamie (DEQ)
Subject: FW: E2 Reporting: Processing Status for EDMR Submission

Jamie,

I just resubmitted the 12/2013 Monthly DMR. I opened it and all the information was there. They had changed our DMR columns before the new NPDES took effect. For that month we did not have to do Mercury or Cyanide. I had left the monthly on those variables blank and had written explanation for daily and monthly. I now know that I should not have left it blank and should have used *G (means that the parameter was not required per NPDES permit for that month). Thanks and sorry for any inconvenience.

Hamid Rahbarnoohi
Water Resources Supervisor, Cadillac WWTP Cadillac, MI 49601
231-775-2841

-----Original Message-----

From: e2admin@michigan.gov [mailto:e2admin@michigan.gov]
Sent: Wednesday, December 17, 2014 11:56 AM
To: Hamid Rahbarnoohi
Subject: E2 Reporting: Processing Status for EDMR Submission

Michigan E2 Reporting System Message

System Time: 12/17/2014 11:56:15 AM
Atomic Time:

Hamid Rahbarnoohi Supervisor
Cadillac WWTP
200 North Lake Street

Cadillac, MI 49601

cc: ,

Subject: Processing Status for E2 Submission

This e-mail provides the processing status for the following E2 Submission:

E2 Reporting System submission status:

File Name: [ServerSide]1521_M_M1_14675_29346_2013_12.final

Upload System Time: 12/17/2014 11:56:14 AM

Status: Accepted

Your submission has been processed and no errors were found in the reporting format.

If you have any questions concerning the E2 system, please reference the guidance documents or other information on the website, or contact the E2 administrator at E2.Admin@michigan.gov

Thank you for using the Department's wastewater electronic reporting system.

View Reports for **Cadillac WWTP**

Validated Reports | Submitted Reports | Unsubmitted Reports

Use the search features below to find submitted reports which have been accepted and verified by the E2 System.

Submission Date	Start 11-1-2013	End 12-31-2014
DMR Type:	☒ All ☐ Daily ☐ Monthly	
Purpose:	☒ All ☐ Original ☐ Revised	

Purpose: ☒ Original ☐ Revised

Report	Received Date	DMR Type	Frequency	Sub. ID	Report ID	Monitor Start	Monitor End	Purp.	Ref. ID	Process Date	Status Msg.
	11-17-2014 1:13:52 PM	M1	Monthly	208197	190598	10-1-2014	10-31-2014		198901	11-17-2014	Accepted
	11-17-2014 1:12:37 PM	M2	Daily	208196	190597	10-1-2014	10-31-2014		197655	11-17-2014	Accepted
	10-16-2014 3:03:41 PM	M1	Monthly	206341	188880	9-1-2014	9-30-2014		197841	10-16-2014	Accepted
	10-16-2014 3:02:25 PM	M2	Daily	206339	188878	9-1-2014	9-30-2014		197643	10-16-2014	Accepted
	9-16-2014 2:09:06 PM	M1	Monthly	204355	187099	8-1-2014	8-31-2014		194827	9-16-2014	Accepted
	9-16-2014 2:08:08 PM	M2	Daily	204353	187097	8-1-2014	8-31-2014		194828	9-16-2014	Accepted
	8-20-2014 1:49:00 PM	M1	Monthly	203110	185935	7-1-2014	7-31-2014		194719	8-20-2014	Accepted
	8-20-2014 1:48:01 PM	M2	Daily	203109	185934	7-1-2014	7-31-2014		194720	8-20-2014	Accepted
	7-18-2014 10:21:10 AM	M1	Monthly	201059	184111	6-1-2014	6-30-2014		191232	7-18-2014	Accepted
	7-18-2014 10:18:56 AM	M2	Daily	201058	184110	6-1-2014	6-30-2014		193079	7-18-2014	Accepted
	6-18-2014										

	11:19:50 AM	M1	Monthly	199099	182334	5-1-2014	5-31-2014		191231	6-18-2014	Accepted
	6-18-2014 9:20:26 AM	M1	Monthly	199044	182282	5-1-2014	5-31-2014		191231	6-18-2014	Accepted
	6-18-2014 9:18:18 AM	M2	Daily	199041	182279	5-1-2014	5-31-2014		183893	6-18-2014	Accepted
	5-19-2014 9:13:40 AM	M1	Monthly	196942	180325	4-1-2014	4-30-2014		189533	5-19-2014	Accepted
	5-19-2014 9:11:38 AM	M2	Daily	196940	180324	4-1-2014	4-30-2014		183892	5-19-2014	Accepted
	4-10-2014 4:03:37 PM	M1	Monthly	194399	177915	3-1-2014	3-31-2014		187145	4-10-2014	Accepted
	4-10-2014 3:58:01 PM	M2	Daily	194397	177914	3-1-2014	3-31-2014		183891	4-10-2014	Accepted
	3-17-2014 11:06:03 AM	M1	Monthly	192833	176548	2-1-2014	2-28-2014		183889	3-17-2014	Accepted
	3-14-2014 2:43:54 PM	M2	Daily	192843	176474	2-1-2014	2-28-2014		183791	3-14-2014	Accepted
	3-14-2014 2:35:49 PM	M1	Monthly	192842	176473	2-1-2014	2-28-2014		183889	3-14-2014	Accepted
	2-12-2014 3:26:35 PM	M1	Monthly	190842	174619	1-1-2014	1-31-2014		183888	2-12-2014	Accepted
	2-12-2014 3:15:28 PM	M2	Daily	190841	174618	1-1-2014	1-31-2014		181700	2-12-2014	Accepted
	1-11-2014 9:56:45 AM	M2	Daily	188631	172586	12-1-2013	12-31-2013		179522	1-11-2014	Accepted
	12-10-2013 3:14:41 PM	M1	Monthly	186398	170499	11-1-2013	11-30-2013		180033	12-10-2013	Accepted
	12-10-2013 3:13:25 PM	M2	Daily	186397	170498	11-1-2013	11-30-2013		179927	12-10-2013	Accepted
	11-8-2013 1:48:23 PM	M1	Monthly	184116	168363	10-1-2013	10-31-2013		178044	11-8-2013	Accepted
	11-8-2013 1:44:55 PM	M2	Daily	184115	168362	10-1-2013	10-31-2013		178023	11-8-2013	Accepted

 View Submission

Validated Reports  Submitted Reports  Unsubmitted Reports

Use the search features below to find submitted reports which have been accepted, rejected or not yet processed by the E2 System.

Submission Date: Start 11-1-2013

End 12-31-2014

Status:  Accepted  Rejected  Processing

Download	Received Date	Sub. ID	CRC No.	Status Date	Status	Status Msg.
 XML	11-19-2014 11:18:39 AM	208457	495728569	11-19-2014 11:18:39 AM		Accepted
 XML	11-19-2014 11:18:26 AM	208456	495728569	11-19-2014 11:18:27 AM		Accepted
 XML	11-19-2014 11:16:28 AM	208455	2152942411	11-19-2014 11:16:33 AM		Accepted
 XML	11-19-2014 11:16:12 AM	208454	2152942411	11-19-2014 11:16:16 AM		Accepted
 XML	10-16-2014 11:50:46 AM	206281	3445936296	10-16-2014 11:50:46 AM		Accepted
 XML	10-16-2014 11:48:30 AM	206280	3455313605	10-16-2014 11:48:31 AM		Accepted
 XML	9-19-2014 3:16:50 PM	204764	3131969751	9-19-2014 3:16:51 PM		Accepted
 XML	9-19-2014 3:15:53 PM	204762	1801274658	9-19-2014 3:15:53 PM		Rejected
 XML	9-19-2014 3:14:35 PM	204761	4083920321	9-19-2014 3:14:35 PM		Accepted
 XML	8-19-2014 3:13:23 PM	202993	2227095352	8-19-2014 3:13:23 PM		Accepted
 XML	8-19-2014 3:13:14 PM	202992	2227095352	8-19-2014 3:13:15 PM		Accepted
 XML	8-19-2014 3:12:01 PM	202991	3704466360	8-19-2014 3:12:01 PM		Accepted

 XML	8-19-2014 3:11:46 PM	202990	3704466360	8-19-2014 3:11:46 PM		Accepted
 XML	7-18-2014 2:08:16 PM	201126	2707968626	7-18-2014 2:08:16 PM		Accepted
 XML	7-18-2014 2:08:07 PM	201125	2707968626	7-18-2014 2:08:07 PM		Accepted
 XML	7-18-2014 2:06:52 PM	201124	809143206	7-18-2014 2:06:52 PM		Accepted
 XML	7-18-2014 2:06:40 PM	201123	809143206	7-18-2014 2:06:40 PM		Accepted
 XML	6-17-2014 9:16:04 AM	198885	715748484	6-17-2014 9:16:04 AM		Accepted
 XML	6-17-2014 9:15:56 AM	198884	715748484	6-17-2014 9:15:56 AM		Accepted
 XML	6-17-2014 9:13:57 AM	198883	1496503911	6-17-2014 9:13:57 AM		Accepted
 XML	6-17-2014 9:13:48 AM	198882	1496503911	6-17-2014 9:13:48 AM		Accepted
 XML	5-19-2014 9:18:33 AM	196948	213940652	5-19-2014 9:18:34 AM		Accepted
 XML	5-19-2014 9:18:24 AM	196947	213940652	5-19-2014 9:18:24 AM		Accepted
 XML	5-19-2014 9:17:01 AM	196944	1099094328	5-19-2014 9:17:01 AM		Accepted
 XML	5-19-2014 9:16:44 AM	196943	1099094328	5-19-2014 9:16:44 AM		Accepted
 XML	4-10-2014 4:42:41 PM	194406	914280118	4-10-2014 4:42:41 PM		Accepted
 XML	4-10-2014 4:42:33 PM	194405	914280118	4-10-2014 4:42:34 PM		Accepted
 XML	4-10-2014 4:40:09 PM	194404	2225876426	4-10-2014 4:40:09 PM		Accepted
 XML	4-10-2014 4:39:54 PM	194403	2225876426	4-10-2014 4:39:55 PM		Accepted
	3-10-2014			3-10-2014		

 XML	3:35:44 PM	192407	1677117177	3:35:44 PM		Accepted
 XML	3-10-2014 3:35:34 PM	192406	1677117177	3-10-2014 3:35:34 PM		Accepted
 XML	3-10-2014 3:33:51 PM	192404	619452357	3-10-2014 3:33:51 PM		Accepted
 XML	3-10-2014 3:33:35 PM	192403	619452357	3-10-2014 3:33:35 PM		Accepted
 XML	2-14-2014 5:10:52 PM	191056	2457483361	2-14-2014 5:10:53 PM		Accepted
 XML	2-14-2014 5:10:38 PM	191055	2457483361	2-14-2014 5:10:38 PM		Accepted
 XML	2-14-2014 5:09:50 PM	191054	187028390	2-14-2014 5:09:51 PM		Accepted
 XML	1-17-2014 4:13:28 PM	189518	399707427	1-17-2014 4:13:29 PM		Accepted
 XML	1-17-2014 4:13:18 PM	189517	399707427	1-17-2014 4:13:18 PM		Accepted
 XML	1-17-2014 4:06:57 PM	189511	2575687117	1-17-2014 4:06:58 PM		Accepted
 XML	1-17-2014 4:06:47 PM	189510	2575687117	1-17-2014 4:06:47 PM		Accepted
 XML	12-11-2013 8:02:15 AM	186423	903435685	12-11-2013 8:02:15 AM		Accepted
 XML	12-11-2013 8:01:16 AM	186422	3460854284	12-11-2013 8:01:17 AM		Accepted
 XML	11-8-2013 11:53:53 AM	184095	419528461	11-8-2013 11:53:53 AM		Accepted
 XML	11-8-2013 11:52:00 AM	184093	3977092664	11-8-2013 11:52:00 AM		Accepted

Wade, Jamie (DEQ)

From: Jankowski, Brian (DEQ)
Sent: Monday, March 9, 2015 10:51 AM
To: Heuer, Janice (DEQ)
Cc: Riley, Jacob (DEQ); Maturen, Brian (DEQ); Wade, Jamie (DEQ)
Subject: FW: Current Compliance Status-QNCR
Attachments: Current Violations_QNCR_All Districts.xlsx

See below and attached

Sincerely

Brian Jankowski, P.E.
District Supervisor
Water Resources Division, Cadillac District (Cadillac Unit)
Dept. of Environmental Quality

231-429-0982 (phone)
jankowskib@michigan.gov

From: Ostlund, Peter (DEQ)
Sent: Monday, March 09, 2015 10:43 AM
To: Bartley, Cheryl (DEQ); Bauer, Charles (DEQ); Casey, Steve (DEQ); Haas, Joseph (DEQ); Jankowski, Brian (DEQ); Rudolph, Brian (DEQ); Russell, Jon (DEQ); Sanders, Jerrod (DEQ); Verona, Laura (DEQ); Worm, Michael (DEQ); Yoon, Hae-Jin (DEQ)
Cc: Masterson, Mike (DEQ); Wilson, Tiffany (DEQ)
Subject: FW: Current Compliance Status-QNCR

FYI, please have review and take appropriate actions. There are a number of non-submitted DMRs that need to be addressed.

Perhaps we can review the limit exceedances at an upcoming EERT or DS meeting.

If you have any questions about the data, please contact Tiffany Wilson. Also let her know when missing DMRs are submitted so she can act on them.

Thanks, Pete

Peter Ostlund
Field Operations Chief – Lakes Erie & Huron
Water Resources Division
517-898-5128
ostlundp@michigan.gov

From: Wilson, Tiffany (DEQ)
Sent: Monday, March 09, 2015 10:20 AM
To: Ostlund, Peter (DEQ)
Cc: Alexander, Christine (DEQ)
Subject: Current Compliance Status-QNCR

Hi Pete. I have attached a spreadsheet that shows all of the facilities (Major) that are not in compliance. Please forward to the appropriate district staff for review.

Thank you.

Tiffany Wilson
Permits Section
Water Resources Division
Department of Environmental Quality
(517) 284-5592 phone
wilsont15@michigan.gov

Facility Name	NPDES #	Violation Date	Limit Set	Parameter Name	Parameter #	Monitoring Location	Violation	District
Ludington WWTP	MI0021334	7/31/2014	001-A	Ammonia Nitrogen	00610	B	Exceeded Limit	Cadillac
		8/31/2014	001-A	Ammonia Nitrogen	00610	B	Exceeded Limit	Cadillac
		9/31/2014	001-A	Ammonia Nitrogen	00610	B	Exceeded Limit	Cadillac
Cheboygan WWTP	MI0020303	11/30/2013	001-A	Entire Month/All Parameters				Cadillac
		12/31/2014	001-A	Entire Month/All Parameters				Cadillac

Cadillac WWTP NOT on list

Facility Name	NPDES #	Violation Date	Limit Set	Parameter Name	Parameter #	Monitoring Location	Violation	District
Cadillac WWTP	MI0020257	6/30/2014	001-A	Ammonia Nitrogen	00610	1	Exceeded Limit	Cadillac
		5/31/2014	001-A	Ammonia Nitrogen	00610	1	Exceeded Limit	Cadillac
		12/31/2013	001-A	Entire Month/All Parameters			Not Submitted	Cadillac

Section I: INTERVIEW

PRETREATMENT COMPLIANCE INSPECTION

Control Authority: *Cadillac WWTP*

NPDES Permit # *MI 0020257*

Inspection Date(s): *5/14/15*

Period Covered by Inspection: *Permit cycle Nov 2013 - Present*

Inspector(s): *Jill Edelbrock/Julie Lowe*

Name	Title	Phone/e-mail
<i>Jill Edelbrock</i>	<i>EQA</i>	<i>989-894-6266</i>
<i>Julie Lowe</i>	<i>EQA</i>	<i>989-705-3446</i>

Facility Representative(s):

Name	Title	Phone/e-mail
<i>Hamid Rahbarnoo</i>	<i>Water Resource ^{Super} User</i>	<i>231-775-2841</i>
	<i>Hamid hrabbar</i>	<i>nooni@</i>
		<i>Cadillac - MI.net</i>

IPP Implementation: ERP

1. Are you having problems with any industrial users?

☒ Yes ☐ No

If yes, complete the following:

Facility Name(s)	Nature of Problem and CA Response
ARVCO	They make cardboard boxes - ink causing color changes. Low flow
CCI Cadillac Casting Inc.	Lately things are good. They are recycling water. Metals T mass bal. is ok. Less water = not much dilution. Moly, copper etc. hits in the past
Michigan Rubber Fats/oils - causing problems w/ nitrification No limit in permit NOT taking enforcement yet Just verifying sampling.	Nitrification / Ammonia limits exceeded - they don't have Nitrotufecation. Creates bump + makes primary tank malfunction. Freezing in winter. Harried is ERP: WWTP is sampling / following up. They knew about it. new toxicity
☆ this is why they are	↳ nitrification - affected by toxicity of Ammonia
AVON automotive	EPA contacted about toluene dumping down drain. Talk to Brian Sheen at plant. older - prior to Aug 2015

follow-up w/ Brian Matheson - Cadillac District office
Brian Jerkenoski or Ryan Blazic chief follow-up

2. a) Did the POTW experience any of the following since the last inspection? [R 323.2303] Please check all that apply and the cause.

Did the POTW experience any of the following?	Yes	No	Industrial Cause	Non-Industrial Cause	Cause Unknown
Interference	☒	☐	☒	☐	☒
Pass through	☒	☐	☒	☐	☒
Fire or explosion	☐	☒	☐	☐	☐
Corrosive structural damage	☐	☒	☐	☐	☐
Flow obstruction	☐	☒	☐	☐	☐
Excessive flow rates	☐	☒	☐	☐	☐
Excessive pollutant contributions	☒	☐	☐	☐	☐
Heat problems	☐	☒	☐	☐	☐
Interference due to oil & grease	☒	☐	☐	☐	☐
Toxic fumes	☐	☒	☐	☐	☐
Illicit dumping of hauled wastes	☒	☒	☐	☐	☐
Worker health & safety issues	☐	☒	☐	☐	☐
NPDES Violations (specify) Ammonia recently	☒	☐	☐	☐	☐

Michigan Rubber & Nitrification Ductile - they can't survive the winter - Each spring / early spring Ammonia on the rise

b) For each instance of industrial cause checked above provide information in table below.

IU Name	Action Taken
Michigan Rubber	Sampled FAT/oil Limit - Add to permit? Sent email waiting results + follow-up

Fat/oil / Grease = what does the SUO say → not in SUO in Resolution >

IPP Implementation: Procedures

Regulation of IUs

3. a. Any new SIUs since the last IPP Annual Report was submitted? [R323.2306 (c) (i)]

☐ Yes ☒ No

If yes, please list

- b. How do you find out about new industrial users and ensure that they are properly regulated?

They have to go to City Hall for water usage. City hall contacts WWTP. WWTP - site visit to new facilities.

4. Are all of your SIU's currently covered by an enforceable permit or equivalent control document? [R 323.2306 (a) (iii)]

☒ Yes ☐ No

If no, list and explain:

5. How many permits were reissued more than 180 days after the expiration date of the previous permit? [40 CFR 123.45 (EPA 1990 QNCR Guidance)]

None

Explain:

Inspections and Sampling

6. In the past 12 months, were all your SIU's [R 323.2306(c)(v)]:

- a) Sampled for all regulated parameters at least once by the CA?

☒ Yes ☐ No

- b) Formally inspected at least once by the CA?

☒ Yes ☐ No

(Inspections and Sampling, continued)

- c) If (a) and/or (b) is no, please list facilities that were not inspected or adequately sampled and an explanation.

Facility	Explanation

Adequate Resources

7. Describe the training provided for IPP staff since the last inspection. [R 323.2306 (e)]

Joint IPP/ Biosolids - 2 yrs ago

8. Are you planning to propose any program modifications within the next year?
[R 323.2309]

☐ Yes ☒ No

If yes, describe:

Section II: FILE REVIEW

9. Are there any specific IU's that you would like us to review during our inspection?

☒ Yes ☐ No

If yes, please list, and state reason.

Michigan Rubber
ARVCO

10. IU's selected for review:

Industry Name	File No.
ARVCO	590-20
Michigan Rubber	not recorded

Section III: SUMMARY & EVALUATION

1. Violations, deficiencies and required corrective actions:

ND

2. SNC Evaluation: Facilities that meet any Level I criteria or two or more Level II criteria are considered to be in SNC [USEPA QNCR Guidance]

a. Level I Criteria:

i. Failure to enforce against Pass-through and Interference ☒

b. Level II Criteria:

i. Failure to issue/reissue >10% of SIU permits within 180 days. ☒

ii. Failure to inspect or sample at least 80% of SIUs in the past year. ☒

iii. Failure to enforce pretreatment standards and reporting requirements ☒

iv. Any other violation of concern to the Approval Authority. ☒

c. Facility does not meet SNC Criteria ☒

3. NMS Data:

Areas Evaluated	Comment (S, M, U, NE)	Comment Detail
Enforcement Response	S	
IU Reporting	S	
IU Permits	S	
Procedures Implementation	M, S	Follow-up - EKR
Inspections/Sampling	S	
Adequate resources	S	
Legal Authority	S	
Local Limits	S	
Enforcement Response Plan	M	Follow-up
Procedures	S	

S=Satisfactory, M=Marginal, U=Unsatisfactory, NE= Not Evaluated

Corrected to

File No. _____

[illegible]

7. Introduction

REPORTING AND SCHEDULE VIOLATIONS

[illegible]



RICK SNYDER
GOVERNOR

STATE OF MICHIGAN
DEPARTMENT OF ENVIRONMENTAL QUALITY
GAYLORD FIELD OFFICE



DAN WYANT
DIRECTOR

June 26, 2015

Mr. Hamid Rahbarnoohi
Water Resources Supervisor
Cadillac WWTP
200 N. Lake Street
Cadillac, Michigan, 49601

Dear Mr. Rahbarnoohi:

SUBJECT: Pretreatment Compliance Inspection
NPDES Permit Number MI0020257
Designated Name: Cadillac WWTP

On May 14, 2015, I met with you and Jill Edelbrock from the Department of Environmental Quality (DEQ), Water Resources Division (WRD) to conduct a Pretreatment Compliance Inspection (PCI) at the Cadillac WWTP, located at 1121 Plett Road, Cadillac, Michigan. The purpose of the inspection was to evaluate the facility's compliance with Part 31, Water Resources Protection, of the Natural Resources and Environmental Protection Act, 1994 PA 451, as amended (NREPA) and the Michigan pretreatment requirements in your National Pollutant Discharge Elimination System (NPDES) Permit Number MI0020257.

The PCI Inspection included a review of the treatment plant profile, industrial user permits, monitoring data, and records kept as required by your NPDES Permit.

The following items were reviewed and/or discussed during the inspection:

1. Your annual report for 2014 included facilities in significant noncompliance (SNC). According to Part 23, Rule 323.2306 (d), publicly owned treatment works (POTWs) that have pretreatment programs must comply with public participation requirements which include public notification in the largest newspaper circulated in the municipality in which your POTW is located. This rule requires you to annually publish all categorical industrial users (CIUs) in SNC. According to your annual report, the following CIUs were in SNC, but not published in the local newspaper:
 - AAR Manufacturing (6th Avenue)
 - Cadillac Castings, Inc.
 - Rec Boat Holding, Inc. Trailer Plant
 - Rec Boat Holding, Inc. Sports
 - Rec Boat Holding, Inc. Cruiser
 - Hutchinson Anti-vibration Systems (formerly known as Paulstra)
2. The inspection revealed impacts to your facility related to fats, oils and grease discharged from Michigan Rubber. This discharge is causing interference with nitrification at the plant resulting in NPDES Permit limit exceedances for ammonia. According to your Electronic Discharge Monitoring Reports (e-DMR), ammonia was exceeded in February 2015, March 2015, and April 2015.

3. According to your 2014 Annual Report, Michigan Rubber is not considered a Categorical Industrial User (CIU). During the inspection, MDEQ questioned the accuracy of Michigan Rubber's listing. After reviewing the Industrial User Permit for Michigan Rubber, it was unclear if Michigan Rubber meets any subcategory in the Categorical Designation listed in 40 CFR, Part 428, Rubber Manufacturing Point Source.

According to Part 23, Rule 323.2306 (g), the POTW shall develop and implement an enforcement response plan (ERP) containing detailed procedures indicating how a POTW will investigate and respond to instances of nondomestic user noncompliance. The purpose of this requirement is to insure protection of the plant for non-domestic discharges of industrial nature.

During the inspection, we discuss enforcement efforts made and an email sent to Michigan Rubber on April 17, 2015. Michigan Rubber responded that an audit would be completed and the source was unknown.

This letter serves as a reminder to implement your approved Enforcement Response Plan (ERP). MDEQ considers this violation to be considered major due to the exceedance of your NPDES permit limit, recurring nature, and observed harm to the plant. Enclosed you will find your approved ERP. Please respond to this letter indicating what further action has taken place to resolve this issue since the date of the inspection.

Please further evaluate whether or not Michigan Rubber is a CIU. MDEQ can offer assistance with this process.

As discussed during the inspection, we recommend the following updates to your Industrial User (IU) Permits:


- Include a facility description in each permit. Identify what they do to produce process wastewater.
- Include whether or each facility listed is a CIU.
- Include the process of flow.
- Update your pH data column, you cannot have a 30 day average as a limit for pH.
- Include the monitoring location in each permit.
- Inspection forms should include the following additional information: name of inspector, whether or not the inspection was announced, process description, wastewater flow information, wastewater treatment information.

Please respond in writing to items 1-3 above **no later than July 30, 2015**.

We appreciate your efforts to maintain compliance with the pretreatment requirements of your NPDES permit.

Should you require further information, please contact me directly at 989-705-3446 or lowej2@michigan.gov.

Sincerely,



Julie Lowe
Water Resources Division

Enclosure
cc/enc: Jill Edelbrock, DEQ

CITY OF CADILLAC MICHIGAN

200 North Lake Street • Cadillac, Michigan 49601
231.775.0181 • fax 231.775.8755
www.cadillac-mi.net

Received
WILLIAMS

JUL 14 2015

GAYLORD FIELD OFFICE

July 08, 2015

Julie Lowe
Water Resources Division
Gaylord Field office
2100 W. M-32
Gaylord, MI 49735-9282

Dear Ms. Lowe,

Subject: Pretreatment Compliance Inspection
NPDES Permit MI0020257
Designated Name: Cadillac WWTP

This is a response to your letter dated June 26, 2015 with the subject above attached herein.

Item 1.

I have done the annual IPP for the Cadillac WWTP since 2011 and I did not know that I had to publish all Categorical Industrial Users in SNC in a local paper. We have a good working relationship with the local industries in town and publishing this information will tarnish our relationship. We have been visiting and communicating with our permitted industries throughout the year and try to resolve any issues in regards to their operation and their discharge limits.

Item 2.

We are not sure if Michigan Rubber was responsible for what was affecting the WWTP. We did Fats, Oils, and Grease (FOG) as to see the possible source of grease coming to the plant from an Industrial User. Michigan Rubber had a detectable hit on FOG. The FOG concentration through Haring TWP main sewer line was also analyzed and was much greater than any other FOG readings. Since June 16, 2015 the Haring WWTP has been receiving that flow and it is no longer a part of our collection system.

We lost our nitrification ability toward the end of January 2015. As you know, growing nitrifying bacteria in the winter is difficult especially with one of the coldest winters we have had on the record. We also had problems with filamentous bacteria that cause poor settling and bulking. A toxicity issue was a concern, and so we did various tests on the incoming flows to the plant. It is also possible that we were getting flows from a non-permitted or a non-industrial location.

I visited and spoke to various permitted facilities about their discharge and their permits and had several walk-throughs. Currently the WWTP is meeting the ammonia limits and is running efficiently with 96-98% TSS removal efficiency.

Item 3.

I believe that Michigan Rubber should be a CIU. We welcome any assistance in evaluating whether or not Michigan Rubber is a CIU.

This is the description found under automotiveoem.com for Michigan Rubber Products Inc.:

*Michigan Rubber Products, Inc.
Zhongding Sealing Parts (USA) Inc.
1200 Eighth Avenue
Cadillac, Michigan 49601 - USA
Telephone: 231-775-1316
Fax: 231-775-3160
Tier I & II
Certificates: ISO/TS 16949, ISO 14001
Number of locations: 2
Employees: 400
Facility size: 156,000 ft.²
Year founded or site established: 1972*

www.michigan-rubber.com

Services include compression/transfer molding, rubber and plastic injection molding, extrusion and automated cutting and assembly. Products area includes air induction, NVH, Static gaskets, tubing (air, water and Fuel).

Per your suggestion, we will include your recommendations on Industrial user (IU) permits in future.

Please contact me or Jeff Dietlin (231-779-7346) if you need any other information or have any concerns.

Best Regards,



Hamid Rahbarnoohi
200 N. Lake St.
Cadillac, MI 49601
231-775-2841

No CC to Samir Wale?

Note to the File

To: Julie Lowe
From: Julie Lowe
Date: October 16, 2015
Re: Michigan Rubber

Hamid left the Cadillac WWTP and replacing him for the moment is Jeff Dietlin. Jeff mentioned that issues with oil and grease at the facility have been resolved. Jeff contacted Michigan Rubber and dischargers to the Haring Township line and told them that someone is discharging oil and grease and if it continues, the city will fine the facilities found responsible. Michigan Rubber's contribution was less than half of what was coming from the Haring Township lift station.

As of October 2015, this issue is resolved.

I spoke to Jeff about completing a categorical determination for Michigan Rubber as mentioned in Hamid's letter dated July 8, 2015. Jeff believes they are categorical and not sure why they were listed only as an SIU. The Cadillac WWTP samples monthly at the facility and are treating them as if they are categorical. This will change in the next annual report.

CITY OF CADILLAC MICHIGAN

200 North Lake Street • Cadillac, Michigan 49601
231.775.0181 • fax 231.775.8755
www.cadillac-mi.net

12/17/2015

Dear Mr. Jamie Wade,

As you know we are currently working on our Asset Management Plan for the City of Cadillac. We thank the MDEQ for the financial assistance opportunity in order to let us develop our detailed Asset Management Plan. We were awarded the grant in Round 2 and we plan to have the full Asset Management Plan completed before the end of the SAW Grant period. We understand that in order to satisfy the current permit requirements that you need the schedule for our Asset Management Plan (AMP) work.

Our AMP schedule is:


Current Work

Spring/Summer 2016
Fall 2016 (9/30/16)
Winter/Spring 2017

Perform data collection and Assessing Condition
Perform Level of Service and
Risk and Consequence of Failure Analysis
Write Asset Management Plan
Complete Asset Management Plan
Determine Rate Structure/User Charges

We have attached Section 5.0 of our Operation and Maintenance Manual addressing Personnel Requirements as well as the Organization Chart for the Utilities Department for the City which is consistent with the change in the NPDES permit. If you would like, we can also provide you with our current system map that of course will be updated during our SAW Grant work. Otherwise we will wait on a map submittal until it has been updated with the field collected data. Please let me know if you require any additional information for reissuance of our NPDES permit.

Sincerely,

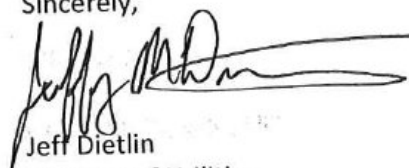

Jeff Dietlin
Director of Utilities
City of Cadillac
231-775-0181 ext 124

WATER RESOURCES
DIVISION

DEC 21 2015

CADILLAC DISTRICT OFFICE



Cadillac Utilities Department

December 21, 2015

Dear Mr. Jamie Wade,

On the afternoon of Friday December 18th an incident occurred at the Cadillac Waste Water Treatment Plant. An operator was performing a routine chemical cleaning of our Aqua Disk cloth filtration system. The operator had bypassed the three tanks and pumped the tanks solids to the head works of the plant. The operator then refilled the tanks with approximately 6,000 gallons each of tertiary water. Five gallons of Grease B Gone degreaser was added in total to the three tanks. Upon adding the degreaser the operator set the tanks to recirculate for a few hours. After recirculation the operator would normally pump the chemical solution to the head works where it can be treated before restoring the tanks to normal operation. Instead the operator returned the tanks to normal operation sending the chemical solution to our effluent. This took place around 12:30 p.m.

At approximately 1:30 p.m. fish in the onsite fish tank appeared to become incapacitated. The fish tank is feed with the plants effluent. At this time the operator was instructed to bypass the Aqua Disk filtration tanks stopping the chemical solution from going to our effluent. Immediately following this you were contacted and personnel were sent out to observe the effluent. Plant personnel walked the river banks looking for any sign of the degreaser in the river. There was no sign or indication the chemical had impacted the river in anyway.

Some of the fish in the fish tank and minnow net did expire but the majority of the incapacitated fish retuned to an active state within 20 to 30 minutes of redirecting the diluted cleaning solution. The Aqua Disk filtration tanks were then filled with tertiary water to further dilute and rinse the degreaser away. It was then pumped to the head works for treatment. This process was repeated three times before restoring the plant back to normal operation.

To prevent this or any other similar occurrences from happening in the future these processes will be gone over and more appropriate training will take place. Once again we would like to thank you for taking the time to come out and look things over.

A handwritten signature in black ink, appearing to read "Jeffrey M. Dietlin".

Jeffrey M. Dietlin
Utilities Director
City of Cadillac
(231)775-9326

WATER RESOURCES
DIVISION

DEC 21 2015

CADILLAC DISTRICT OFFICE

From: Jankowski, Brian (DEQ)
Sent: Wednesday, January 6, 2016 9:54 AM
To: Heuer, Janice (DEQ) <HEUERJ@michigan.gov>; Wade, Jamie (DEQ) <WadeJ@michigan.gov>
Subject: FW: Michigan FY15 Annual SNC list
Importance: High

Jamie and Janice

Please review and address. Cadillac WWTP and Ludington WWTP are on this list. Respond to me and we will forward a response to Jon and Chris after that.

Sincerely

Brian Jankowski, P.E.
District Supervisor
Water Resources Division, Cadillac District (Cadillac Unit)
Dept. of Environmental Quality

231-429-0982 (phone)
jankowskib@michigan.gov

From: Veldkamp, Christine (DEQ)
Sent: Tuesday, January 05, 2016 5:41 PM
To: Bauer, Charles (DEQ); Casey, Steve (DEQ); Haas, Joseph (DEQ); Hartz, Andrew (DEQ); Jankowski, Brian (DEQ); Jordan, Kameron (DEQ); Kammer, Stephanie (DEQ); Masterson, Mike (DEQ); Myers, Tiffany (DEQ); Ostlund, Peter (DEQ); Pennala, Virginia (DEQ); Rudolph, Brian (DEQ); Saldivia, Luis (DEQ); Sanders, Jerrod (DEQ); Vanderlaan, Mary (DEQ); Verona, Laura (DEQ); Worm, Michael (DEQ); Yoon, Hae-Jin (DEQ)
Cc: Russell, Jon (DEQ); Ostlund, Peter (DEQ)
Subject: Michigan FY15 Annual SNC list

Dear District Supervisors,

EPA has sent us their FY15 Annual Significant Noncompliance (SNC) list for review. More than half of the significant noncompliance was associated with DMR Non-Receipt (likely due to the transition to MiWaters). We will be working with EPA to address this.

However, there were still 19 major facilities that had other SNC violations. Four of the 19 permittees appropriately received violation notices to address the noncompliance. The other 15 permittees in SNC do not appear to have been addressed as required by EPA. Two of the 15 in SNC had violations in FY14 that were unaddressed.

In 2014, the WRD and EPA presented 3 PowerPoint presentations to field staff about how to handle major facilities in SNC. The attached presentation discusses EPA's expectations, but the important slides are 32-38.

The following permittees were in SNC for 2015 and no action appears to have been taken to address the noncompliance (specifically the violations associated with the SNC on the Annual List or due to unresolved violations after the VN was issued):

Great Lakes Tissue Co
Lansing BWL-Eckert Station
St Louis WWTP
Saline WWTP

BASF- Wyandotte
Neenah Paper-Munising Paper
Cargill Salt Div-St Clair
Stoneco Inc-Maybee
Cadillac WWTP
Cheboygan WWTP
Ludington WWTP
Hillsdale WWTP
St Johns WWTP

FutureMark Manistique – FY14 SNC
Marquette WWTP – FY14 SNC

District staff should be sending VNs to these permittees to address their SNC and perhaps pursuing escalated enforcement if the issues won't be resolved soon. Please provide a response to Jon Russell and copy me on what action was, or will be, taken to address each of these facilities in SNC.

If you have any questions about this, please let me know. Thanks.

Chris Veldkamp

Water Resources Division
Department of Environmental Quality
State of Michigan Building
350 Ottawa Ave NW Unit 10
Grand Rapids MI 49503
616-401-1556 (new phone number)
veldkampc@michigan.gov

Wayne Co
Cadillac WWTP
Jan 2016

Wade, Jamie (DEQ)

From: Veldkamp, Christine (DEQ)
Sent: Friday, January 8, 2016 9:58 AM
To: Wade, Jamie (DEQ)
Cc: Jankowski, Brian (DEQ)
Subject: RE: Michigan FY15 Annual SNC list

I am happy to help if you need it ☺.

Chris Veldkamp

Water Resources Division
Department of Environmental Quality
State of Michigan Building
350 Ottawa Ave NW Unit 10
Grand Rapids MI 49503
616-401-1556 (new phone number)
veldkampc@michigan.gov

From: Wade, Jamie (DEQ)
Sent: Friday, January 8, 2016 9:48 AM
To: Veldkamp, Christine (DEQ) <VELDKAMPC@michigan.gov>
Cc: Jankowski, Brian (DEQ) <JANKOWSKIB@michigan.gov>
Subject: FW: Michigan FY15 Annual SNC list

Chris,
I will be sending a violation notice to Cadillac. They have already made changes to plant operations and staff to rectify their frequent SNC during late 2014 and early 2015.
I've not issued a VN like this so, I may be looking for some guidance.
Thanks
Jamie

From: Wade, Jamie (DEQ)
Sent: Thursday, January 7, 2016 12:19 PM
To: Jankowski, Brian (DEQ) <JANKOWSKIB@michigan.gov>
Subject: RE: Michigan FY15 Annual SNC list

Brian,
It appears that Cadillac WWTP did have some significant exceedances for several months in late 2014 through June of 2015. The NMS software in the past did highlight values that were or could be in violation and that would alert the viewer to review further. The DMRs in 2015 and late 2014 were not highlighted or flagged as a violation in NMS or in MiWaters under the 'violations' tab.

I did speak to Jeff Dietlin (Utilities director for Cadillac) and said that Cadillac would likely receive a violation notice from me (DEQ) and that I would be requesting some sort of report from him as to how the exceedances occurred and what steps have been taken to reduce the likelihood of them reoccurring.

I will be watching their DMRs a little closer and will follow up as needed.

Jamie

Cadillac WUSTP

	(Exceedance)	
Jan 2015	CBOD ₅	1-16-15 1-21-15
Feb 2015	TSS	2-23-15
March 2015	FE max They Given	3-30-15 & Ammonia
April 2015	Geometric Mean + Ammonia	
May 2015	(Many) ?	all over?
June 2015	(Many)	all over
July 2015	(NONE)	
August	(NONE)	
Sept.	(NONE)	
October	(NONE)	
Nov.	(NONE)	
Dec.	(NONE)	NOT submitted as of 1-6-2016

1-6-2016 called Jeff Dietlin to find out what is happening
Left v.m.


1-7-2016 Jeff mentioned a black sledge.

* Jeff says that faultily was in NOD-compliance
I said I would send an email later on
what we should do NOW. He what I will
expect from him.

* Review of Violations in DMS does NOT show violations w/rt
DNR values. Rather than Reviewing DMS I was looking
list of violations. / DMS was NOT flagging violations/exceedances.

Violations: months	Daily (Violations)		Flagged in NMS
	monthly	Violations	
2015 June	yes	yes	TSS CBODs - Ammonia TSS CBOD Ammonia NO
2015 May	yes	yes	CBODs - Ammonia - TSS CBODs - Ammonia - TSS NO
2015 April	NO	yes	X Ammonia X NO
2015 March	NO	yes	Ammonia TSS NO
2015 Feb	yes	yes	monthly Ammonia TSS CBODs
2015 JAN	yes	NO	X
2014 Dec	NO	NO	X
2014 Nov	yes	yes	Ammonia CBODs Ammonia NO
2014 Oct	yes	yes	Ammonia TSS CBODs phosphorus (monthly)
2014 Sep	NO	NO	X
2014 August	NO	NO	X
2015 July	NO	NO	X
2015 August	NO	NO	X
2015 September	NO	NO	X
2015 October	NO	NO	X
2015 November	NO	NO	X
2015 December	NA	NA	1-7-2016 NOT yet submitted

* Violations "FLAGGED" in minutes

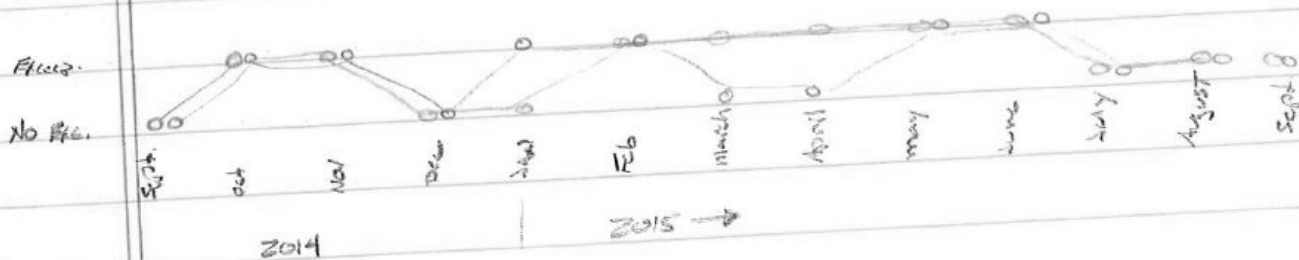

May of 2014 was latest violations flagged

January 12, 2016

Dear Mr. Jamie Wade,

Per part 2 Section C paragraph 7 spill notification of our NPDES permit I'm writing this letter to inform you of a spill. On the morning of January 12, 2016 at 9:22 am I received a call from Larry Springberg, the leachate driver for American Waste. He informed me that there had been a leachate spill while offloading. While heading out to survey the situation I promptly contacted the Director of Utilities Jeff Dietlin to report the spill to him. Upon arrival of the incident I noticed the discharge from the truck had ended. I witnessed the tail end of the leachate running along the edge of the asphalt and ponding at a lower elevation around the bend from the truck.

At that time we took immediate actions to contain the spill. Snow berms were plowed up to help contain the ponding leachate from running toward the river. While containing the ponding I looked over the three storm drains in the area. Two of them were out of harm's way due to elevation. The third was in the direct path of the leachate. Three sand bags were placed on the storm drain in the drive and snow was pack around it to ensure no leachate enter the storm drain structure and thus eventually into the river. The leachate truck can contain up to ten thousand gallons, it was determined less than this amount was spilled. We continued to monitor the leachate at the spill. Upon the arrival of the Director of Utilities we contacted you Mr. Wade and asked you to take a look at the spill site. Together we surveyed the spill site and you gave us your recommendation for cleanup.

The frozen slush was pushed off the asphalt via a plow truck to the ponded area. All the contaminated snow was taken off the spill site, edges of the road and around the area that the leachate ponded. The dirt was scrapped down to the frost level in all the affected areas via a backhoe and loader. All contaminated material was removed and hauled to the waste water treatment plants drying beds where it can filter through and be treated by the process. All excavated areas were back filled with fresh top soil.

At this time it was believed that a leachate truck driver pulled the hose almost all the way out of the waste stream to prevent freezing. The weight and heat of the next morning's leachate delivery made the hose pliable and heavy pulling it out of the hole that secures the hose to the waste stream. To prevent this from happening in the future we will have the leachate truck drivers check the hose depth and remain in their trucks while offloading. I believe this will help reduce the risk of a spill this size from happening again. Thank you for taking time out of your day to help us with this matter.

Respectfully,



Douglas Langworthy
Assistant Water Resources Supervisor
City of Cadillac W.W.T.P.
231-775-2841

WATER RESOURCES
DIVISION

JAN 19 2016

CADILLAC DISTRICT OFFICE

2014

[illegible]

[illegible]

[illegible]

DATE	PARAMETER	EFFLUENT LIMITATION		REPORTED VALUES	
		Daily Maximum	Monthly Average	Daily Maximum	Monthly Average
5-19-15	TSS max 7-day	30 mg/L		51.50	
5-19-15	TSS max 7-day	800 lb/day		861.70	
5-19	CBODs max 7 day	270 lb/day		308.91	
5-19	CBODs max daily	10 mg/L		21.0	
5-19	Ammonia N	2 mg/L		2.46	
5-20	CBODs	10 mg/L		12.9	
5-20	Ammonia N	2 mg/L		3.08	
5-21	TSS	30 mg/L		68.00	
5-21	TSS	800 lb/day		1069.11	
5-21	CBODs max 7	270 lb/day		339.60	
5-21	CBODs	10 mg/L		21.60	
5-21	Ammonia	53 lb/day		77.35	
5-21	Ammonia	2 mg/L		4.92	
5-22	TSS	30 mg/L		87.00	
22	TSS	800 lb/day		1248.09	
22	CBODs	270 lb/day		309.86	
22	CBODs	10 mg/L		21.6	
22	Ammonia	53 lb/day		66.56	
22	Ammonia	2 mg/L		4.64	
5-25	TSS	30 mg/L		199.00	
5-25	TSS	800 lb/day		3337.03	
5-25	CBODs	270 lb/day		352.15	
5-25	CBODs	10 mg/L		21.0	
5-25	Ammonia	2 mg/L		2.87	
5-26	TSS	30 mg/L		60.00	
5-26	TSS	800 lb		972.82	
5-26	CBODs	270 lb		289.41	
5-26	CBODs	10 mg		17.9	
5-26	Ammonia	2 mg		2.28	
5-27	CBODs	10 mg/L		11.4	
5-28	CBODs	10 mg/L		12	
5-28	Ammonia	53 lb/day		55.76	
5-28	Ammonia	2 mg/L		3.40	
5-29	CBOD	270 lb/day		362.76	
5-29	CBOD	10 mg/L		21.00	
5-29	Ammon	53 lb/day		86.37	
5-29	Ammon	2 mg/L		5.0	
may	TSS max monthly	—	20 mg/L	—	28.7
may	CBODs max monthly	—	190 lb/day	—	190.47
may	CBODs	—	7 mg/L	—	11.87
may	Ammonia max monthly	—	24 lb/day	—	47.2
may	Ammonia max monthly	—	0.9 mg/L	—	3.0



Cadillac Utilities Department

WATER RESOURCES
DIVISION

FEB 29 2016

CADILLAC DISTRICT OFFICE

February 26, 2016

Mr. Jamie Wade, P.E.
Michigan Department of Environmental Quality
Cadillac District Office
120 West Chapin Street
Cadillac, Michigan 49601

Re: Violation Notice – Cadillac WWTP VN No. VN-006346

Dear Mr. Wade,

This is in response to your letter dated February 1, 2016 which you informed us of violations that occurred at the Cadillac waste water treatment plant. We will describe what happened and what was done to mitigate the situation. I believe that there were two separate incidents that took place leading up to the violations noted. The first period of violation took place from October 21, 2014 to November 27, 2014 and the second violation period was from January 9, 2015 to June 23, 2015.

At this time it isn't entirely clear what the influent or operational problems were because the plant supervisor that was in charge during the duration of violation periods is no longer here. I do know that there was an influx of material in both instances that caused a large mass of floating sludge on the primary clarifiers. This floating mass caused severe settling issues within the plant. The solids passing through the aeration basins into the secondary clarifiers' caused bulking within the clarifier tanks. The operators were instructed to continually increase the RAS and WAS, which increased the solids loading problem on the plant. The bulking made its way through the tertiary treatment causing our clothe filtration to bypass. The solids then made it through U.V. disinfection reducing U.V. dose and then into the river. I believe that a lack of communication and supervision led to the majority of these problems.

The increased unsettled solids passing through the plant caused the following violations on several occasions between October 21, 2014 and November 27, 2014:

- Total Suspended Solids 7-day Ave. mg/L

- Total Suspended Solids 7-day Ave. lbs./day
- CBOD5 lbs./day
- CBOD5 mg/L
- Fecal Coliform Max 7-day Gm.
- Ammonia as (N) mg/L
- Ammonia as (N) 7-day Ave. lbs./day
- Ammonia lbs./day
- Total Phosphorus

The following operational procedures were put into action to mitigate the issues dated above:

- Double pumping to reduce the solids in the primary clarifiers.
- Increased ferric chloride feed to aid in secondary settling.
- Increased aeration to provide more oxygen for the bacteria and to aid in driving off Ammonia.
- Mild Chlorine solution to control filamentous.
- Increased IPP monitoring to minimize the possibility of unwanted inflow.

The increased unsettled solids passing through the plant caused the following violations on several occasions between January 9, 2015 and June 23, 2015:

- Total Suspended Solids 7-day Ave. mg/L
- Total Suspended Solids 7-day Ave. lbs./day
- Total Suspended Solids Monthly Ave. Max
- Total Suspended Solids % Removal
- CBOD5 Monthly Ave. Max
- CBOD5 lbs./day
- CBOD5 mg/L
- Fecal Coliform Max 7-day Gm.
- Ammonia as (N) mg/L
- Ammonia as (N) 7-day Ave. lbs./day
- Ammonia Monthly Ave. Max
- pH

The following operational procedures were put into action to mitigate the issues dated above:

- Double pumping to reduce the solids in the primary clarifiers.
- Increased ferric chloride feed to aid in secondary settling.
- Increased aeration to provide more oxygen for the bacteria and to aid in driving off Ammonia.
- Mild Chlorine solution to control filamentous.
- Increased IPP monitoring to minimize the possibility of unwanted inflow.

At this time I would like to thank you for your time addressing the violations that took place. As I previously stated before the supervisor that was here at the time of the violation periods is no longer here. That being said I will never completely know all of the exact causes or events that took place. I also cannot give an explanation as to why the supervisor did not give written notice for each occurrence as is required in our NPDES permit. The only information I have is the vague violation reports I have received from the previous supervisor and information given to me by the operators. The poor communication and lack of supervision have been removed from the operations at the Cadillac waste water treatment plant. Through this I believe we will not have these operational issues again. Again I would like to thank you for your time.

Respectfully,

A handwritten signature in black ink, appearing to read 'Jeffrey M. Dietlin', with a long horizontal flourish extending to the right.

Jeffrey M. Dietlin
Director of Utilities
City of Cadillac
231-779-7346 direct line
231-775-0906 fax

State of Michigan Department of Environmental Quality

This is to certify that

Jeffrey M. Dietlin

having submitted acceptable evidence of qualifications, in accordance with the requirements of the Rules Governing the Certification of Sewage Treatment Works Operators, is qualified to operate any sewage treatment works of any of the following classifications:

A, B, C, D

Issued

March 4, 2014

Expires

April 15, 2017

Operator I.D. Number

10435

ISSUED BY THE DIRECTOR OF THE DEPARTMENT OF ENVIRONMENTAL QUALITY
UNDER AUTHORITY OF ACT 451, P. A. 1984, AS AMENDED

EQP 3402
REV 3/2014



DATE: 2-26-2016

TO: Michigan Department of Environmental Quality
Water Resources Division

ATTN: Brian Jankowski, Supervisor
Cadillac District Office

I hereby designate JEFFREY M. DIETRICH as the responsible operator in charge of the waste treatment facilities at CADILLAC W.W.T.P. discharge Permit No. MI0020257. He/she has met the requirements of the Department and has been properly certified. The Certificate No. is 10435, and the license classification(s) are A, B, C, D. The names, certificate number, and license classification(s) of other operators who are employed at the above facilities are listed below.

<u>Name</u>	<u>Certificate No.</u>	<u>License Classification(s)</u>
<u>Doug Langworthy</u>	<u>18398</u>	<u>C, D</u>
<u>DEBBIE GOODRICH</u>	<u>18456</u>	<u>C, D</u>
<u>KEVIN BRIGGS</u>	<u>19127</u>	<u>C, D</u>
<u>BRETT BALCOLM</u>	<u>19178</u>	<u>D</u>
<u>DAVE SKIFF</u>	<u>19190</u>	<u>D</u>

JEFFREY M. DIETRICH
Name
UTILITIES DIRECTOR
Title
CITY OF CADILLAC
Company

Send this form to: Brian Jankowski, Supervisor
Water Resources Division
Cadillac District Office
Department of Environmental Quality
120 West Chapin Street
Cadillac, MI 49601

Stantec
CITY OF CADILLAC
WASTEWATER TREATMENT PLANT
OPERATION AND MAINTENANCE MANUAL

5.0 PERSONNEL

5.1 PERSONNEL REQUIREMENTS

The operation of the Cadillac WWTP and collection system is accomplished by qualified personnel. For routine operation of the WWTP, it is expected that personnel will be required eight hours per day, five days a week, and one operator per day on call during weekends and holidays, in addition to laboratory requirements. The collection system, sewers and forcemains is maintained by the City's Utilities Department. However, the collection system lift stations are maintained by the WWTP staff. The organizational structure of the Utilities Department is outlined in **Appendix F**.

5.2 CERTIFICATION

The Department of Environmental Quality, Municipal Wastewater Division, General Rules, requires that the wastewater plant operator (the person signing the monthly operating report) be certified, and that the certification be equivalent or higher than the classification of the treatment plant.

The supervisor of the Cadillac WWTP plant is required to have a Class "B" license, according to the general rules.

WATER RESOURCES
DIVISION

DEC 21 2015

CADILLAC DISTRICT OFFICE

♦ Original O & M Manual prepared by ALNM 1975, was used in the preparation of this revision.

1-2-2018

Balcom	Brett O.	19178 D	January 15, 2018	Cadillac
Briggs	Kevin R.	19127 C, D	January 15, 2018	Cadillac
Campbell	Larry H.	10497 A, B, C, D	April 15, 2017	Cadillac
Dietlin	Jeffrey M.	10435 A, B, C, D	April 15, 2017	Cadillac
Goodrich	Derek W.	18456 C, D	July 15, 2017	Cadillac
Hoffert	Elijah L.	18977 D	July 15, 2016	Cadillac
Langworthy, Jr.	Douglas K.	18398 C, D	July 15, 2016	Cadillac
Marquardt	Chad K.	19368 D	January 15, 2019	Cadillac
Skiff	David W.	19190 D	January 15, 2018	Cadillac
Stein	Eric M.	18662 C, D	July 15, 2016	Cadillac
Vail	Amy J.	18553 D	July 15, 2016	Cadillac
Rahbarnoochi	Hamid	11717 A, B, C, D	July 15, 2018	Cadillac WWTP

City of Cadillac

* Handled through IPP
all mi Rubbers.

- o Letter 6-26-15 (printed)
- o Note to file 10-16-15
- o Julie interview notes 5-14-15
- o Memo to Julie 7-8-15

* Harmon Hills Violations in minutes
(Review violations)


* Blatantly NOT Complying (Notifications)
on IPP side

* Copy of Draft to Julie so she can add
her own notes w/ or
IPP violations.

~~(231) 389-0141 2:47 pm Jim Vogler~~
~~Discussion Re.~~

**CITY OF
CADILLAC
MICHIGAN**

Utilities Department

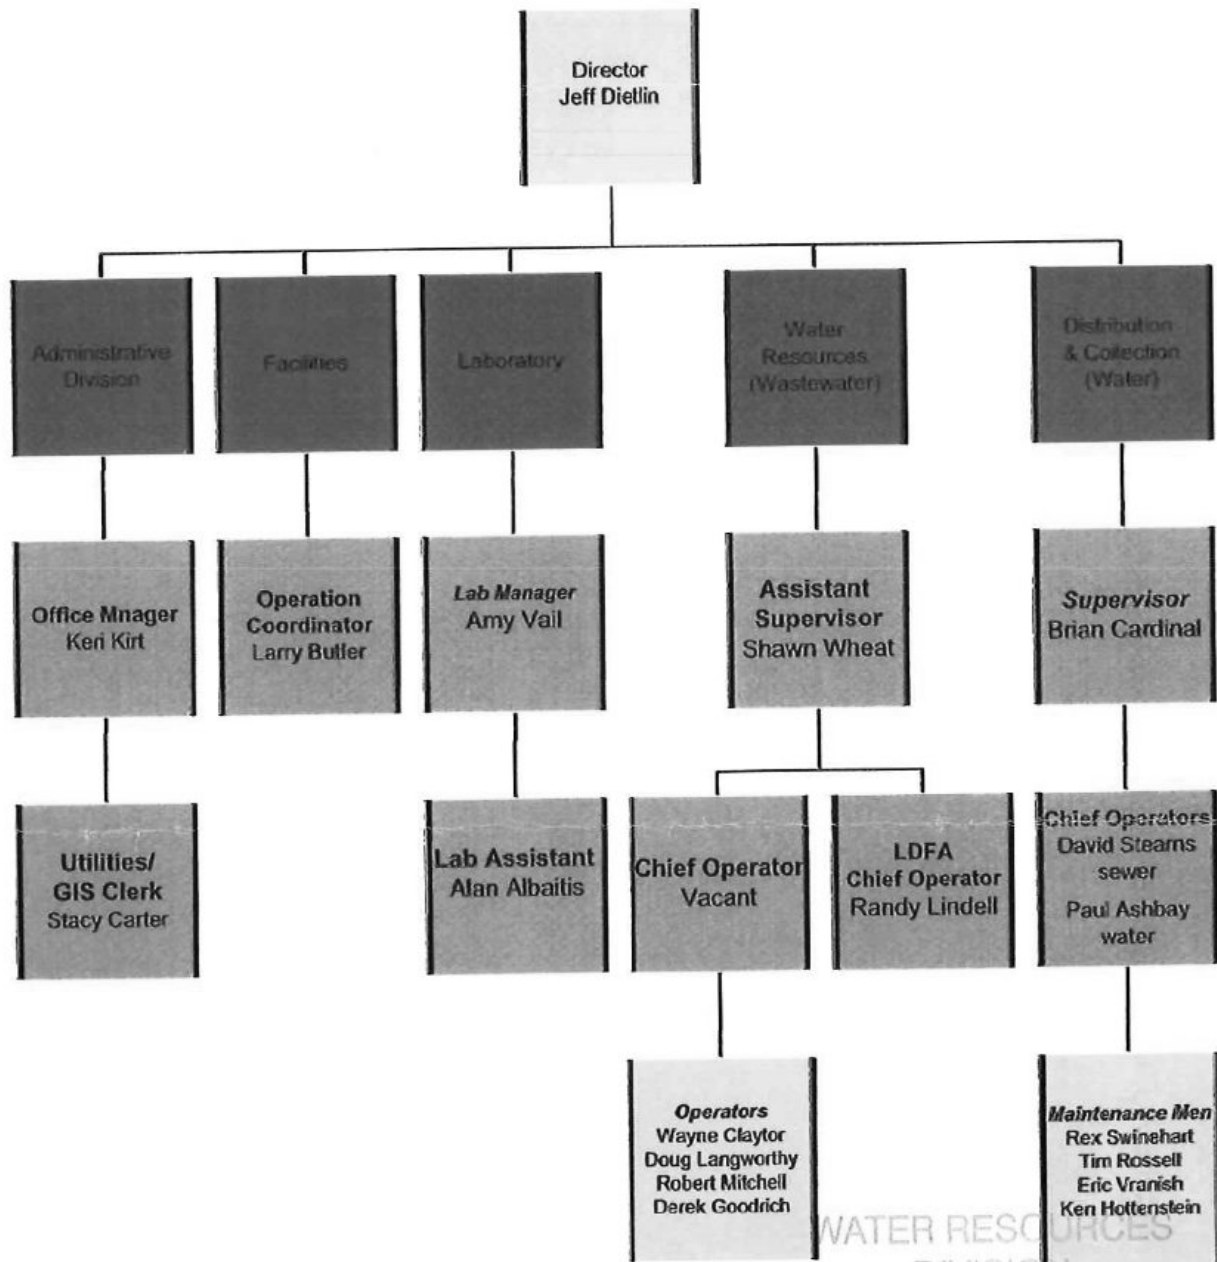

WATER RESOURCES
DIVISION

DEC 2 1 2015

CADILLAC DISTRICT OFFICE