

FACT SHEET

PERMITTEE/FACILITY NAME: City of Cadillac / Cadillac WWTP


COUNTY: Wexford

DESCRIPTION OF EXISTING WASTEWATER TREATMENT FACILITIES:

The Cadillac WWTP was originally constructed in 1963 as a secondary treatment activated sludge facility. Improvements in 1975, 1990, and 1996 added Rotating Biological Discs (RBCs) and fine bubble diffusers to improve biological treatment and ammonia removal; additional secondary clarifiers and sand filters for solids removal; and further improvements in equalization, grit and solids handling, and conversion to sodium hypochlorite disinfection. The facility will soon be converting to ultraviolet light (uv) disinfection. Phosphorus is removed with ferric chloride.

Design flow is 3.2 MGD. Sludge is digested and land applied. Storm water is collected and discharged to the Clam River.

MAP OF DISCHARGE LOCATION:

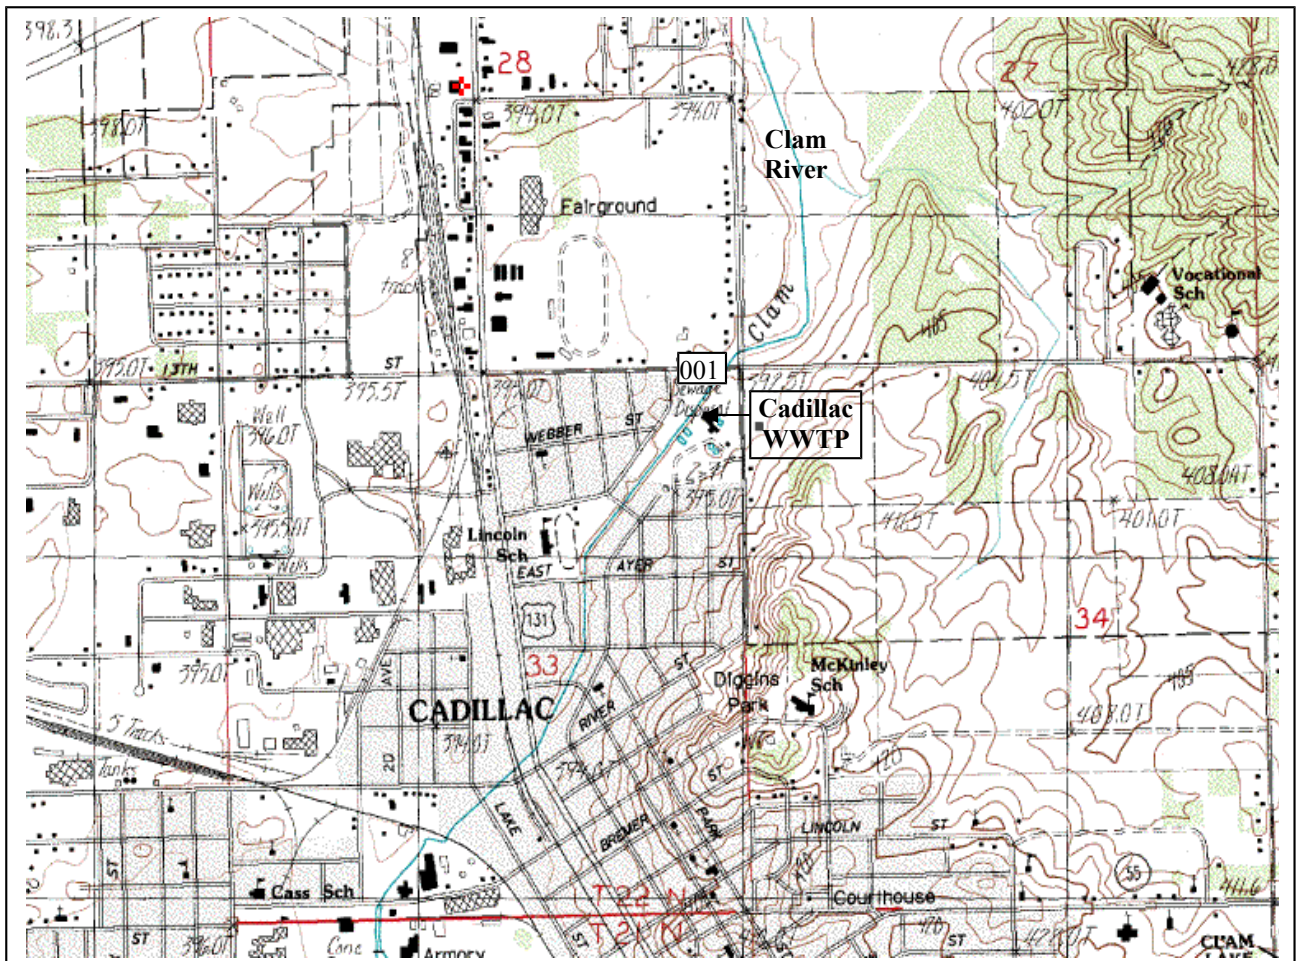

RECEIVING WATER:

The Clam River is protected for agricultural uses, navigation, industrial water supply, public water supply at the point of water intake, warm-water fish, other indigenous aquatic life and wildlife, partial body contact recreation, and total body contact recreation (May through October). Coldwater fishery designation begins 5.6 river miles downstream at County Line Road.

The receiving stream flows used to develop effluent limitations are a 95% exceedance flow of 2.1 cfs, a harmonic mean flow of 13 cfs, and a 90-day, 10-year low flow of 2.9 cfs.

MIXING ZONE:

For toxic pollutants, the volume of the Clam River used in assuring that effluent limitations are sufficiently stringent to meet Water Quality Standards is 25% of the applicable design flows of the receiving stream.

For other pollutants, the volume of the Clam River used in assuring that effluent limitations are sufficiently stringent to meet Water Quality Standards is the applicable design flows of the receiving stream.

EXISTING EFFLUENT QUALITY: (from completed application dated March 26, 2002)

<u>Parameter</u>	<u>Minimum</u> <u>Daily</u>	<u>Maximum</u> <u>Monthly</u>	<u>Maximum</u> <u>Daily</u>
CBOD ₅ , mg/l	---	4.4	10
Total Suspended Solids, mg/l	---	3.6	12
Ammonia as N, mg/l	---	1.8	12
Total Phosphorus, mg/l	---	.26	.52
Fecal Coliform Bacteria, cts/100 ml		337	600
Total Residual Chlorine, mg/l	---	---	0.1
pH	6.4	---	8.1
Dissolved Oxygen, mg/l	7.5	---	---

PROPOSED EFFLUENT LIMITATIONS: (see draft permit)

BASIS FOR PROPOSED EFFLUENT LIMITATIONS:

Based on this facility's application for an NPDES discharge permit, the Michigan Department of Environmental Quality proposes to issue the applicant a permit to discharge, subject to effluent limitations and certain other conditions within the permit. Effluent limitations and/or monitoring requirements for carbonaceous biochemical oxygen demand, ammonia nitrogen, Lindane, , total phosphorus, total residual chlorine, fecal coliform bacteria, pH, cadmium, copper, zinc, and dissolved oxygen are based on meeting water quality standards in the Clam River. Limits for total suspended solids are based on permit writer's judgement. Acute and chronic toxicity limits are

based in water quality concerns. Total mercury limits are based on meeting mercury variance requirements.

REGISTER OF INTERESTED PERSONS

Any person interested in a particular application or group of applications, may leave his/her name, address, and telephone number as part of the file for an application. The list of names will be maintained as a means for persons with an interest in an application to contact others with similar interests.

PUBLIC COMMENT

Comments or objections to the draft permit received between July 30, 2003 and August 29, 2003 will be considered in the final decision to issue the permit.

If submitted comments indicate significant public interest in the application or if useful information may be produced, the Michigan Department of Environmental Quality at its discretion, may hold a public hearing on the application. Any person may request the Michigan Department of Environmental Quality to hold a public hearing on the application. The request should include specific reasons for the request, indicating which portions of the application or draft permit constitutes the need for a hearing.

Public notice of a hearing will be provided at least thirty (30) days in advance. The hearing will normally be held in the vicinity of the discharge. The Michigan Department of Environmental Quality will consider comments made at the hearing when making its final determinations on the permit. Further information regarding the draft permit, and procedures for commenting or requesting a public hearing may be obtained by contacting Diane Carlson, P.E., Surface Water Permits Section, Water Division, Department of Environmental Quality, P.O. Box 30273, Lansing, Michigan, 48909, telephone: 517-335-4118 email: carlson@michigan.gov.