

FACT SHEET

PERMITTEE / SITE NAME: City of Cadillac / Cadillac WWTP

COUNTY: Wexford

DESCRIPTION OF EXISTING WASTEWATER TREATMENT FACILITIES


The Cadillac Wastewater Treatment Plant (WWTP) was originally constructed in 1963 as a secondary treatment activated sludge facility. Improvements in 1975, 1990, and 1996 added Rotating Biological Contactors and fine bubble diffusers to improve biological treatment and ammonia removal; additional secondary clarifiers and sand filters for solids removal; and further improvements in equalization, grit and solids handling, and biosolids storage. In 2003 the sodium hypochlorite disinfection system was replaced with an ultraviolet (UV) light disinfection system. Phosphorus is removed with ferric chloride. The sand filters have been replaced with Aqua Disk cloth media. Sludge generated at the facility is stabilized in an anaerobic digester and stored until land applied. Treated effluent and storm water collected from the facility grounds are discharged to the Clam River.

MAP OF DISCHARGE LOCATION

Facility Coordinates

Latitude 44.2657

Longitude -85.3985

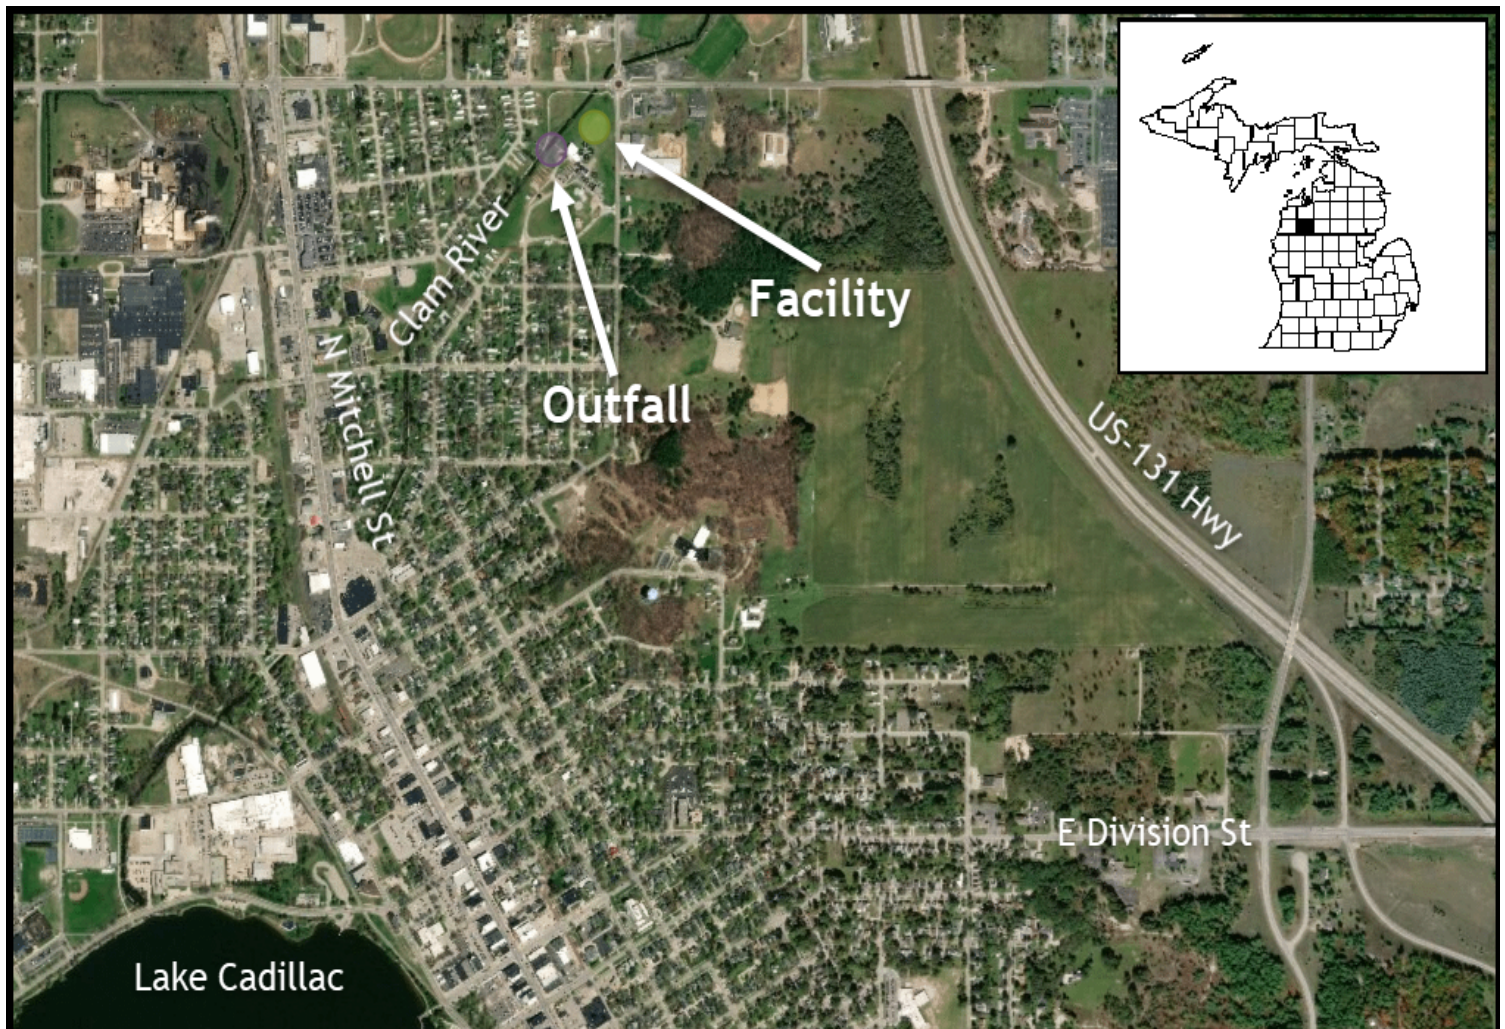

RECEIVING WATER

The Clam River is protected for agricultural uses, navigation, industrial water supply, public water supply in areas with designated public water supply intakes, warm-water fish, other indigenous aquatic life and wildlife, partial body contact recreation, total body contact recreation (May through October), and fish consumption.

The receiving stream flows used to develop effluent limitations are a 95 percent exceedance flow of 2.9 cfs, a harmonic mean flow of 14 cfs, and a 90-day, 10-year low flow of 3.6 cfs.

MIXING ZONE

For toxic pollutants, the volume of the Clam River used to ensure that effluent limitations are sufficiently stringent to meet Water Quality Standards is 25 percent of the applicable design flow of the receiving stream.

For other pollutants, the volume of the Clam River used to ensure that effluent limitations are sufficiently stringent to meet Water Quality Standards is the applicable design flow of the receiving stream.

EXISTING EFFLUENT QUALITY: (from DMR data from June 2013 to June 2018)

Parameter	Minimum Daily	Maximum Monthly	Maximum 7-Day	Maximum Daily	Units
Flow	---	2.59	---	3.61	MGD
Carbonaceous Biochemical Oxygen Demand (CBOD ₅)					
May – November	---	12.4	---	29.1	mg/l
December – March	---	17.1	---	85.4	mg/l
April	---	9.63	---	13.8	mg/l
Total Suspended Solids (TSS)					
May – November	---	28.7	177.65	---	mg/l
December – April	---	11.1	11.7	---	mg/l
Ammonia Nitrogen (as N)					
May – November	---	3	---	24.2	mg/l
December – March	---	7.3	---	7.3	mg/l
April	---	3.5	---	6.3	mg/l
Total Phosphorus (as P)					
May – March	---	0.73	---	0.87	mg/l
April	---	0.2	---	0.31	mg/l
Fecal Coliform Bacteria	---	168.4	654	---	cts/100 ml
Total Copper	---	---	---	86	ug/l
Total Mercury	---	0.275	---	---	ng/l
pH	6.34	---	---	8.1	S.U.
Dissolved Oxygen					
May – November	6.7	---	---	---	mg/l
December – April	6.7	---	---	---	mg/l
	Minimum Monthly				
TSS Minimum % Removal					
December – April	25	---	---	---	%

PROPOSED EFFLUENT LIMITATIONS: (see draft permit)

BASIS FOR PROPOSED EFFLUENT LIMITATIONS: (see Basis for Decision Memo)

ADDITIONAL INFORMATION

This permit requires the permittee to prepare an Asset Management Program, and implement the program upon Department of Environmental Quality approval. Annual reports summarizing program activity are also required to be submitted. The requirements of an Asset Management Program contain goals of effective performance, adequate funding, and adequate operator staffing and training. Asset management is a planning process that ensures gaining optimum value for each asset and providing the financial resources to rehabilitate and replace them when necessary, and typically includes five core elements that identify: the current state of the asset, the desired level of service (e.g., per the permit or for the customer), the most critical asset(s) to sustain performance, the best life-cycle cost, and the long-term funding strategy to sustain service and performance.

REGISTER OF INTERESTED PERSONS

Any person interested in receiving notification by e-mail of National Pollutant Discharge Elimination System (NPDES) permitting actions may register with the Permits Section of the Department of Environmental Quality (Department). To register, e-mail the contact identified below with your full name and the request that you be added to the Department's Public Notice Notification List. Once you are added to the list, you will receive an e-mail notification for every NPDES permitting action in the state unless/until you ask to be removed from the list.

PUBLIC COMMENT

Persons wishing to submit comments or request a public hearing should go to <https://miwaters.deq.state.mi.us>, select 'Public Notice Search,' search for this public notice by entering the permit number or site name into the search field, click 'Search', click 'View,' click 'Add Comment,' enter information into the fields, and then click 'Submit.' Comments or objections to the draft permit received between June 6, 2019, and July 6, 2019, will be considered in the final decision to issue the permit.

Any person may request the Department to hold a public hearing on the application. The request should include specific reasons for the request, indicating which portions of the application or draft permit constitute the need for a hearing. If submitted comments indicate significant public interest in the application or if useful information may be produced, the Department, at its discretion, may hold a public hearing on the application.

If a public hearing is scheduled, public notice of the hearing will be provided at least 30 days in advance. The hearing will normally be held in the vicinity of the discharge. The Department will consider comments made at the hearing when making its final determinations on the permit. Inquiries should be directed to Bradley Popovich, Permits Section, Water Resources Division, Department of Environmental Quality, P.O. Box 30458, Lansing, Michigan 48909-7958; telephone: 517-284-6656; or e-mail: PopovichB@michigan.gov.