

# Simulating improvements on mining compressed air systems

B.M. Friedenstein

28354516

Dissertation submitted in fulfilment of the requirements for the degree  
*Magister* in [Electrical and Electronic Engineering](#) at the Potchefstroom  
Campus of the North-West University

Supervisor: Dr Johann van Rensburg

May, 2017

# Abstract

**Title:** Simulating improvements on mining compressed air systems  
**Author:** B.M. Friedenstein  
**Supervisor:** Dr Johann van Rensburg  
**School:** North-West University Potchefstroom Campus  
**Degree:** Masters in Electrical and Electronic Engineering

As operational costs of deep level mines increases and gold ore grades decrease, profitability in the gold mining sector is becoming a challenge. Electricity tariff increases have contributed to a rise in the cost of operating mines. Compressed air systems are utilised on mines as they provide safe, reliable power for various underground machines. Compressed air is also used for emergency oxygen in refuge bays.

Compressed air systems utilise a significant portion of a mine's total energy. It has been shown that many deep level mine compressed air networks have inefficiencies. Improving the efficiency of these systems could result in a reduction of operational costs by reducing the energy required to produce compressed air. Additionally, an improvement in service delivery could be achieved.

Previous studies have shown the usefulness of simulations to develop improvements for deep level mining systems. However, these studies have not followed a structured methodology for developing compressed air simulation for deep level mines. Previous studies have also simplified compressed air models reducing the simulation precision and testable scenarios.

In this study a simulation methodology was therefore developed. Investigations into the compressed air systems are performed. A model is then developed in software to accurately recreate the system operation. Finally a proposed means of improvement is simulated, analysed and quantified in terms of improvements in energy savings and service delivery.

---

Two case studies were evaluated. For each case study a variety of scenarios were simulated. In case study A by reducing air used by refuge bays in simulation, a reduction of 1 MW E.E. would be achieved with addition to a significant improvement of 18 kPa to system pressure. Drop tests implemented on the case studies validated the simulation with a precision of 5%.

The study showed that simulation is a important tool for identification improvements in large compressed air systems. By utilising a structured methodology to develop detailed compressed air simulations, inefficiencies and operational improvements were identified.

**Keywords:** Mining, Energy, Compressed air, modelling, Simulation, operational improvements

<b>Abstract</b>	<b>i</b>
<b>Abbreviations and nomenclature</b>	<b>v</b>
<b>List of figures</b>	<b>vi</b>
<b>List of tables</b>	<b>vi</b>
<b>1 Introduction and background</b>	<b>1</b>
1.1 Preamble . . . . .	2
1.2 Background on deep level mining . . . . .	2
1.3 Compressed air systems in mining . . . . .	4
1.4 Use of simulation in industry . . . . .	8
1.5 Problem statement and objectives . . . . .	9
1.6 Dissertation overview . . . . .	10
<b>2 Overview of simulation and compressed air applications</b>	<b>11</b>
2.1 Introduction . . . . .	12
2.2 Methods to identify operational improvements . . . . .	12
2.3 Review of compressed air energy interventions in industry . . . . .	13
2.4 Use of simulations to identify improvements in mining systems . . . . .	14
2.5 Conclusion . . . . .	15
<b>3 Developing a simulation methodology</b>	<b>16</b>
3.1 Introduction . . . . .	17
3.2 System investigation method . . . . .	17
3.3 Model development and verification . . . . .	18

3.4	Implementation of simulation method . . . . .	21
3.5	Conclusion . . . . .	22
<b>4</b>	<b>Results and validation</b>	<b>23</b>
4.1	Introduction . . . . .	24
4.2	Case study: Mine A ( <a href="#">Kusasaletu</a> ) . . . . .	24
4.3	Case study: Mine B ( <a href="#">Beatrix 123</a> ) . . . . .	25
4.4	Periodic simulation analysis . . . . .	25
4.5	Potential benefit for SA mines . . . . .	25
4.6	Conclusion . . . . .	25
<b>5</b>	<b>Conclusion</b>	<b>26</b>
5.1	Conclusion . . . . .	27
5.2	Limits of this study . . . . .	27
5.3	Recommendations for future studies . . . . .	27
<b>Appendix A</b>	<b>1</b>	<b>31</b>
<b>Appendix B</b>	<b>2</b>	<b>32</b>

## Abbreviations

**CALDS** Compressed Air Leakage Documentation System.

**DSM** Demand Side Management.

**PLC** Programmable logic controller.

**SCADA** Supervisory control and data acquisition.

**STB** Simulation Toolbox.

**THS** Thermal-hydraulic simulation.

**VFD** Variable Frequency Drive.

**VSD** Variable Speed Drive.

## Nomenclature

**kPa** - Kilopascal.

**MW** - MegaWatt.

**T** - Tonne.

---

## List of Figures

1.1	Electricity price increases between 2007 and 2017 compared to the inflation rate in South Africa.. . . . .	3
1.2	A layout showing the mining processes. . . . .	4
1.3	The energy consumption for each mining system. . . . .	4
1.4	The relation between guide vain position and compressor output power. . . .	6
1.5	A typical operation schedule of a deep level mine. . . . .	7
2.1	The Compressed air energy and flow consumed per T of ore produced. . . . .	14
3.1	Estimating the characteristic curve of a compressor by fitting a quadratic function to points of operation. . . . .	20
3.2	Integrating the compressor component into the simulation. . . . .	20
3.3	Control components in Simulation Toolbox (STB). . . . .	21

---

## List of Tables



# CHAPTER 1

---

## Introduction and background

---

*‘Quote.’* - Somebody

## 1.1 Preamble

This chapter firstly discusses background regarding deep level mining in South Africa. Next, the need to reduce costs of operation in the mining sector is examined. From this a focus in reducing energy consumption of compressed air systems is developed. Next, background on compressed air operation and energy interventions are discussed. Simulations and their value in industry is discussed leading to a problem statement and objectives of the study. Finally, an overview for the dissertation is provided.

## 1.2 Background on deep level mining

### 1.2.1 Mining profitability

Various technical, economic, social and operational challenges are posing a risk to the profitability of the South African mining sector. One of the challenges the sector faces is a rise in the cost of operation [1].

A considerable factor that is contributing to the rise of operational costs in South African gold mines has been the increase in electricity costs. As shown in figure 1.1, the general cost of electricity has increased at a rate greater than inflation since 2008 [2].

In addition to rising electricity costs, gold ore grades of South African mines have fallen substantially over the last few decades [3]. As ore grades decline, the energy utilised per unit of metal increases exponentially [4]. Therefore mines require significantly more energy per unit of metal produced. This combination of tariff increases and increased energy usage per unit have led to significant rises in mining operation costs.

---

<sup>1</sup>inflation.eu, "Historic inflation South Africa - cpi inflation." [Online] <http://www.inflation.eu/inflation-rates/south-africa/historic-inflation/cpi-inflation-south-africa.aspx>, [Accessed 25 March 2017].

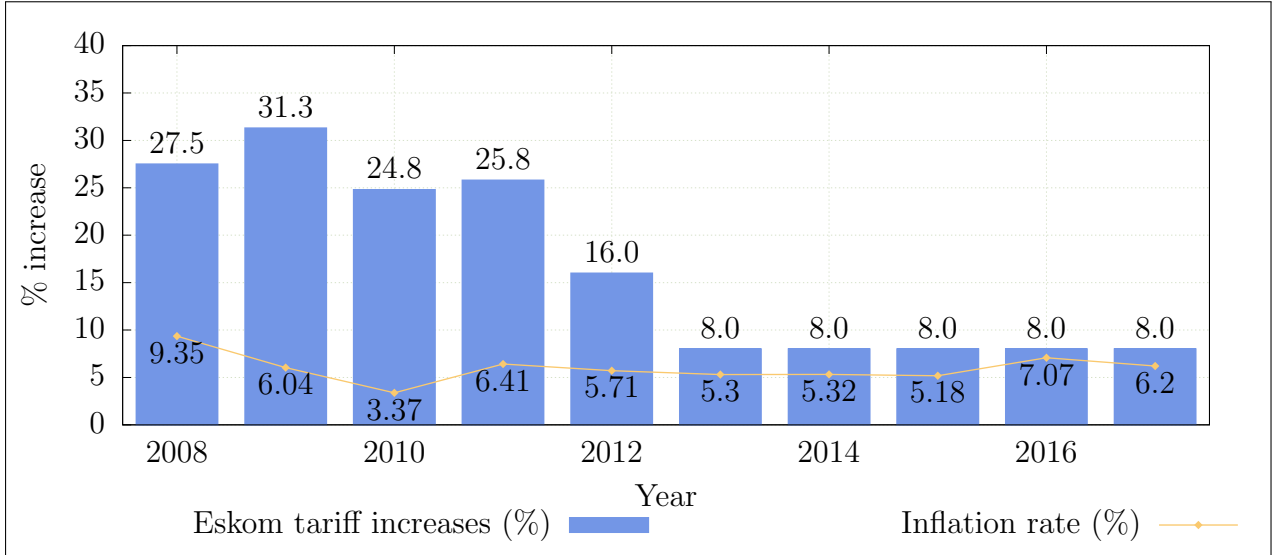


Figure 1.1: Electricity price increases between 2007 and 2017 [2] compared to the inflation rate in South Africa.<sup>1</sup>

### 1.2.2 Process of a deep level mine

South Africa's mines are some of the deepest in the world. Some mine shafts are reaching depths deeper than 4000m below the surface [5]. The process of extracting ore at these depths is dependent on the essential services, mainly cooling and ventilation, pumping, compressed air and hoisting, as shown in figure 1.2.

Cooling and ventilation systems are required to maintain safe working temperatures underground. Pumping is critical to remove surface and fissure water, preventing flooding. Compressed air is needed to safely power underground drills and machines. Finally, hoisting systems are used to bring the ore to the surface and to transport mine workers in the mine.

### 1.2.3 Mining Services

#### Energy usage

The mining industry uses extensive amounts of energy. In South Africa, the industry utilizes approximately 15% of the national electricity supplier's yearly output, of which, gold and platinum mines use 80%. [6]

Figure 1.3 shows the division of energy within the mining industry. The chart shows that compressed air systems utilise the most energy within a mining industry. It is reasoned that

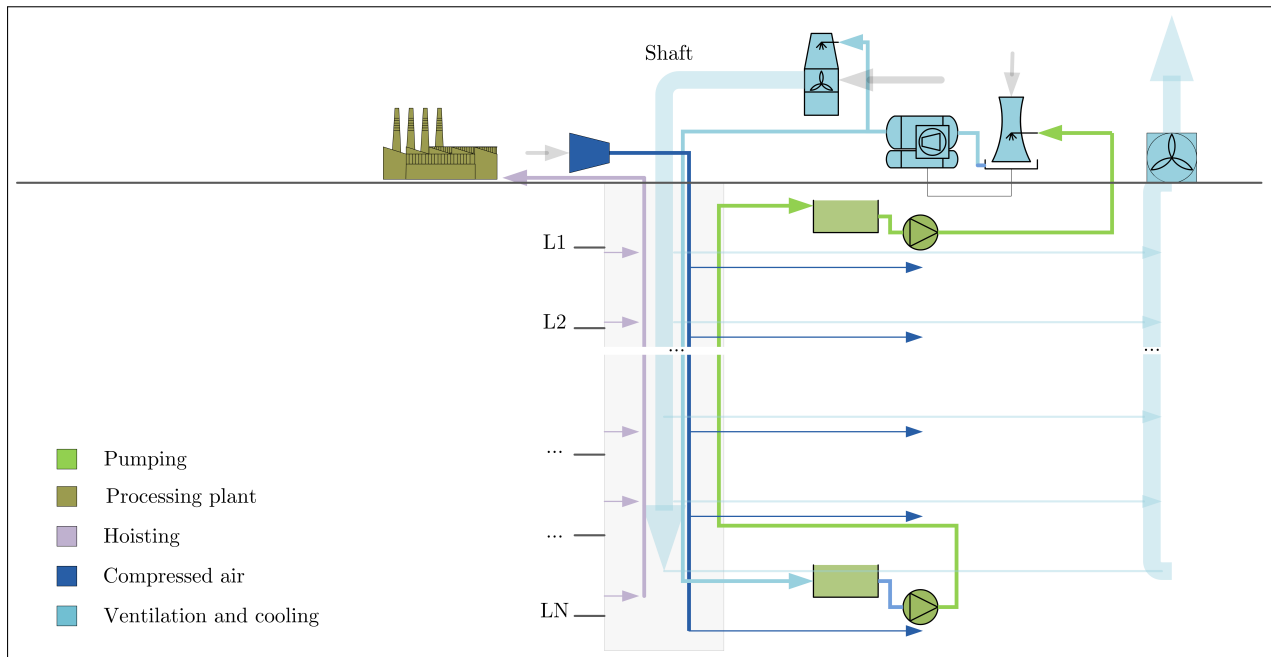


Figure 1.2: A layout showing the mining processes.

energy can be most effectively reduced through the implementation of energy interventions on compressed air systems.

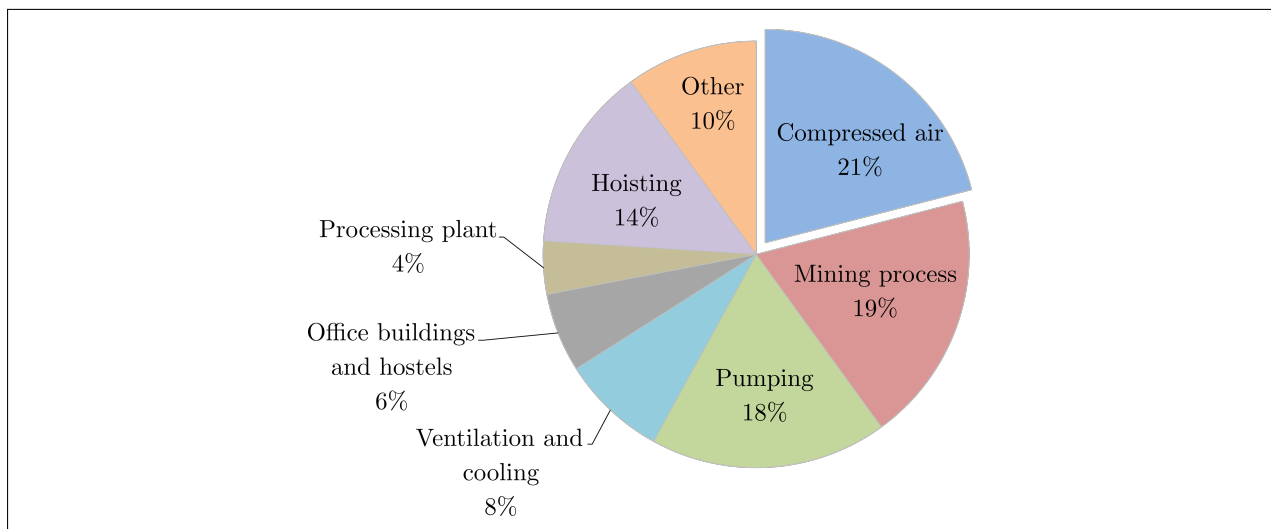


Figure 1.3: The energy consumption for each mining system [7].

## 1.3 Compressed air systems in mining

### 1.3.1 Compressed air in operation

Largely due to their reliability, versatility and ease of use, the South African mining industry has installed extensive compressed air networks. These systems can have compressors with capacities of up to 15 MW [8]. However, the supply of compressed air is a highly energy

demanding and costly process [9]. The energy used for compressed air production contributes to between 9% and 20% of the total mining energy consumption [6],[10].

Large compressed air systems are likely inefficient. Internationally, the expected energy savings potential of a large compressed air network is 15% [11]. Marais [12] showed that energy savings of up to 30% and 40% can be attained through various interventions.

### **Pneumatic rock drills**

Drilling is mainly performed in the production areas or stopes of a mine. Drill machines are used to drill holes into the rock face. Once the holes have been drilled, explosives are then installed to break up the rock [13].

Compressed air is used to power pneumatic rock drills within a mine. Pneumatic rock drills run at an efficiency of 2%. This is low when compared to alternative rock drills such as electric, oil electro-hydraulic and hydro-powered drills that run at an efficiency of between 20-31% [14],[15].

### **Refuge bays**

Refuge bays are installed in mines to provide safety to miners during emergencies. Most mines will utilise compressed air to deliver safe, cool air to the refuge bay. The provision of 1.42 l/s of air per person at a pressure between 200 and 300 kPa is required to provide oxygen and prevent any poisonousness gas entering the refuge [16].

Airflow in the refuge bays can be controlled with a manual valve within the chamber. Any many cases, this valve is often misused by mine workers who open the valves fully in order to cool the bay through the decompression of the air. \*\*\* need source \*\*\*

### **Compressed air control**

On many large compressed air networks, the intake guide vain position on a compressor is manipulated in order to obtain the air flow and pressure requirements. Typically, guide vains are opened and closed to increase and decrease the compressors discharge pressure. When more pressure is required than can be obtained with the guide vains fully opened, another compressor is needed to operate.

As shown in the figure 1.4, showing guide vane positions vs power for a typical mining compressor, the guide vains are controlled between 40% and 100% of their fully open position. Reducing and increasing the guide vane position will effect the power output of the compressor. The relationship between power and guide vane position of a compressor can be approximated as a linear function. A guide vane position of 40% will relate to an output power of about 60% of maximum power.

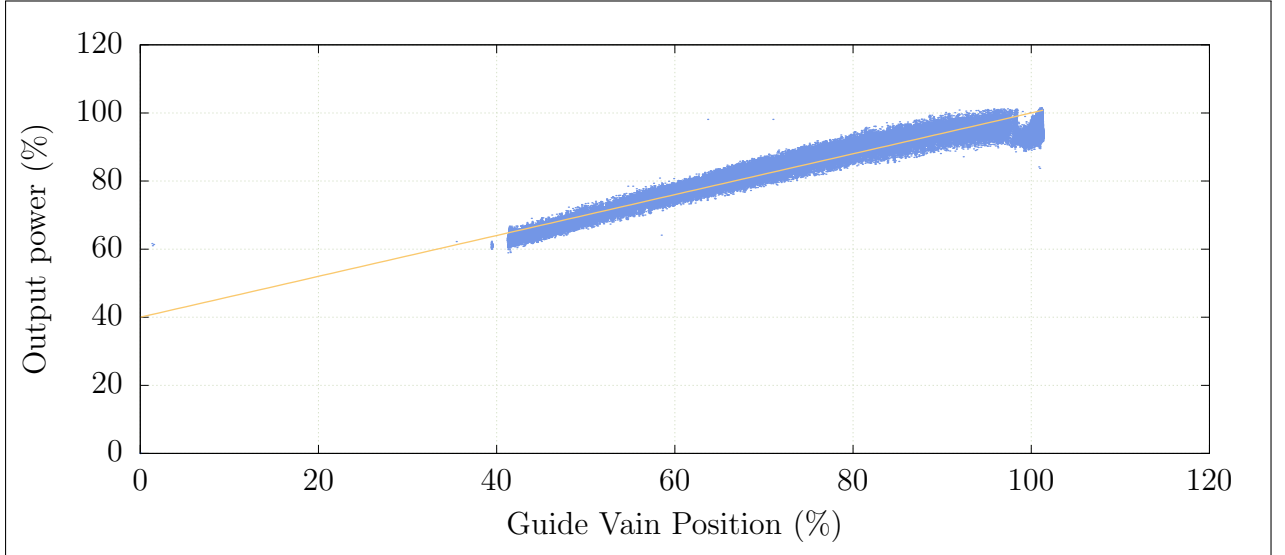


Figure 1.4: The relation between guide vain position and compressor output power.

### Operation schedule

On a typical mine, various operations will take place at different times of the day. Depending on the activity taking place, many mines will control the pressure to meet the requirements [17],[8]. Figure 1.5 shows the schedule and pressure requirement on a typical deep level mine.

As shown in the figure, the pressure requirement changes depending on the activity taking place. The drilling shift typically has the highest pressure requirement whilst blasting shift requires the lowest. Schedules and operation philosophies can differ between mines. Different operational schedules require alternative pressure requirement profiles.

### 1.3.2 Characteristic inefficiencies of compressed air systems

Compressed air distribution networks in the mining industry consist of multiple compressors and working areas up to eight kilometres away from the source [8]. Due to their size and complexity, these systems are prone to large energy losses.

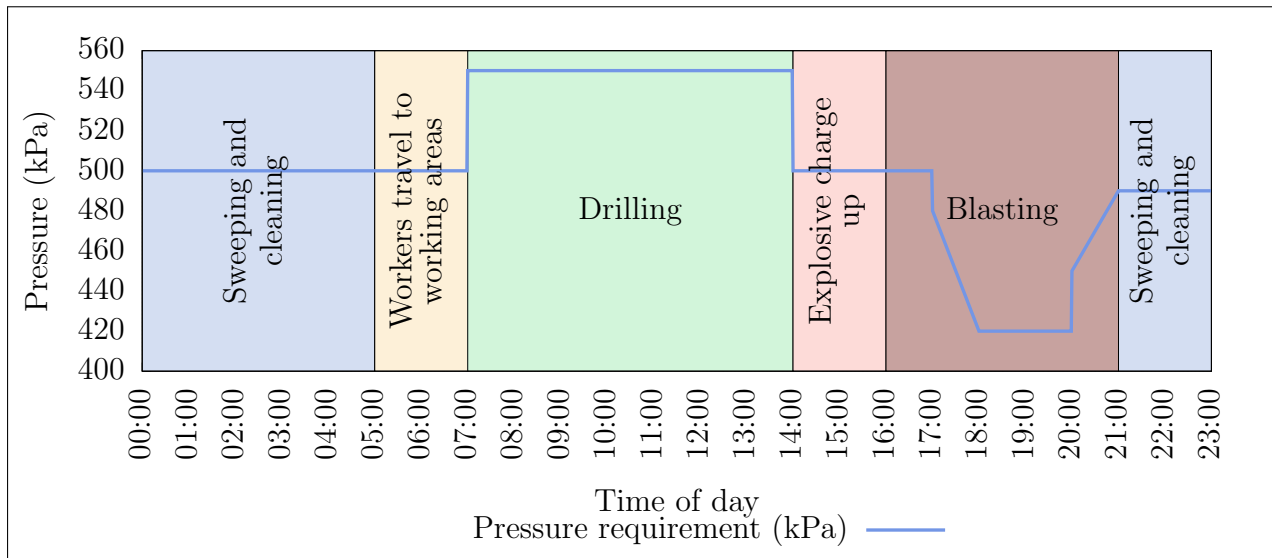


Figure 1.5: The typical operation schedule of a deep level mine [17].

Compressed air leakage accounts for as much as 35% of the energy losses of a compressed air network [18]. Other systemic losses include, faulty valves, pipe diameter fluctuations, obstructed air compressor intake filters and inefficient compressors.

### 1.3.3 Instrumentation and measurements

For large industrial systems, thorough instrumentation is necessary in order to monitor performance and condition throughout the system. In a mining compressed air network, instrumentation is installed on the compressor to monitor flows, pressures, temperatures and guide vain position. Electrical instrumentation is also installed for sensing currents, power factors, voltages and power. On control valves, input/output pressures, flows and valve position are usually measured with instrumentation.

Programmable logic controllers (PLCs). A Supervisory control and data acquisition (SCADA) system is is used to observe and monitor all of the instrumentation.

When instrumentation is not installed. Manual measurements are performed.

Not finished

### 1.3.4 Inefficiency identification methods

Leakage and inefficiency detection strategies is not often pursued in the South African mining industry [15]. Many mines do however perform leak inspections either internally or by a

outside company. In these inspections, an ultrasonic detector is used to locate the leak. Alternatively, some mines employ the “walk and listen” method to identify leaks from the audible sound that it produces [15]. Once the inspection is completed, the findings, including the locations and estimated costs of all identified leaks, are reported. Need to added a citation or two

### 1.3.5 Compressed air savings strategies

The main strategies fo reducing energy on compressed air systems are summarised as follows [19]:

- Reducing leaks.
- Reducing demand.
- Reducing unauthorised usage.
- Increasing supply efficiency.
- Optimising supply.

Still need to discuss more detailed

## 1.4 Use of simulation in industry

### 1.4.1 Background in industrial simulation

Continuous improvements in computing hardware has led to major advancement in software technology. Consequently the use of computational simulation has become an increasingly valuable tool for many industries.[20]

In *Handbook of simulation: principles, methodology, advances, applications, and practice*, the advantages of the use of simulation in industry are discussed as follows [21]:

- The ability to test new policies, operating procedures and methods without causing a disruption to the actual system.
- The means to identify problems in complex systems by gathering insight in the interactions within the system.
- The facility to compress or expand time to investigate phenomena thoroughly.
- The capability to determine the limits and constraints within a system.



- The potential to build consensus with regard to proposed designs or modifications.

### **1.4.2 Thermal-hydraulic simulation**

Thermal-hydraulic simulation (THS) is the modelling and computational analysis of Thermal-hydraulic systems. THS models can be developed large mining systems such as cooling, compressed air water reticulation etc. In industry, various THS software packages are used for modelling and simulating these systems. Two such packages discussed in this dissertation are KY-pipe and Simulation Toolbox.

### **1.4.3 Use of simulation in mining**

In industry, simulations have mainly been used as an initial verification of Demand Side Management (DSM) energy intervention proposals [17]. This removes potential risks that would arise from testing the interventions on the actual mining systems. However these simulations are typically highly simplified models [12].

## **1.5 Problem statement and objectives**

### **1.5.1 Problem statement**

Rising costs and falling ore grades are driving in the mining industry to reduce operational inefficiencies. Large energy savings can be made in Compressed air systems in the mining industry. However manual testing of interventions can be cumbersome.

Computer modelling and simulation of compressed air systems can be used to quantify and prioritise operational interventions that improve efficiency. The simulations would allow scenarios to be evaluated with minimal risk.

### **1.5.2 Research objectives**

The main objective of this dissertation is achieve energy savings and identify operational improvements in mining compressed air systems. A simulation process to will be developed to achieve this goal.

## 1.6 Dissertation overview

Describe (in approximately one sentence each) the contents of each of the dissertation chapters. No results here.

## CHAPTER 2

---

# Overview of simulation and compressed air applications

## **2.1 Introduction**

## **2.2 Methods to identify operational improvements**

### **2.2.1 Preamble**

### **2.2.2 Identifying areas for improvement**

(Kriel Masters) -Investigation

-Measurements

-Simulated impact of the proposed intervention

### **2.2.3 Measurements**

### **2.2.4 Leakage detection**

(Van Tonder masters) - Inspections

- Audible sounds (by ear)

- Ultrasonic

- Intelligent leakage detection (instrumentation SCADA)

- Alternatives (pigging, soap water, Dyes load/unload test)

- CALDS ( Compressed air leakage document system)

### **2.2.5 Estimation techniques**

- Snyman estimated improvements using historical data.[19]

- Marais estimation through simplified estimation, simulation [8, 12].

### 2.2.6 Summary

## 2.3 Review of compressed air energy interventions in industry

### 2.3.1 Preamble

(Kriel Masters) - Supply and demand strategies (improving compressor efficiency vs reducing/improving demand)

Marais et al investigated increased energy savings through the use of Compressed Air Leakage Documentation System (CALDS) [22].

### 2.3.2 Strategies to improve compressed air supply

- Control Strategies
- Relocating compressor. reconfiguring networks - Bredenkamp
- Compressor schedules
- Variable speed drives
- Compressor selection
- Marais showed compressed air saving potential through an expert control system.[23]

### 2.3.3 Strategies to reduce/optimize compressed air consumption

- Reducing leaks
- Control Valves - Pascoe
- Marais PhD
- Snyman - investigated various Compressed air demand reduction and efficiency optimisations [19].

#### **Pneumatic rock drills efficiency**

Reduced pressure to the drill will cause it to run even less efficiently. A study by Bester *et*

*al.* showed that between 2002 and 2013 compressed air and energy consumption per tonne of ore produced had steadily increased as shown in figure 2.1. The increase in consumption per T was a result of a reduction in air pressure at the mining stopes. Measurements indicated that the pressure was as low as 300 kPa. This reduced the efficiency of the rock drills. Before 2002 pressure was maintained above 500 kPa at the stopes. .[24]

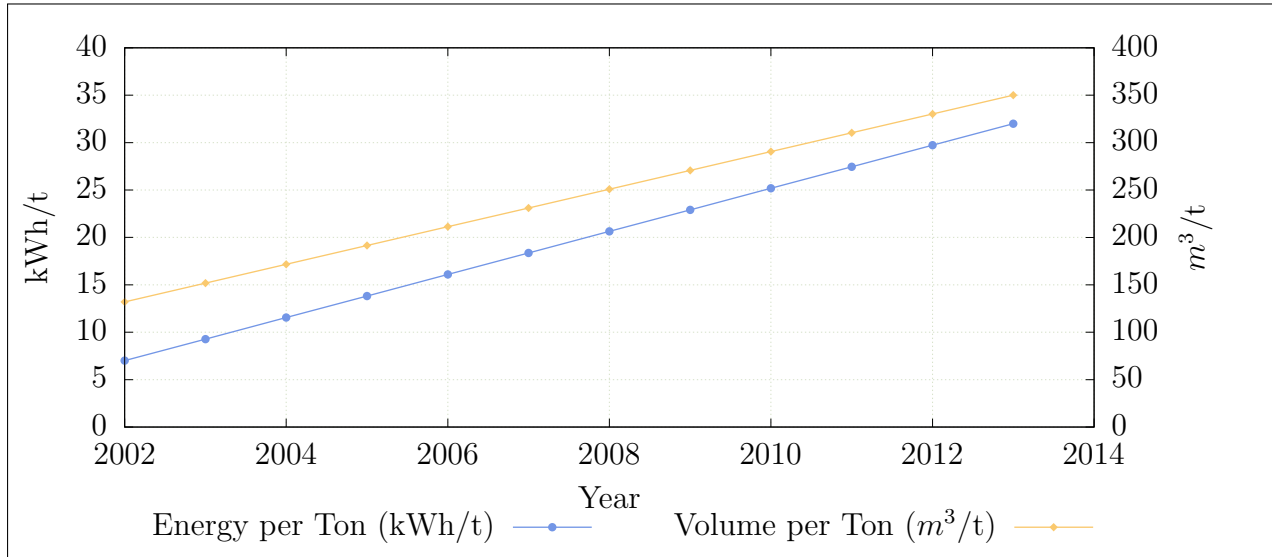


Figure 2.1: The Compressed air energy and flow consumed per T of ore produced. Adopted from Bester *et al.* [24].

### 2.3.4 Summary

## 2.4 Use of simulations to identify improvements in mining systems

### 2.4.1 Preamble

### 2.4.2 Value of simulation in DSM projects

(Van Niekerk M)

- Compressed air
- Cooling systems
- Dewatering
- Design optimisations using simulation
- KYPipe's gas simulation engine

- De Coning - simulations to investigate the opportunity to optimise the control strategy of a compressed air network by rescheduling the compressors.

### **2.4.3 Simulation procedures**

-Kriel masters

-Pascoe

**Periodic simulation**

### **2.4.4 Verifying simulations**

- Holman - van Niekerk masters

- Kriel masters ( validation)

- Calibrating -pascoe - determining accuracy - pascoe - Du2015Development - comparisons with models - comparison with actual - First principles

### **2.4.5 Shortcoming of previous studies**

### **2.4.6 Summary**

## **2.5 Conclusion**

# CHAPTER 3

---

## Developing a simulation methodology

---

‘*Quote.*’ - Somebody



## 3.1 Introduction

## 3.2 System investigation method

### 3.2.1 Preamble

Developing a detailed simulation model of a compressed air network requires thorough comprehension of the inner workings of the system. This section will discuss the investigations needed to obtain the required understanding.

### 3.2.2 Data acquisition and verification

- Layouts, data from SCADA Instrumentation, etc.
- Verification of accurate data - Gous article

### 3.2.3 Solutions to unavailable data

Parameters that are required to develop the simulation model, such as flows, pressures, may not be actively logged by mine systems. To obtain this data it is necessary to investigate alternative sources. At points where instrumentation is absent, estimations can be made from assumptions made using instrumentation on the network or spot inspections.

Air network specifications such as piping sizes, technical layouts, major leak locations or specifications is often outdated or not recorded. Critical data should be obtained through audits and inspections of the system. If manual inspection is not possible, estimations should be made using the available data or approximation techniques discussed in literature.

REMEMBER TO REFERENCE

SPECIFIC LOCATION LITERATURE.

### 3.2.4 Mining schedule

A crucial aspect to developing an accurate model of a mining compressed air system is understanding the the operational philosophy of the mine. The schedule for operations such as drilling, blasting or cleaning can have a major impact on compressed air requirements at

different times of the day. By utilizing the operational schedule, simulation scenarios can be optimized for the air requirements throughout the day.

### 3.2.5 Summary

## 3.3 Model development and verification

### 3.3.1 Preamble

Compressed air networks are comprised of components such as compressors, valves, pipes, etc. This section the development of component models that make up a compressed air simulation is discusses. Verification methods is then discussed.

### 3.3.2 Compressed air component models

#### Air pipes and valves

Pressure losses that occur due to pipe friction losses should be included for large piping sections in the simulation . A pipe component is used to account for these losses which are defined by the *Darcy-Weisbach equation*<sup>1</sup>:

$$\Delta P = \frac{fL\rho V^2}{2D}$$

Where the pressure difference  $\Delta P$  is a function of:

$f$	Friction coefficient
$L$	Pipe length ( $m$ )
$D$	Pipe diameter ( $m$ )
$\rho$	Air density ( $kg/m^3$ )
$V$	Average velocity ( $m/s$ )

The component model can be used as a valve by controlling the open fraction between 0 and 1. Modeling the valve flow characteristics is discussed in 3.3.2 *Controllers*.

---

<sup>1</sup> B. Glenn, 'The Darcy-Weisbach Equation,'[Online] <https://bae.okstate.edu/faculty-sites/Darcy/DarcyWeisbach/Darcy-WeisbachEq.htm>, [Accessed 20-05-2017]

### **Ambient conditions**

Ambient air condition underground and on surface can effect the performance of the network [Citation needed]. Pressure and temperature increases with depth as a result of auto compression and rock face temperature [Citation needed]. Therefore it is important to take into account conditions for the boundary conditions at each mining level or area where compressed air is used.

### **Compressors**

Three compressor models were investigated, each with varying complexity. The models are: air compressor, dynamic compressor and positive displacement compressor.

The air compressor model is a general, simplified compressor model. This model requires minimal user inputs by making several assumptions. This is useful when parameters for a compressor are not available. Or when doing a quick preliminary simulation. However it is not ideal for detailed simulations which require more precision.

The dynamic and positive displacement compressor models are more complex, taking into account factors such as heat caused by polytropic compression and inefficiencies. The models do still make several assumptions for example, the compressor efficiency at different loads is assumed to remain the same. This can cause the operation of the model can differ slightly from the real life compressor.

For most scenarios, the dynamic compressor component is most suitable. This component is modeled by fitting a quadratic curve through three points of operation to obtain an equation for corrected mass flow as a function of the pressure ratio. This characteristic curve of compressor as shown in figure 3.1 can be accurately estimated even when only one data point is available by making approximations for the zero flow and pressure points on the curve.

Once accurately modeled, the compressor component is added to the air network in the arrangement shown in figure 3.2. The Compressor is connected to the inlet air source via an inlet pipe and air node and to the rest of the network via an air node and outlet pipe.

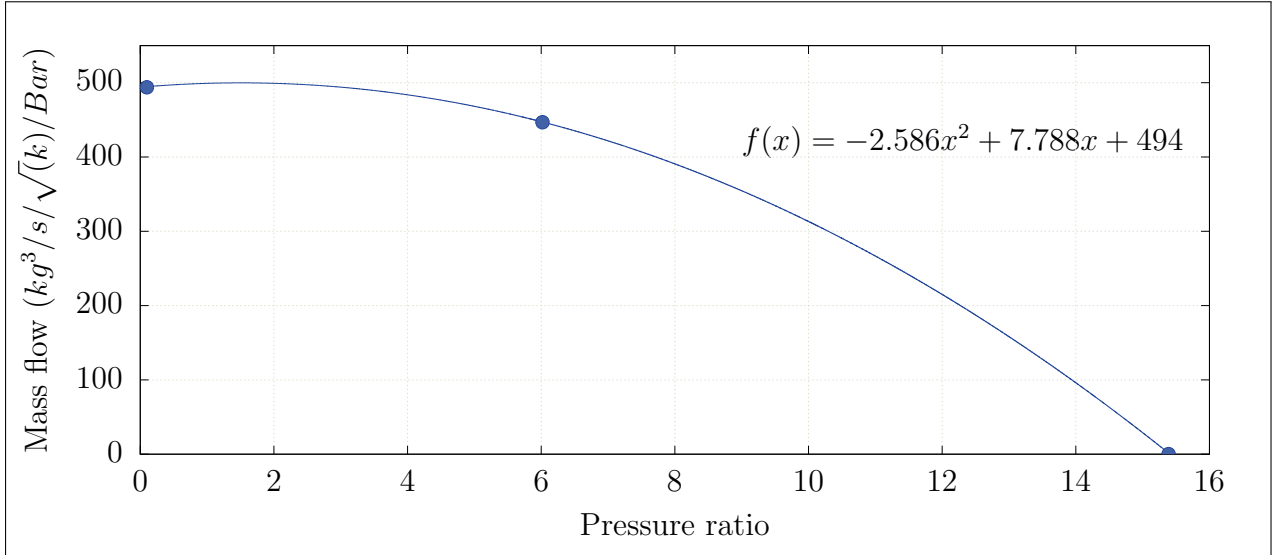


Figure 3.1: Estimating the characteristic curve of a compressor by fitting a quadratic function to points of operation.

This is to allow the inlet and outlet parameters and conditions to be monitored and controlled.

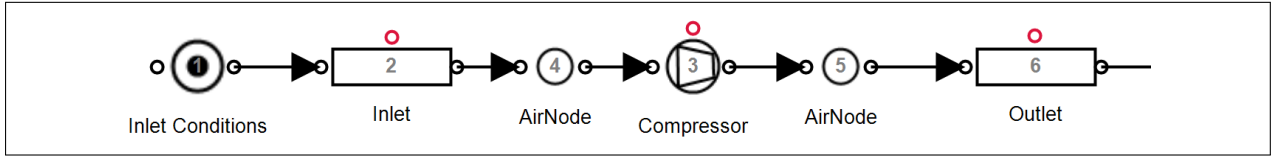


Figure 3.2: Integrating the compressor component into the simulation.

## Demand/leak

A flow demand

## Controllers

Simulated components need to be dynamically controlled as in the actual air network. Typically compressors and valves are controlled to certain set-points and schedules. It is important to model the nonlinearities of these controllers to ensure the simulation reacts in the same way the actual network would.

On a typical mine, compressors power is controlled such that the discharge pressure matches a specified set-point. Power control is achieved through either Variable Speed Drives (VSDs) /Variable Frequency Drives (VFDs) or guide-vain control. VFDs provide a wide range of power control and can be estimated using a Proportional-Integral (PI) controller as in figure 3.3 where discharge pressure is used as feedback for the controller. A guide vain controller

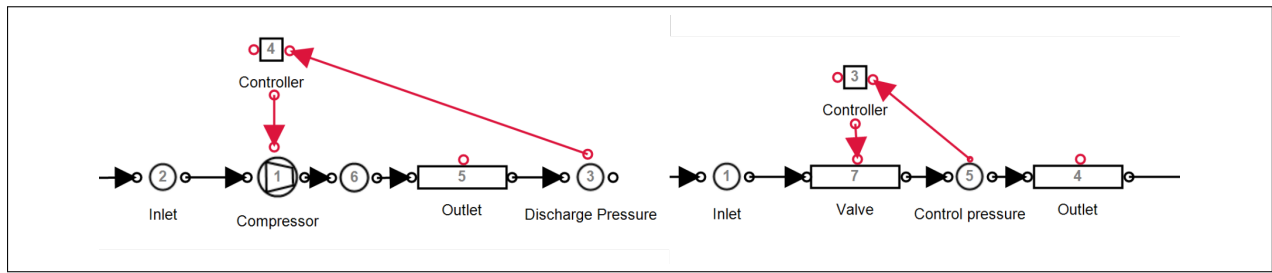


Figure 3.3: Control components in STB.

is developed a PI controller as with the VSD. However the control limitations of guide vane control, as shown in figure 1.4, must be added to the model. Figure 1.4 also shows that the typical minimum guide vane control position of 40% will map to a output power of approx. 60% of the maximum output power of the compressor.

### After Cooling

#### 3.3.3 Simulation inputs

-Discuss inputs of the simulation, (compressor setpoints, ambient conditions, demands)

#### 3.3.4 Verification of simulation model

- Steps to validate the model accuracy .
- Compare parameters to actuals

#### 3.3.5 Summary

### 3.4 Implementation of simulation method

#### 3.4.1 Preamble

Once a model has been developed and verified, the implementation of simulated interventions and scenarios follows. In this section, the approach of implementation, and analysis of interventions in simulation will be discussed.

#### 3.4.2 Analyses of data

- Baseline vs Optimised comparison

### **3.4.3 Quantifying operational improvements**

- Estimating cost savings

### **3.4.4 Summary**

## **3.5 Conclusion**

# CHAPTER 4

---

## Results and validation

---

‘*Quote.*’ - Somebody

## 4.1 Introduction

## 4.2 Case study: Mine A ([Kusasaletu](#))

### 4.2.1 Preamble

### 4.2.2 Scenario 1. Refuge bay simulation

Tested scenario where all excessive leaking valves are removed. refuge bays savings 1MW E.E.



### 4.2.3 Verification of baseline simulation

Validation of results

### 4.2.4 Scenario 2. Closing off levels/stopes

### 4.2.5 Summary

## 4.3 Case study: Mine B ([Beatrix 123](#))

### 4.3.1 Preamble

### 4.3.2 Scenario 1. Compressor set points

### 4.3.3 Scenario 2. Control valves set points

### 4.3.4 Summary

## 4.4 Periodic simulation analysis

### 4.4.1 Preamble

### 4.4.2 Summary

## 4.5 Potential benefit for SA mines

## 4.6 Conclusion

## CHAPTER 5

---

Conclusion

---

‘*Quote.*’ - Somebody

## 5.1 Conclusion

## 5.2 Limits of this study

## 5.3 Recommendations for future studies

---

## Bibliography

- [1] P. Neingo and T. Tholana, “Trends in productivity in the south african gold mining industry,” *Journal of the Southern African Institute of Mining and Metallurgy*, vol. 116, no. 3, pp. 283–290, 2016.
- [2] Eskom, “Revenue application - multi year price determination 2013/14 to 2017/18 (mypd3),” [Online] <http://www.eskom.co.za/CustomerCare/MYPD3/Documents/NersaReasonsforDecision.pdf>, 2013, [Accessed 22 March 2017].
- [3] G. M. Mudd, “Global trends in gold mining: Towards quantifying environmental and resource sustainability,” *Resources Policy*, vol. 32, no. 1, pp. 42–56, 2007.
- [4] J. Müller and H. Frimmel, “Numerical analysis of historic gold production cycles and implications for future sub-cycles,” *The Open Geology Journal*, vol. 4, no. 1, pp. 29–34, 2010.
- [5] J. Vosloo, L. Liebenberg, and D. Velleman, “Case study: Energy savings for a deep-mine water reticulation system,” *Applied Energy*, vol. 92, pp. 328–335, 2012.
- [6] Eskom Demand Side Management Department, “The energy efficiency series - towards an energy efficient mining sector,” [Online] [http://www.eskom.co.za/sites/idm/Documents/121040ESKD\\_Mining\\_Brochure\\_paths.pdf](http://www.eskom.co.za/sites/idm/Documents/121040ESKD_Mining_Brochure_paths.pdf), February 2010, [Accessed 19 March 2017].
- [7] H. Le Roux, “Energy consumption reduction challenge,” *Mining Weekly, PO Box*, vol. 75316, p. 30, 2005.
- [8] J. Marais, “An integrated approach to optimise energy consumption of mine compressed air systems,” Ph.D. thesis, North-West University, 2012.
- [9] L. Padachi *et al.*, “Energy efficiency through the integration of compressed air supply control with air network demand control,” in *Proceedings of the Sixth Conference on the Industrial and Commercial Use of Energy*. Citeseer, 2009, pp. 77–80.

- 
- [10] J. Du Plessis and R. Pelzer, “Development of an intelligent control system for mine compressor systems,” in *Industrial and Commercial Use of Energy (ICUE), 2011 Proceedings of the 8th Conference on the*. IEEE, 2011, pp. 59–63.
- [11] J. Neale and P. Kamp, “Compressed air system best practice programmes: What needs to change to secure long-term energy savings for new zealand?” *Energy Policy*, vol. 37, no. 9, pp. 3400–3408, 2009.
- [12] Marais *et al.*, “Simplification of mine compressed air systems,” in *Industrial and Commercial Use of Energy Conference (ICUE), 2013 Proceedings of the 10th*. IEEE, 2013, pp. 1–8.
- [13] A. van Jaarsveld, S. Ebben, and A. Ashanti, “Development and implementation of an electrically powered stope rockdrill for tau tona mine,” in *SAIMM Narrow Vein and Reef Conference, Sun City, South Africa*, 2008.
- [14] P. Fraser, “Saving energy by replacing compressed air with localized hydropower systems: a ‘half level’ model approach,” *Platinum in Transformation*, 2008.
- [15] A. van Tonder, “Sustaining compressed air dsm project savings using an air leakage management system,” Masters dissertation, North-West University, 2011.
- [16] D. Brake and G. Bates, “Criteria for the design of emergency refuge stations for an underground metal mine,” in *AusIMM Proceedings*, vol. 304, no. 2. The Australian Institute of Mining and Metallurgy, 1999, pp. 1–8.
- [17] C. Kriel, “Modernising underground compressed air dsm projects to reduce operating costs,” Masters dissertation, North-West University, 2014.
- [18] L. B. N. Laboratory, *Improving Compressed Air System Performance: A Sourcebook for Industry*, 2nd ed. Washington DC: US Department of Energy, 2004.
- [19] J. Snyman, “Integrating various energy saving initiatives on compressed air systems of typical south african gold mines,” Masters dissertation, North-West University, 2010.
- [20] Kocsis *et al.*, “The integration of mine simulation and ventilation simulation to develop a ‘life cycle’ mine ventilation system,” *Application of Computers and Operations Research*

- in the Minerals Industries, South African Institute of Mining and Metallurgy*, pp. 223–230, 2003.
- [21] J. Banks, *Handbook of simulation: principles, methodology, advances, applications, and practice*. John Wiley & Sons, 1998.
- [22] J. Marais, M. Kleingeld, and R. Pelzer, “Increased energy savings through a compressed air leakage documentation system,” *ICUE, SA*, vol. 11, 2009.
- [23] J. Marais and M. Kleingeld, “An expert control system to achieve energy savings on mine compressed air systems,” *Industrial and commercial use of energy (ICUE)*, 2010.
- [24] Bester *et al.*, “The effect of compressed air pressure on mining production and energy demand,” in *Industrial and Commercial Use of Energy Conference (ICUE), 2013 Proceedings of the 10th*. IEEE, 2013, pp. 1–4.

# APPENDIX A

---

1

# APPENDIX B

---

**2**