

COMMERCIAL KITCHEN EXHAUST

Molitron Odor Abatement System

Odor treatment inside the exhaust path.

The Molitron Odor Abatement System (MOAS) delivers Odor Neutralizer Solution to two remote atomizing nozzles. Compressed air and solution travel through separate tubing, creating a fine mist inside the grease duct.

One complete system


The stainless-steel cabinet, external solution container and two atomizing nozzles form the complete MOAS setup. The external container is standard equipment.

Up to 10 gallons

Odor Neutralizer Solution in the standard external container.


Equipment within reach. Treatment in the duct.

The cabinet can be located in a separate room, with air and solution tubing connecting it to the nozzle pair. See the installation example on the next page.

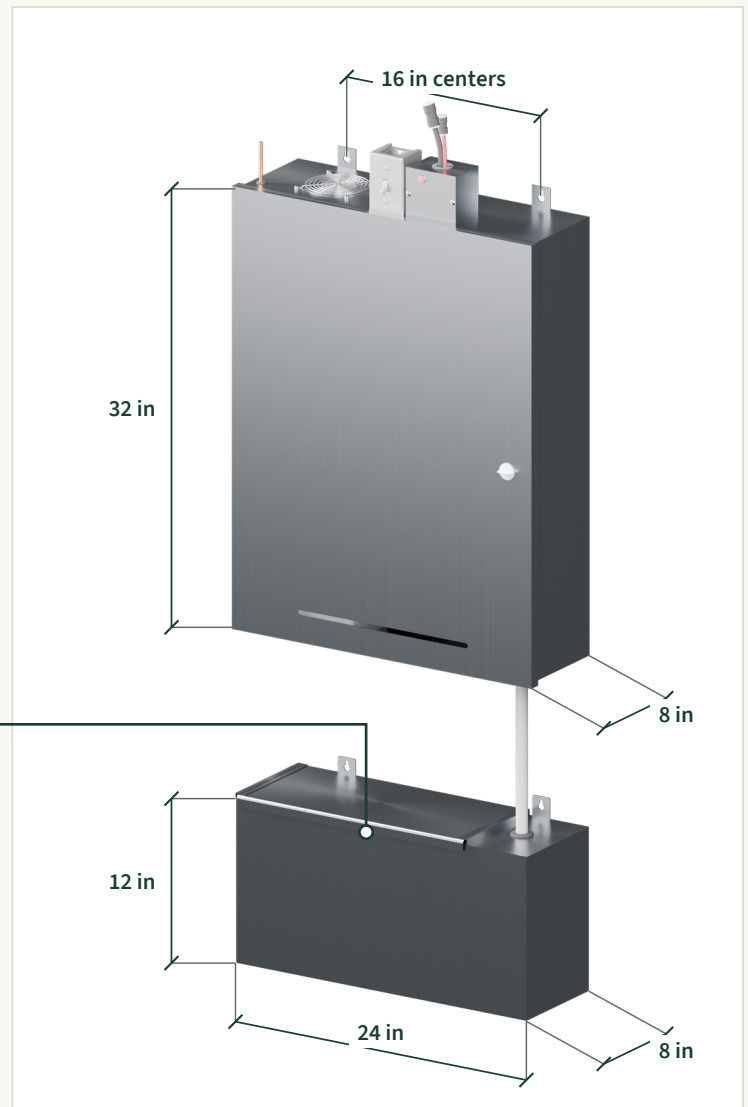

From supply room to duct

The supply room shown is one example of remote placement. Separate air and solution tubing runs from the cabinet through supported conduit to two tees above the duct.

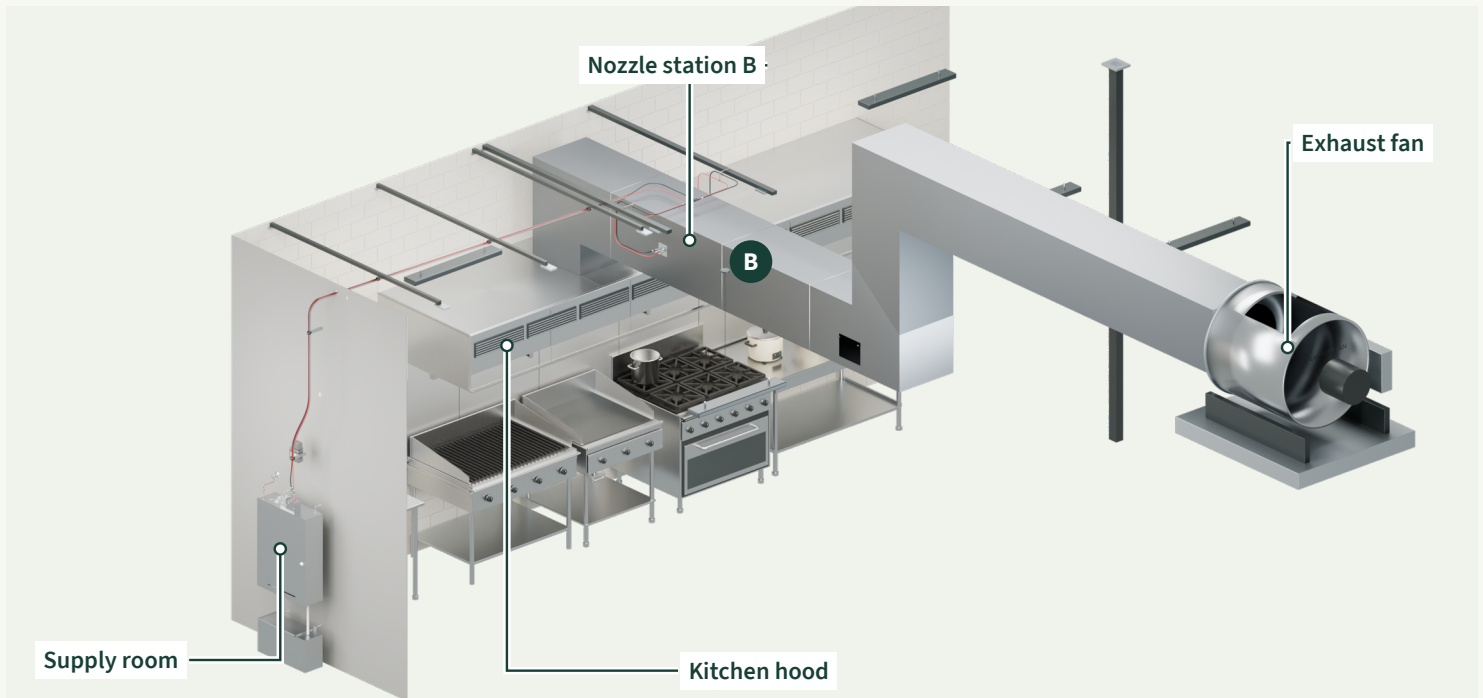


Example installation; selected building elements and electrical routes omitted. Not for construction.

CABINET PLACEMENT

Locate the cabinet so staff can hear its internal low-solution buzzer during normal working hours and reach the external container for refilling.

B Two tees. Two opposed nozzles.

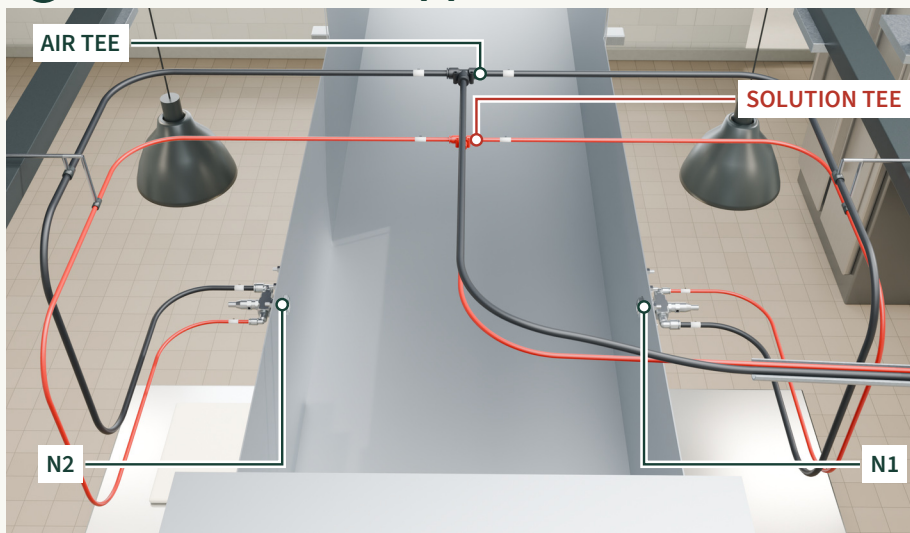

Each tee feeds its own connection on both N1 and N2. The duct and conduit cutaways reveal the separate supplies and the nozzle tips inside the exhaust path.


NOZZLE SERVICE ACCESS

Position both nozzles where staff can reach the rear cleaning buttons for routine maintenance.

Explanatory cutaway; hardware and tube positions retained. The conduit section does not depict a removable cover.

Coordinate the connections


Plan the MOAS supply and exhaust-fan control connection with the project team. The views identify equipment and routes; they are not wiring diagrams.

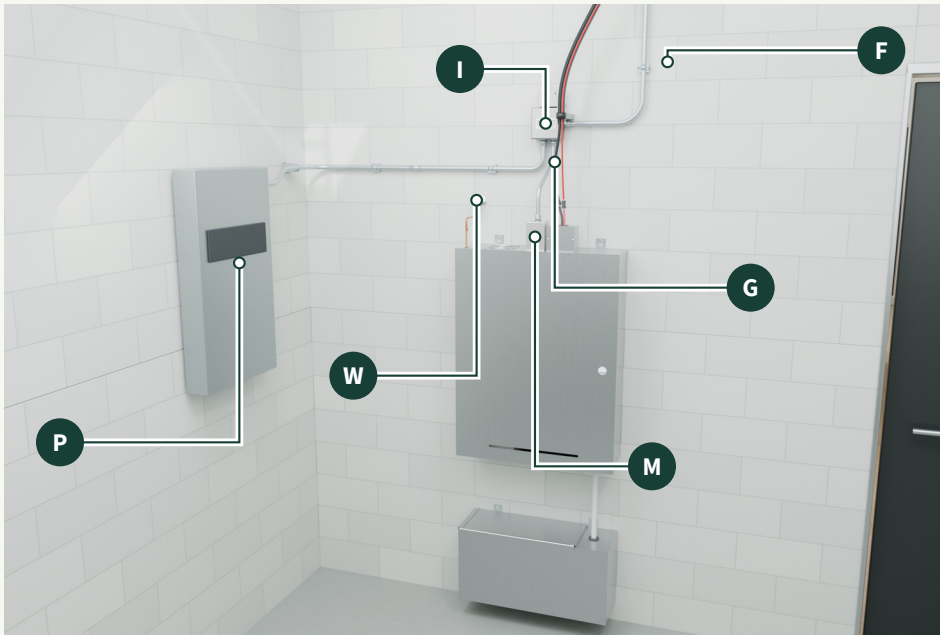


Fan control is distinct from the dedicated MOAS circuit. Coordinate field wiring for the specific project.

- P Building electrical panel**
120 VAC, 20 A circuit dedicated to MOAS.
- W Cold-water supply**
A building-provided isolation valve is recommended. MOAS also has an internal shutoff.
- I Exhaust-fan interlock**
Located above the cabinet in this example.
- M Power switch**
Mounted on top of the cabinet.
- G Air and solution tubing**
Separate tubes rise from the cabinet toward the duct.
- F Exhaust-fan control connection**
Separate route from the interlock toward the exhaust fan.

N1 / N2 • External nozzle connections

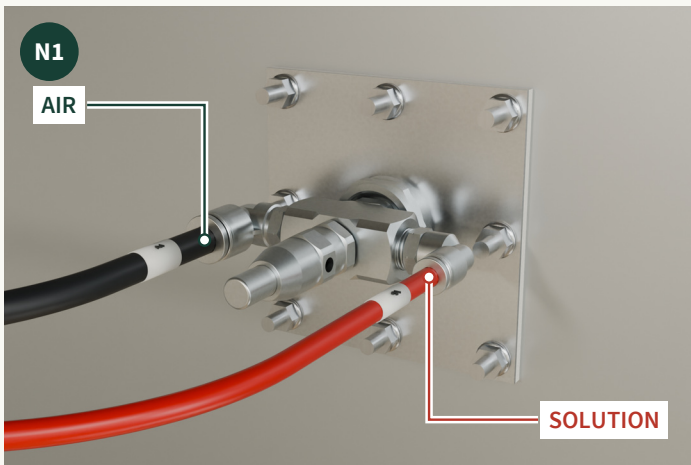

AIR / Black, 3/8-inch OD tubing

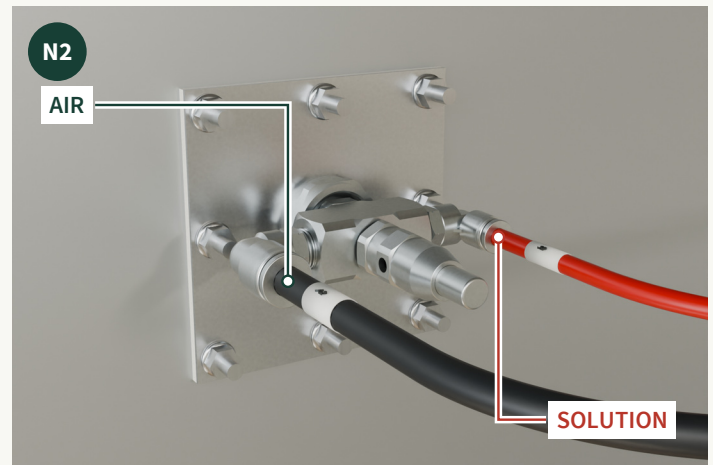

SOLUTION / Red, 1/4-inch OD tubing

Start with the project

MOAS can be used independently or alongside Molitron EPFA filtration. Select and configure the system for the cooking operation and exhaust arrangement.

UP TO

95%

odor reduction

UP TO

50%

smoke reduction

UP TO

6,000 CFM

per two-nozzle system

Performance varies with cooking process, hood grease-removal performance, exhaust configuration, installation, dwell time and calibration. Results are not guaranteed. Capacity is subject to project-specific configuration; smoke reduction is not a particle-filtration rating.

Planning essentials

MOAS electrical supply	120 VAC, 20 A dedicated circuit
Cold-water supply	1/4-inch connection
Standard solution container	Up to 10 gallons
Application	Commercial, indoor, permanently connected equipment

Review the cooking load, hood grease removal and exhaust airflow with Molitron. Coordinate nozzle placement and adequate treatment dwell time, protected tubing routes, cabinet ventilation and service access. Detailed mounting, commissioning, calibration and maintenance belong in the installation and operation manual.



ETL Listed • United States and Canada

MOAS is ETL Listed under Intertek Report 101453585DEN-002. The report identifies UL 197 and CSA C22.2 No. 109 as the applicable standards. Listing does not establish approval of a field installation.

Discuss your application

303-969-8888 | cleanair@molitron.com