




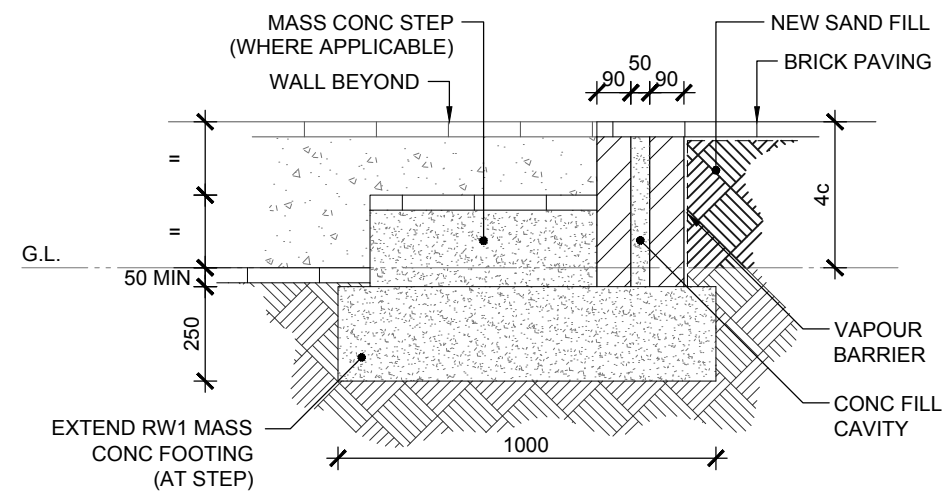


DETAIL A (RW1)
1:20

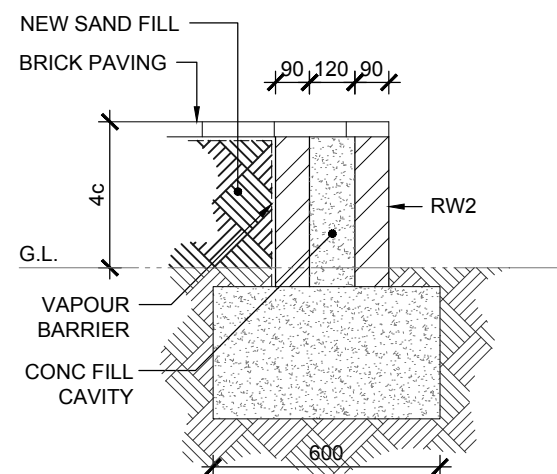

DETAIL B (RW2)
1:20

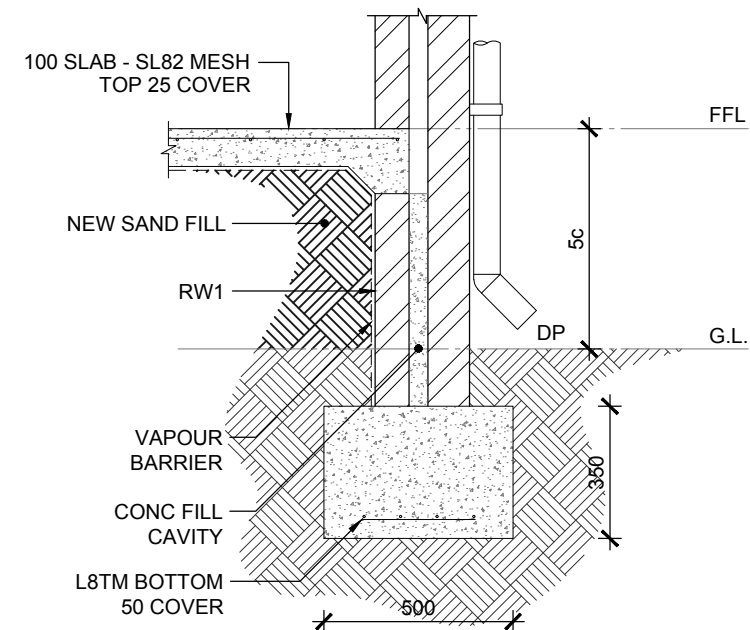


DETAIL C
1:20

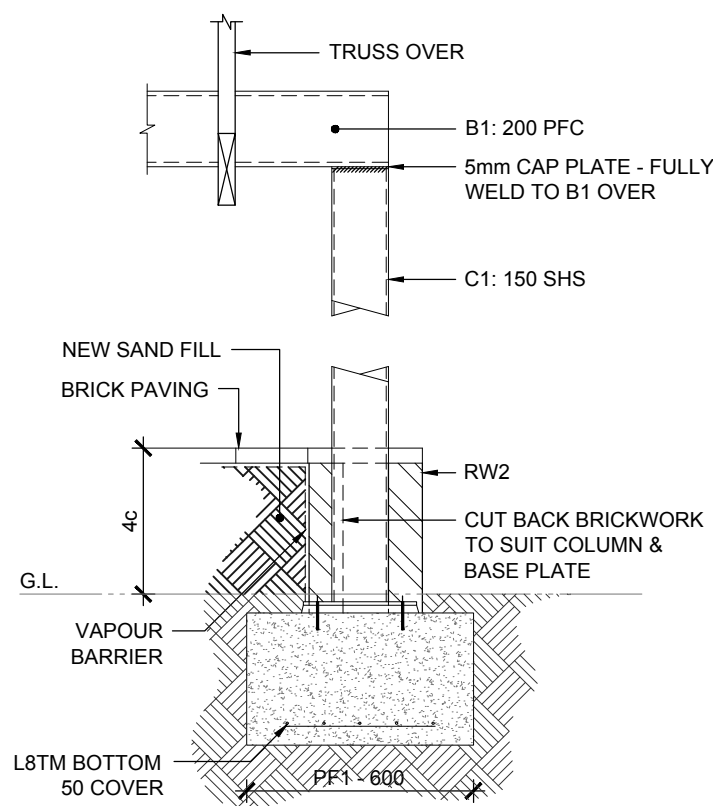


DETAIL D (C1 ON PF1)
1:20

ANY STEELWORK IN CONTACT WITH THE GROUND IS TO BE COATED WITH 2 COATS OF SIGMACOVER 640 (BY PPG PROTECTIVE & MARINE COATINGS) (MIN DFT 250 MICRONS) OR SIMILAR APPROVED.

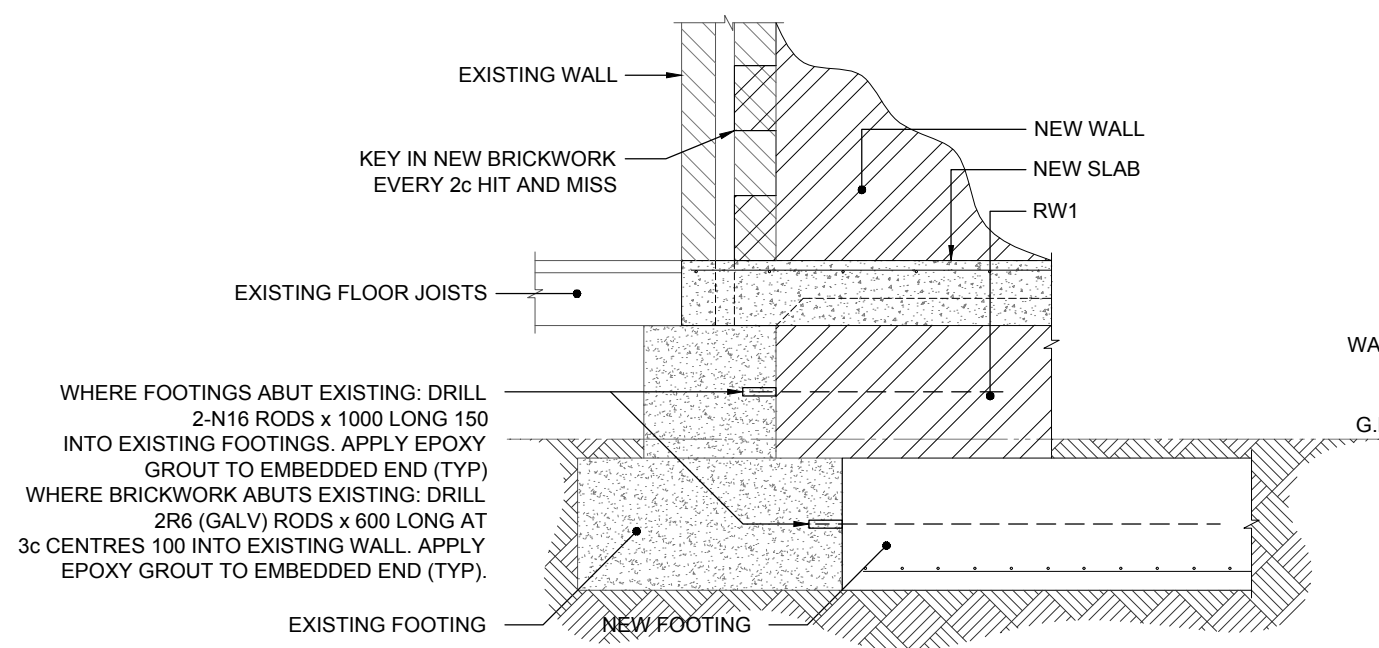

DETAIL E
1:20

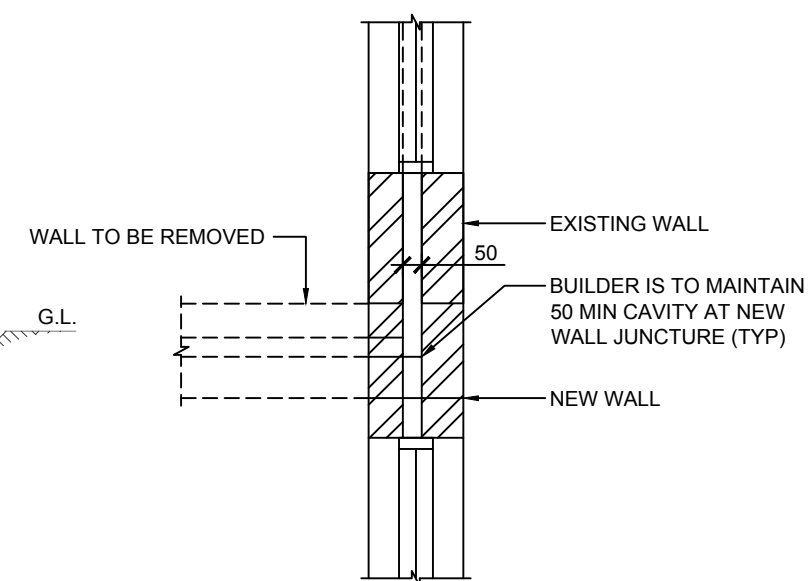

DETAIL F
1:20

PROPOSED ADDITION - C & J SPRATT
11 MEREWORTH RD, THORNLIE WA

SCALE 1:20 @ A3

DRAWN JULY 2012


A.03

DO NOT SCALE OFF DRAWING : ALL DIMENSIONS ARE APPROXIMATE ONLY AND SHOULD BE CONFIRMED ON SITE

SERVICES UNDER

MEREWORTH ROAD

SERVICES UNDER

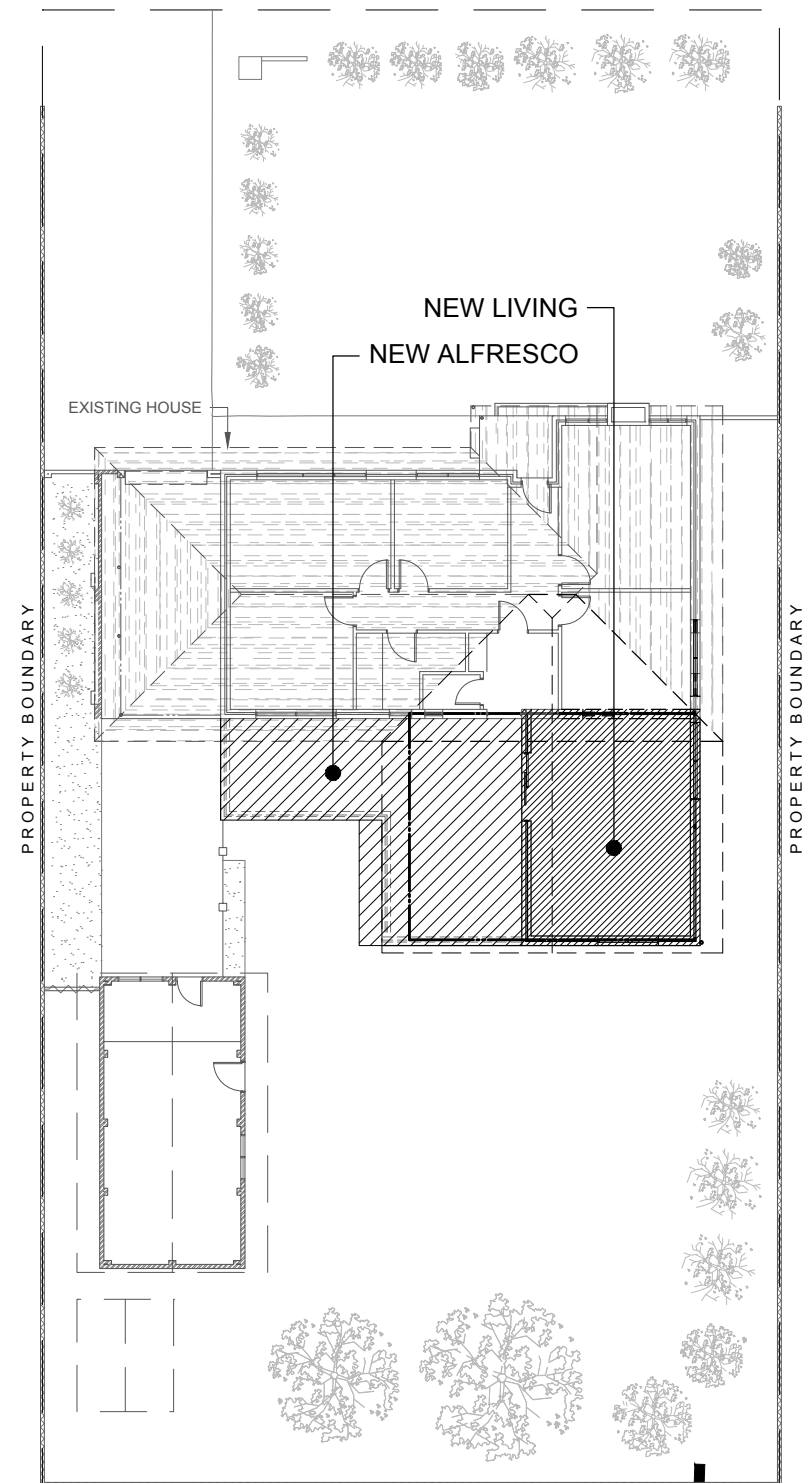


SITE PLAN
1:200

- LEGEND**
- C1 - 150 x 5 SHS: SEE DETAIL A.03
 - B1 - 200 PFC
 - T1 - PREFABRICATED TRUSS @ 600 c/c
 - SF1 - 500 x 350 STRIP FOOTING: SEE DETAIL A.03
 - PF1 - 800 x 800 x 350 PAD FOOTING: SEE DETAIL A.03
 - DP - NEW DOWNPIPE

NEW WORKS
1:100

- LEGEND**
- C1 - 150 x 5 SHS: SEE DETAIL DWG A.03
 - B1 - 200 PFC: SEE DETAIL DWG A.03
 - TR1 - PREFABRICATED TRUSS @ 600 c/c
 - R1 - 190 x 45 MGP10 RAFTERS @ 600 c/c
 - SF1 - 500 x 350 STRIP FOOTING: SEE DETAIL DWG A.03
 - PF1 - 800 x 800 x 350 PAD FOOTING: SEE DETAIL DWG A.03
 - RW1 - RETAINING WALL: SEE DETAIL DWG A.03
 - RW2 - RETAINING WALL: SEE DETAIL DWG A.03
 - DP - NEW DOWNPIPE
 - L1 - 150 x 100 x 10 UA LINTEL - 250 MIN END BEARING (OVER ALL NEW OPENINGS)
- NEW TRUSS**
- NEW BEAM**
- NEW RAFTERS**
- EXISTING BRICK WALL TO BE DEMOLISHED**
- NEW BRICK WALL**
- EXISTING BRICK WALL TO BE REPLACED**
- EXISTING BRICK WALL**
- EXISTING STUD WALL**
- NEW RETAINING WALL**

- MATERIALS**
- BRICKWORK - BORAL "FASTWALL" UTILITY BRICKS, RENDERED INTERNALLY & EXTERNALLY
- ROOF TRUUS - PREFABRICATED ROOF TRUSS TO AUSTRALIAN STANDARDS
- ROOF TILES - TERRACOTTA TILES TO MATCH EXISTING
- WINDOWS - BORAL FIXED & ALUMINUM FRAMED WINDOWS
- DOORS - BORAL DOUBLE SLIDING ALUMINIUM FRAMED DOORS





PROPOSED ADDITION - C & J SPRATT
11 MEREWORTH RD, THORNLIE WA

- FOOTINGS**
- FOOTINGS AND SLABS ON GROUND TO COMPLY WITH AS 2870.
 - FOOTING AND GROUND SLAB DESIGNED FOR A CLASS A STABLE SITE AS PER AS2870 U.N.O.
 - FOOTINGS AT LOWEST LEVEL MUST BE FIRST FOOTINGS POURED.
 - DIFFERENCE IN FOOTING LEVELS IS NOT TO EXCEED HALF THE CLEAR DISTANCE BETWEEN THEM.
 - LOCATE FOOTINGS CENTRALLY UNDER WALLS & COLUMNS UNLESS OTHERWISE SHOWN.

- STRUCTURAL STEELWORK**
- ALL STEELWORK TO COMPLY WITH AS 4100
 - ALL WELDING TO COMPLY WITH AS/NZS 1554 PARTS 1 AND 2.
 - ALL WELDS TO DEVELOP FULL STRENGTH OF MEMBERS JOINED. UNLESS NOTED OTHERWISE
 - FULLY SEAL ALL HOLLOW SECTIONS USING 5MM PLATES WHERE NECESSARY.
 - PROVIDE ALL CLEATS, BRACKETS, HOLES, ETC. NOT SHOWN BUT NECESSARY TO COMPLETE THE BUILDING.
 - UNLESS OTHERWISE SHOWN, ALL BOLTED CONNECTIONS ARE TO DEVELOP FULL STRENGTH OF MEMBERS JOINED.
 - STEEL BEAMS TO BE FABRICATED WITH NATURAL CAMBER UP.
 - UNLESS OTHERWISE NOTED, USE:
 - (a) 10MM THICK GUSSET FIN AND END PLATES AND 2-M16 8.8/S BOLTS.
 - (b) 6MM CONTINUOUS GP FILLET WELD.
 - ALL BOLTED CONNECTIONS TO BE BOLTING CATEGORY 8.8/S UNLESS NOTED OTHERWISE
 - PROVIDE TEMPORARY BRACING DURING ERECTION.
 - USE 1:2 CEMENT: SAND GROUT UNDER ALL SEATING AND BASE PLATES, ENSURING THE SPACE UNDER THE PLATES IS COMPLETELY FILLED.
 - WHERE MASONRY WALLS ABUT OR ADJACENT TO STEEL COLUMNS: WELD A VERTICAL R10 ROD TO COLUMN. LENGTH OF WELD TO BE 25mm EACH SIDE OF ROD EVERY 350mm. PROVIDE 5mm CLEARANCE BETWEEN ROD AND COLUMN FACE.
 - ALL INTERNAL STEELWORK SHALL BE CLASS '2.5' ABRASIVE BLASTED AND APPLY 1 COAT INORGANIC ZINC SILICATE WITH MINIMUM TOTAL DRY THICKNESS OF 75 MICRONS.
 - EXTERNAL STEELWORK TREATMENT TO CONFORM WITH AS/NZS 2312 UNLESS NOTED OTHERWISE
 - TREAT SITE WELDS WITH 2 COATS OF 'JOTUN BARRIER' TWO-PACK EPOXY (DRY FILM THICKNESS OF 45 MICRONS EACH), OR SIMILAR APPROVED.
 - COLD FORMED SECTIONS TO CONFORM TO AS 1397 - G 450 (450 MPa MIN. YIELD STRESS).
 - PROVIDE EXTRA PURLINS & GIRTS AS REQUIRED TO SUIT PENETRATIONS AND GUTTERS.
 - ALL STEELWORK IN CONTACT WITH THE GROUND IS TO BE COATED WITH 2 COATS OF SIGMACOVER 640 (BY PPG PROTECTIVE & MARINE COATINGS) (MIN DFT 250 MICRONS) OR SIMILAR APPROVED.

SCALE 1:100 @ A3
1:200 @ A3
DRAWN JULY 2012

A.01

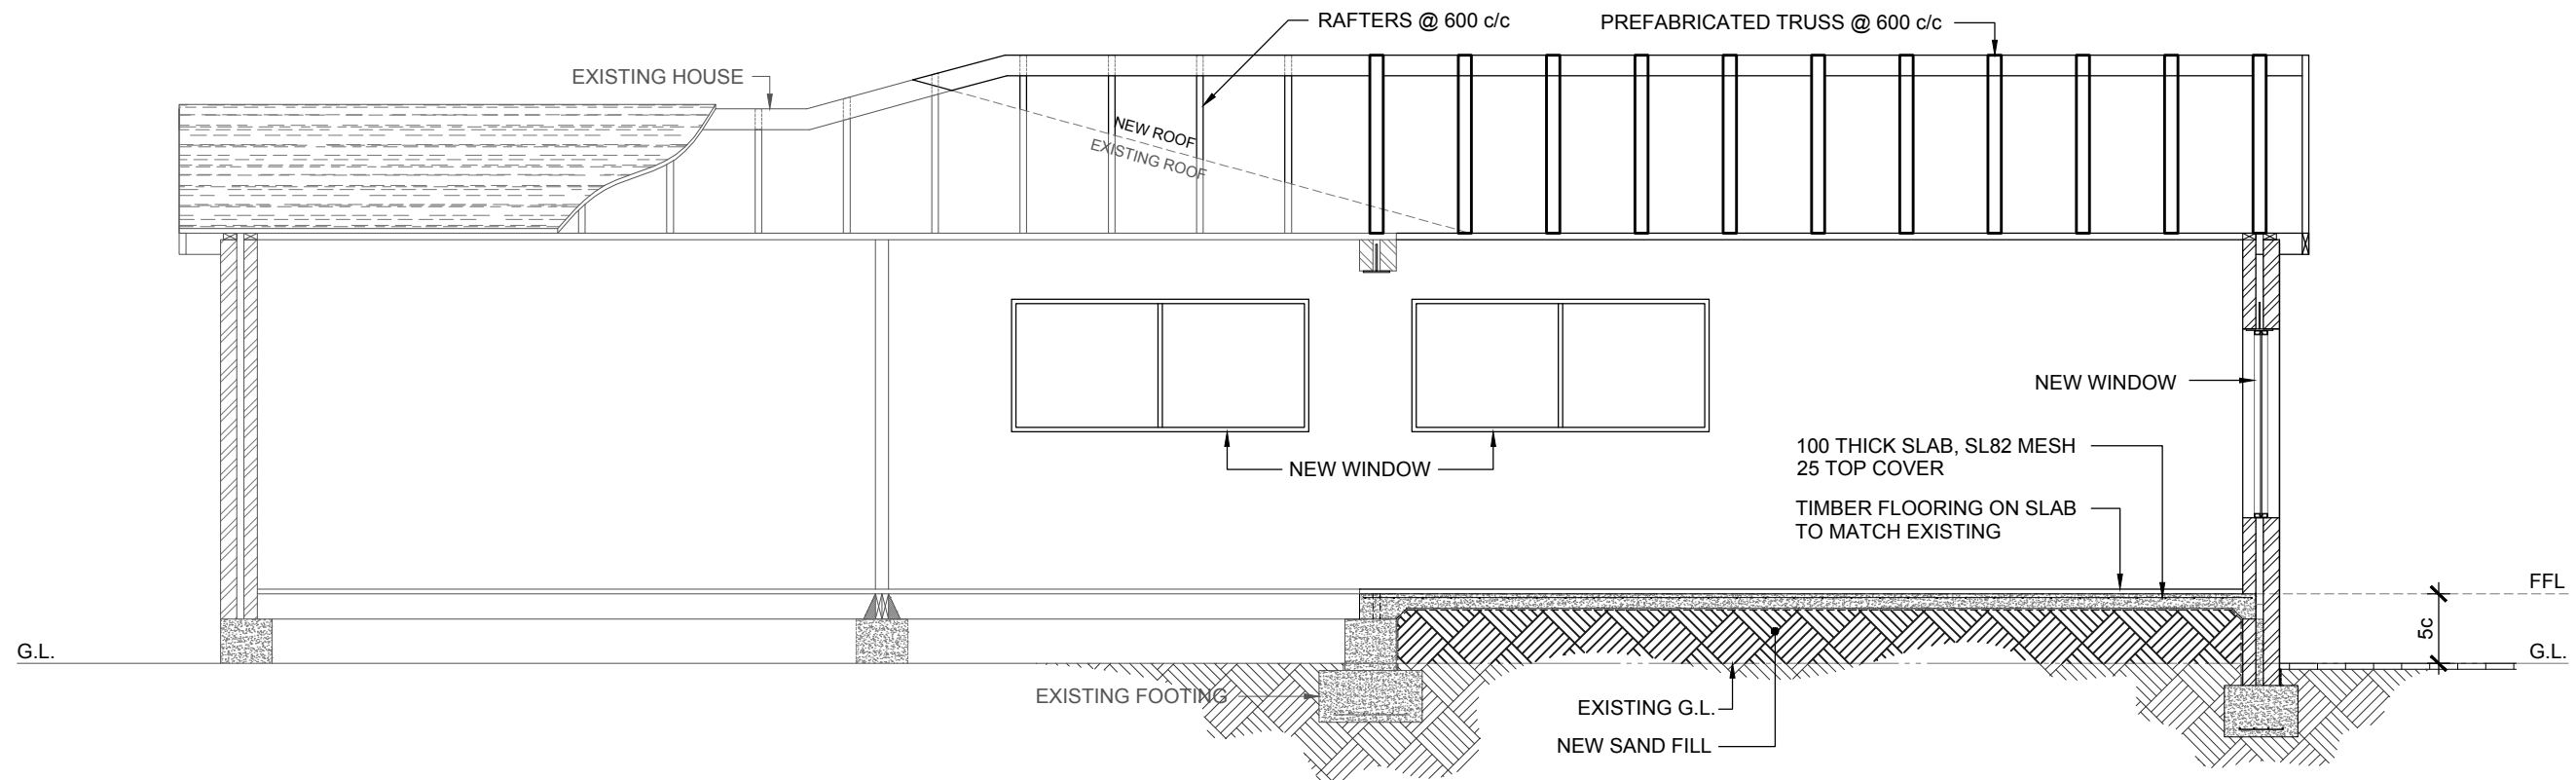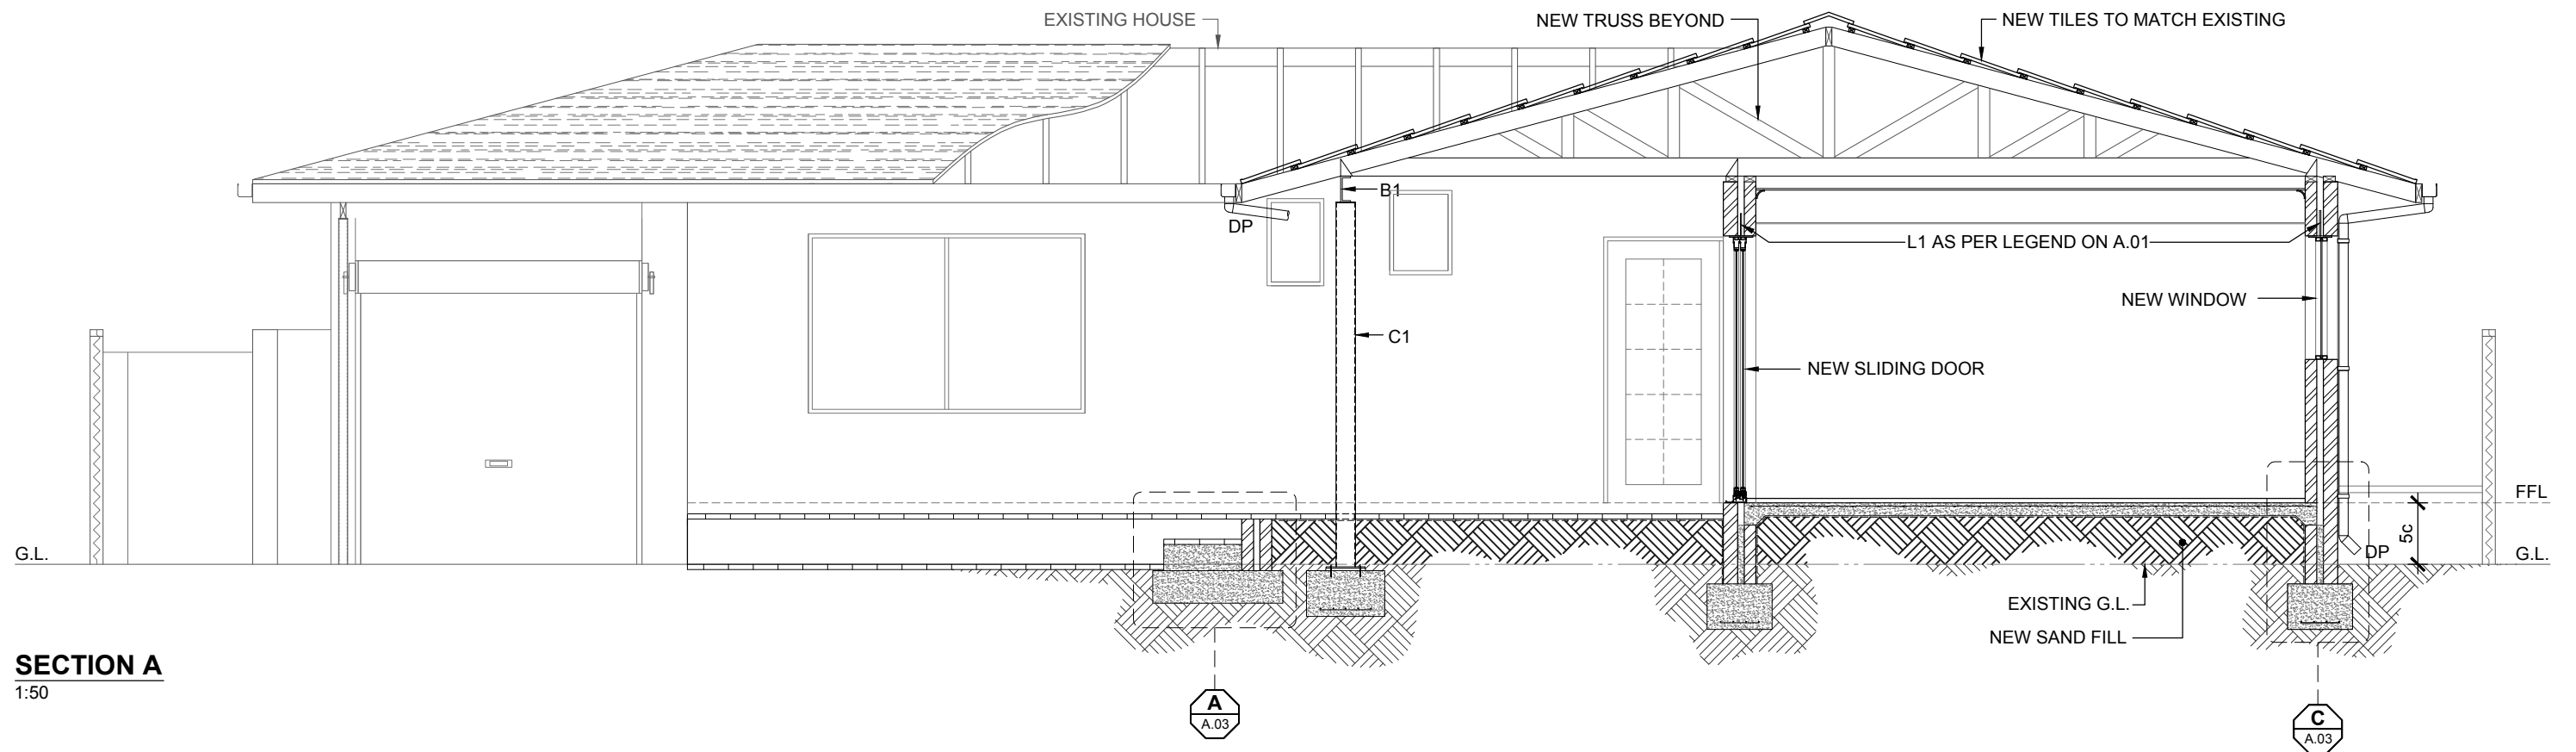

PROPOSED ADDITION - C & J SPRATT
11 MEREWORTH RD, THORNLIE WA

SCALE 1:50 @ A3

DRAWN JULY 2012

A.02

DO NOT SCALE OFF DRAWING : ALL DIMENSIONS ARE APPROXIMATE ONLY AND SHOULD BE CONFIRMED ON SITE