Residencial single door open outwards

DO_0345
Door Outer

DSI_0344
Open Out Stile

In side

DB_01 Square Bead
DB_02 Bevel Bead

Open Out,Glazed In

Out side

In side

Out side

DSI_0344
Open Out Stile

Slave Bolt

DO_0345
Door Outer

glazing

Unit 5 Brook lane business center
Brook lane north, LONDON, TW8 0 PP
TEL: 0208 111 111 5
Mob: 074 5050 3030
info@xrayglazing.co.uk

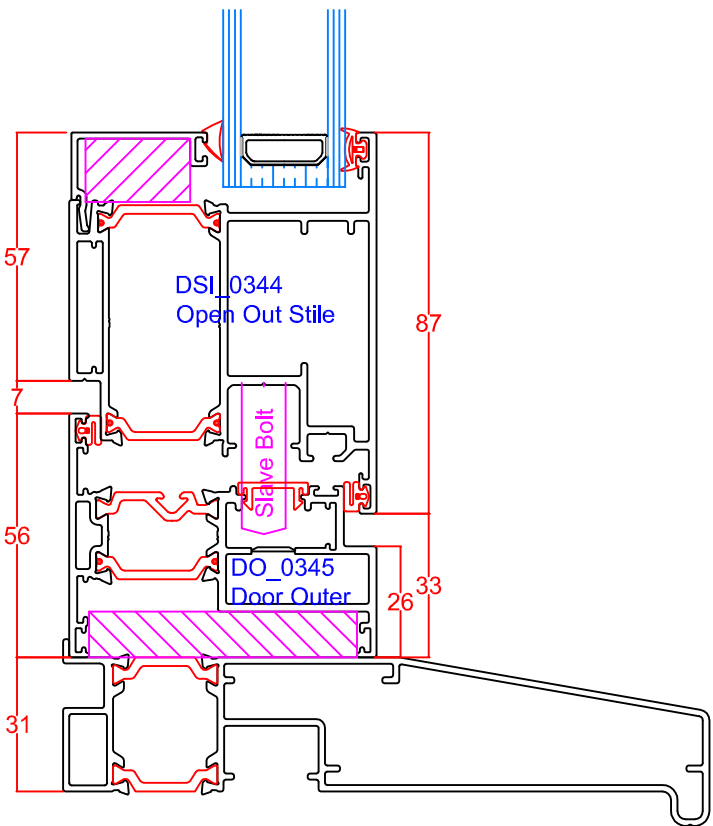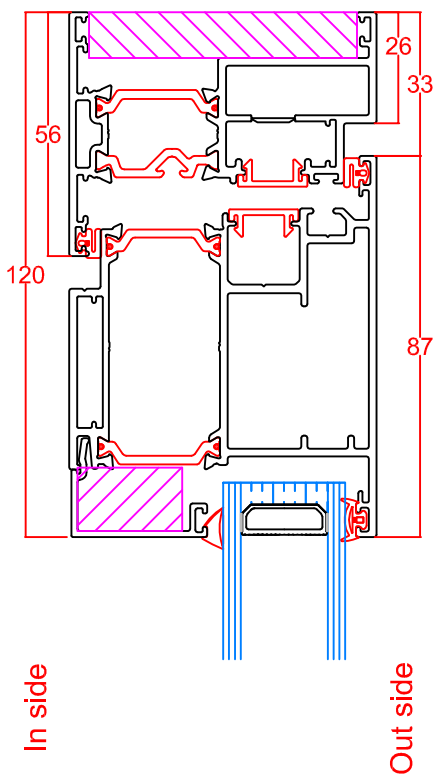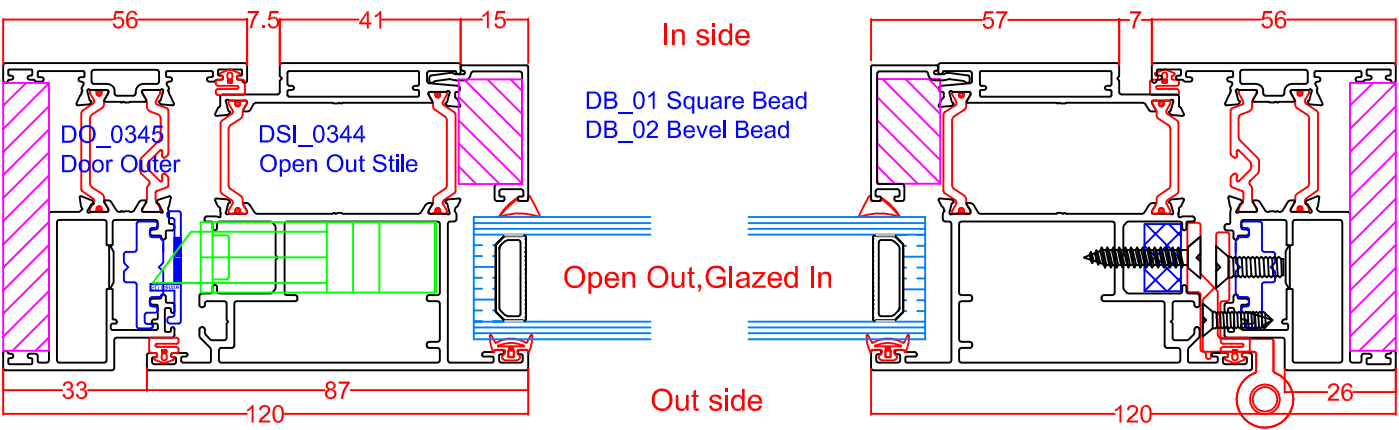**XRAY GLAZING LTD**

Results of Test: Chilt/P11122/02

This document confirms that performance testing was conducted from 6 December 2011 to 2 November 2012. Testing was conducted to the following standards:-

- PAS 24-1: 2007 + A1: 2009 Enhanced security performance requirements for door assemblies - Part 1: Single and double leaf, hinged external door assemblies to dwellings
- And BS 6375 Part 1:2009 Performance of windows and doors - Part 1: Classification for weathertightness and guidance on selection and specification. The following results were achieved

Product tested		Climate II PA Doorset (Outward Opening)	
Summary of testing procedure			Result
	Test Standard	Classification Standard	
Air permeability	BS EN 1026: 2000	BS EN 12207: 2000	600Pa (Class 3)
Watertightness	BS EN 1027: 2000	BS EN 12208: 2000	200Pa (Class 5A)
Wind resistance	BS EN 12211: 2000	BS EN 12210: 2000	1200Pa (Class C3)
Exposure category		BS 6375: Part 1: 2009	1200
PAS 24-1: 2007 + A1: 2009 - Clause A.4			Pass

Air leakage at 50pa was 1.3m³/h positive pressure and 1.1m³/h negative pressure. The perimeter length of opening light was 5.74m.

Passed for the requirements of both key removable and thumbturn locks

The results relate only to the specimen tested, as detailed in the technical specification Chilt/P11122/tec2

Steve Smith – Deputy Section Head
Date: 02-11-2012

Vincent Kerrigan - Technical Manager
Date: 02-11-2010

UKAS TESTING
1762

XRAY glazing