
AUX ACTIVE CLAMP / ALL NETS HOT-REFERENCED

Input: regulated 15V; 35V fault envelope remains conditional.

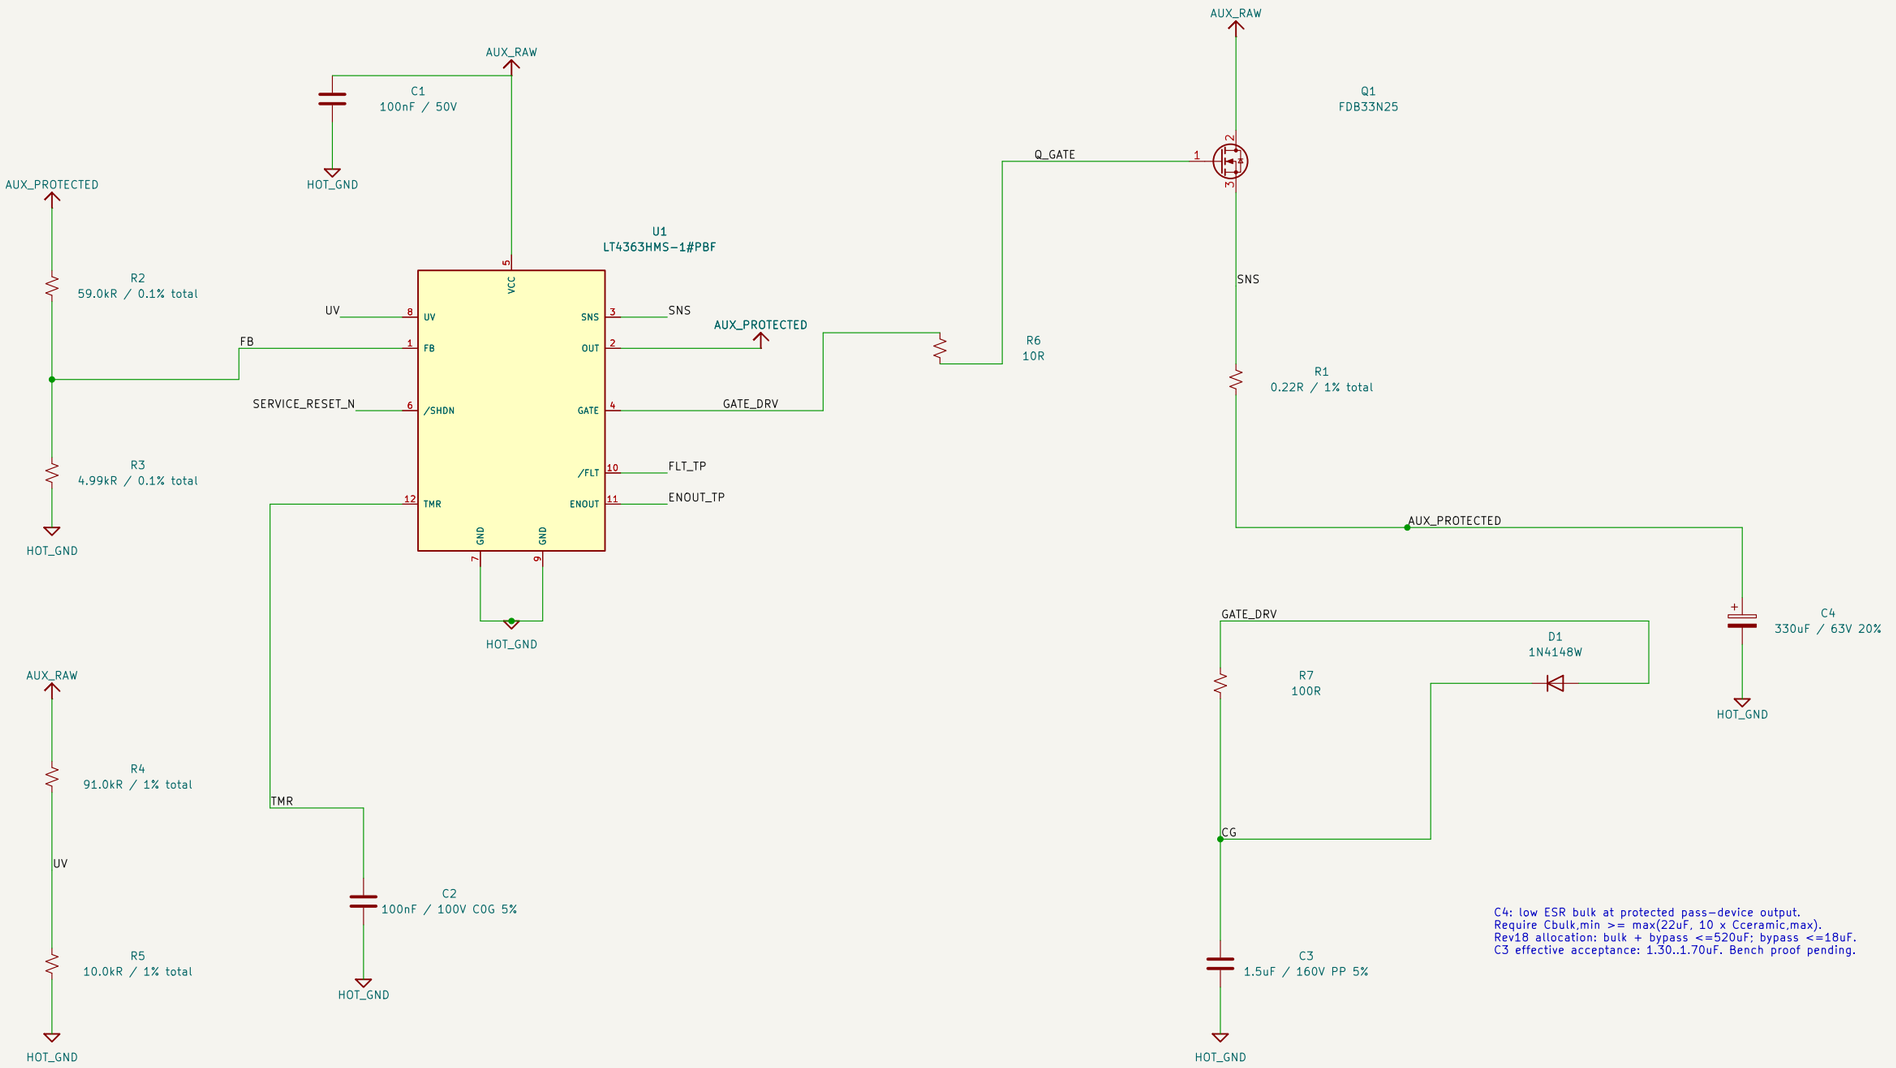

C4: low ESR bulk at protected pass-device output.
Require Cbulk,min >= max(22uF, 10 x Cceramic,max).
Rev18 allocation: bulk + bypass <=520uF; bypass <=18uF.
C3 effective acceptance: 1.30..1.70uF. Bench proof pending.

SERVICE_RESET_N: local contact to HOT_GND only; normally open.
Independent of PERMIT. SHDN <=0.4V for >=120ms: TIMER RESET ONLY.
Release >=10V/ms. Gate turn-off / output discharge require separate validation.
FLT_TP / ENOUT_TP are observation only; no fault-net pullup fitted.

C2/C3/C4 have prototype MPNs; remaining passives keep placeholder identities.
No output-peak, startup, SOA or single-pass-FET-short qualification is claimed.

Review fixture - not production or hardware qualification

Sheet: /
File: clamp.kicad_sch

Title: Temper / clamp interface fixture

Size: A3	Date: 2026-09-22	**Rev: 19-prototype**
KiCad E.D.A. 10.0.4		Id: 1/1