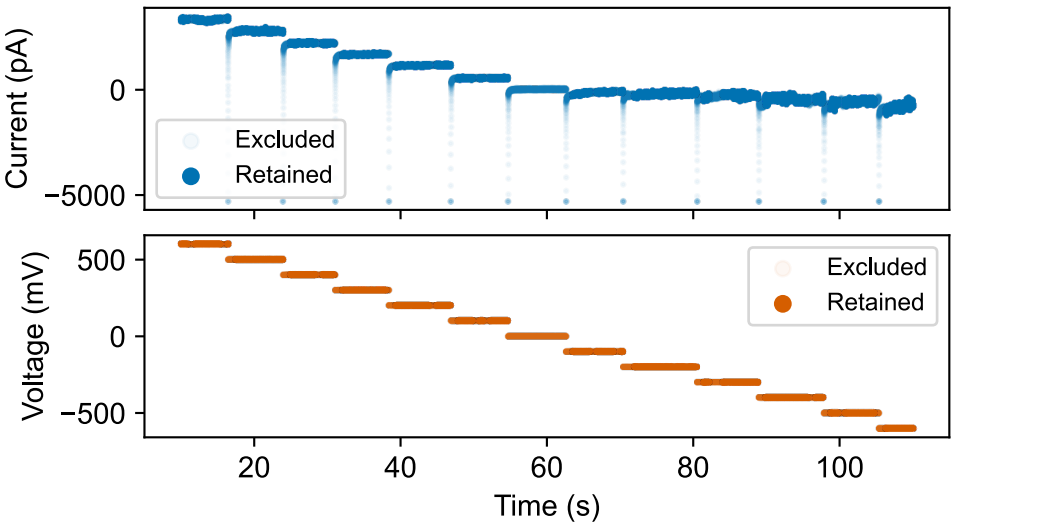

Hafnia 1000:10 mM KCl pH 9.5 ICR Subset I(t) and V(t), Trimmed
Current (pA)
0
−5000
Excluded
Retained
Voltage (mV)
500
0
−500
Excluded
Retained
20
40
60
80
100
Time (s)