

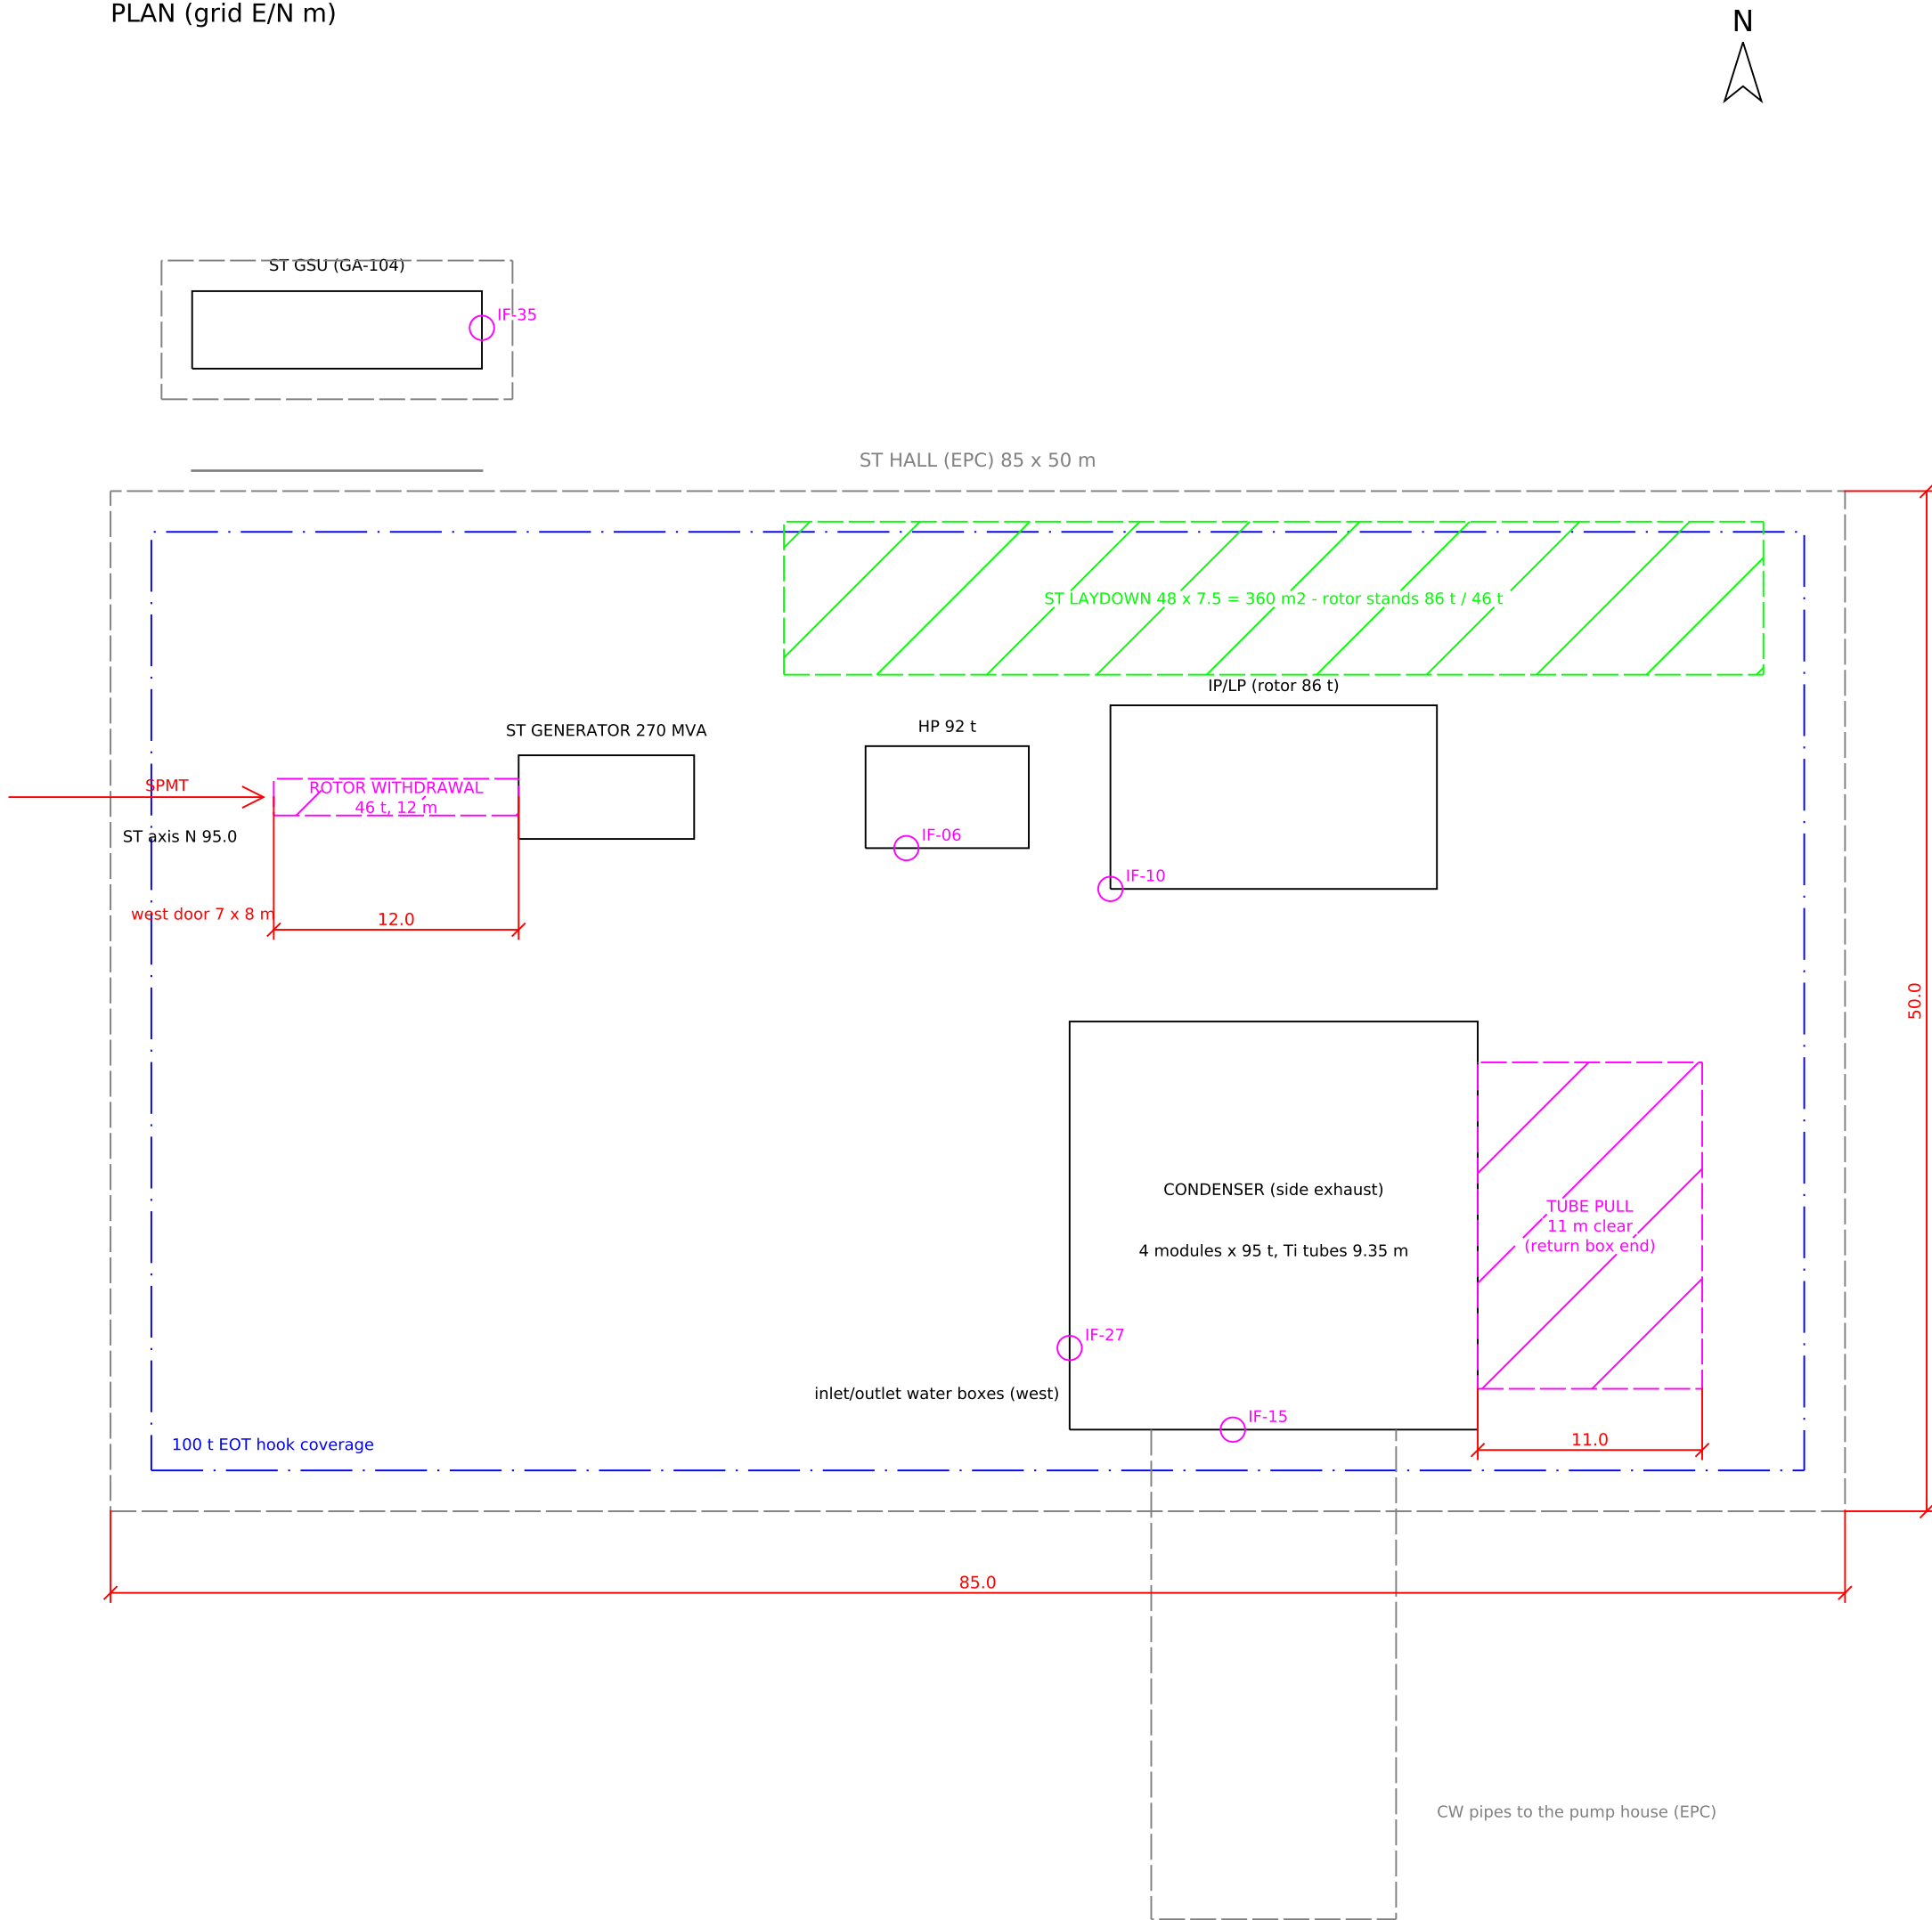


PLAN (grid E/N m)



SECTION ON ST AXIS (looking north), EL m

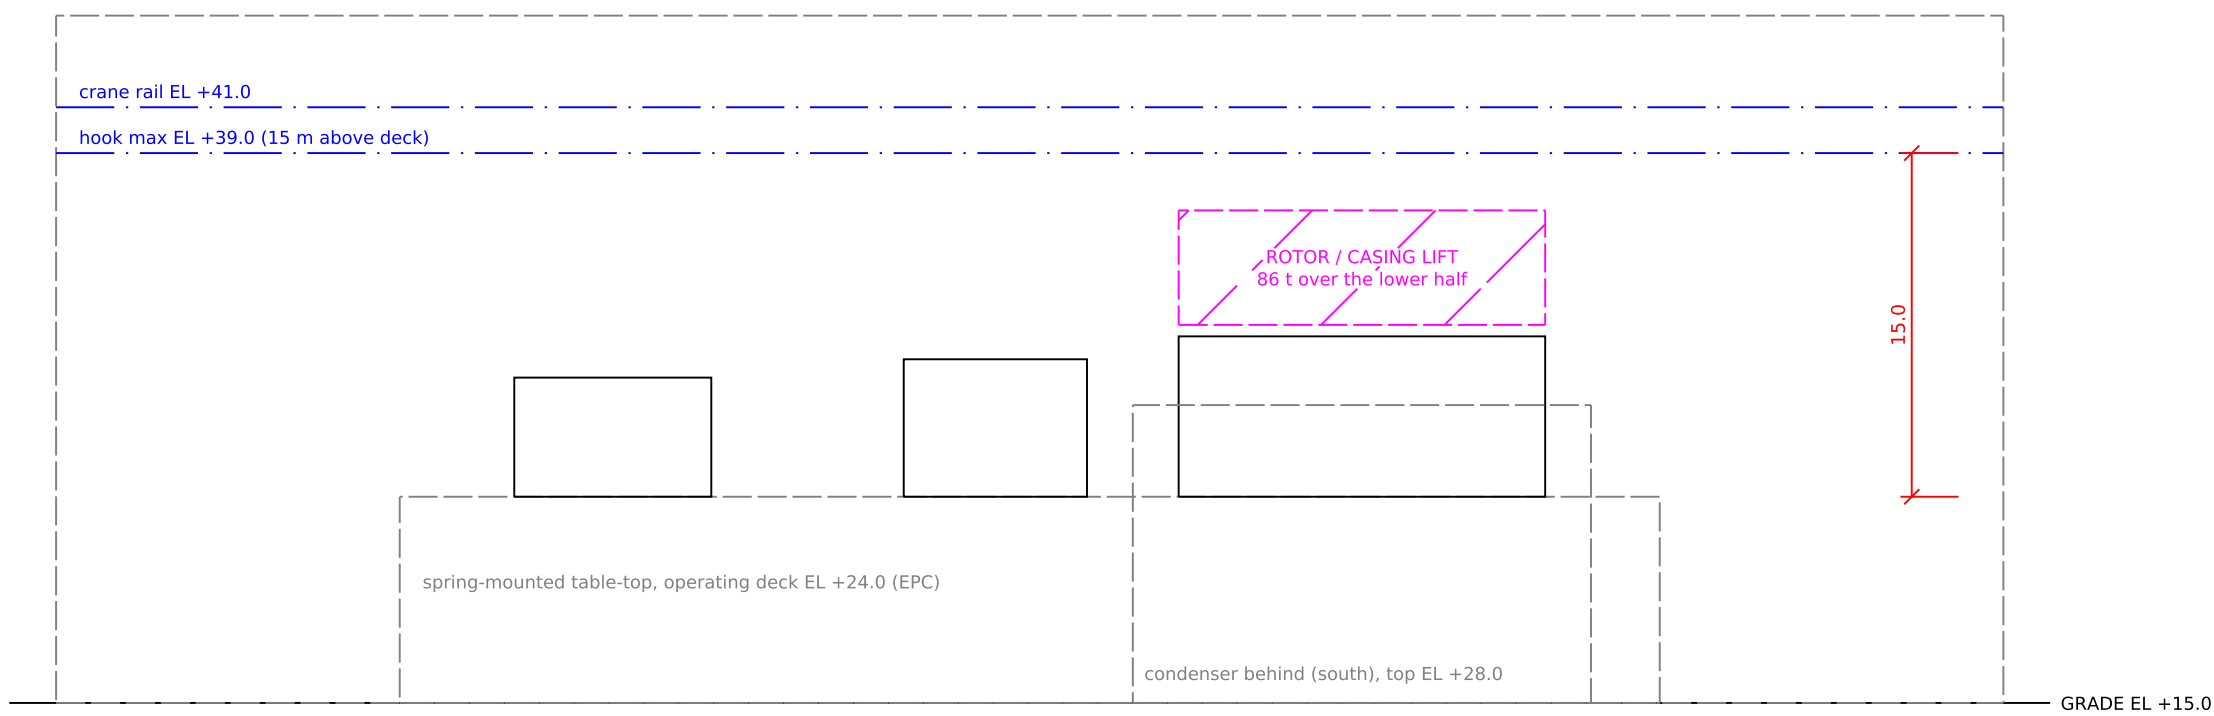

1. WEIGHTS AND LIFTS

Item	t	L x W x H m	Remark
HP turbine (shipped assembled)	92	per DS-103	hall crane
IPILP outer casing lower half	2 x 78	-	hall crane, 2 pieces
IPILP rotor	86	about 9 long	heaviest maintenance lift: 100 t hook
ST generator stator	185	8.6 x 4.1 x 4.2	DS-102; jacking / skidding onto the deck
ST generator rotor	46	about 10 long	withdrawn west, 12 m clear
Condenser modules	4 x 95	per DS-105	set on the condenser foundation before the ST

2. MAINTENANCE AND INSTALLATION REQUIREMENTS

Requirement	IEC requirement (EPC to provide)
Crane	EOT 100 t; hook max >= EL +39.0 (15 m above the operating deck); coverage over ST, generator, laydown and the condenser tube pull area.
Tube pull	11 m clear at the condenser return water box end (east) inside the hall; removable wall panel if the hall is shortened. Water box removal 2 x 12 t.
Laydown	360 m ² on the operating deck level for rotor stands (86 t, 46 t) and casing halves, 5 t/m ² .
Access	west door 7 x 8 m for SPMT; hatch in the deck over the condenser neck expansion joint.
Foundations	ST + generator spring-mounted table-top 980 t (REQ-001 section 9); spring elements by EPC.
CW	4 x DN1800 at the west water boxes (IF-27); ball injection nozzles (IF-44).

LEGEND

- IEC supply (equipment outline)
- EPC item, shown as IEC space requirement
- maintenance / withdrawal space (keep free)
- laydown area
- crane hook coverage / crane
- crane pad / pre-assembly area (temporary)
- vehicle / heavy-haul access (SPMT)
- dimension (m)

VENDOR	Imaginary Electric Company - Power Generation Division (fictional)
PROJECT	Alpilla 600 MW CCGT - 1 x IE-9H.02 multi-shaft power island
CLIENT	Istanbul EPC (consortium leader) - EPC engineering
TITLE	STEAM TURBINE, GENERATOR AND CONDENSER - GA, MAINTENANCE
DWG NO / REV	IEC-ALP-GA-102 Rev 0
SCALE / SHEET	1:300 on A1 / 1 of 1
COORDINATES	plant grid m; levels EL m (grade EL +15.0)
DATE / STATUS	2026-09-28 issued for EPC layout (reference)
NOTE	CASE STUDY - fictional; IEC proprietary