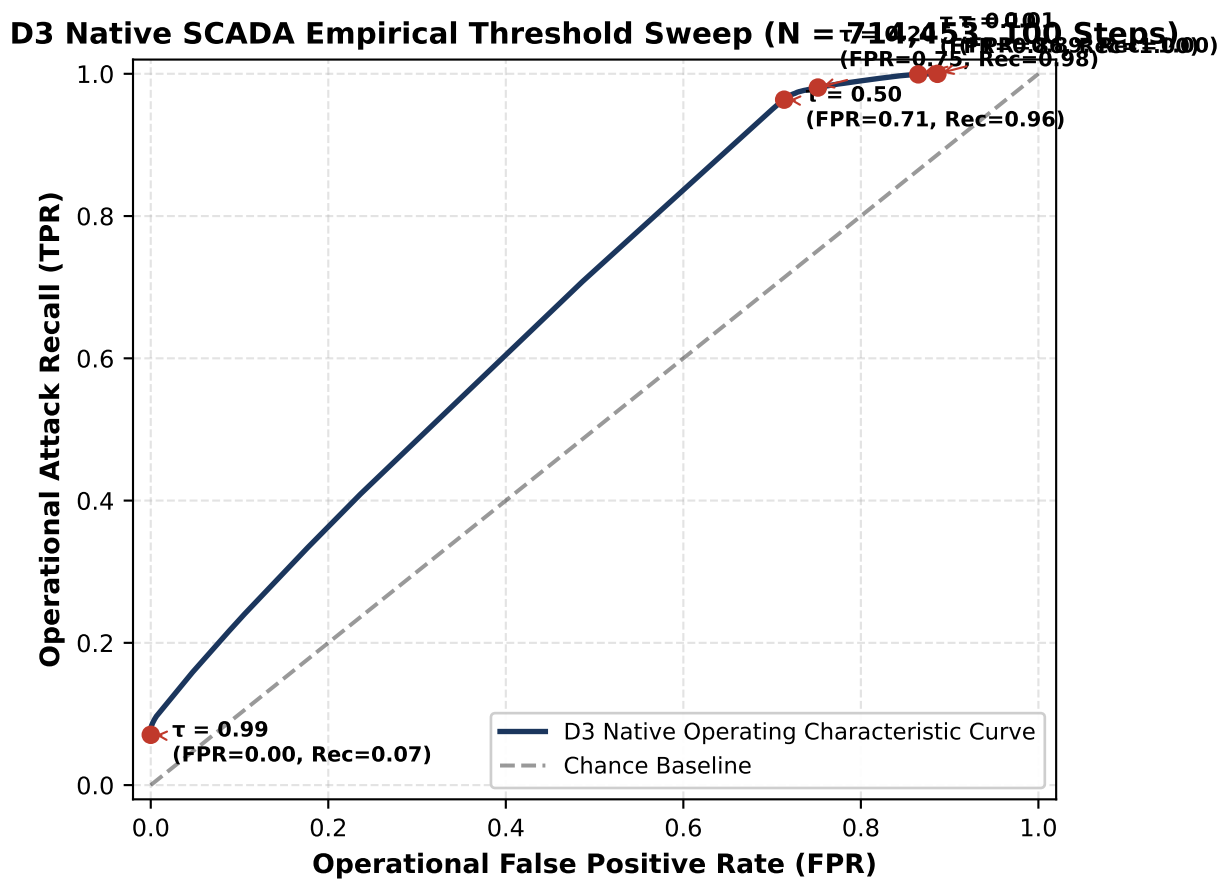
D3 Native SCADA Empirical Threshold Sweep (N = 714,453, 100 Steps)
Operational Attack Recall (TPR)
Operational False Positive Rate (FPR)
0.0
0.2
0.4
0.6
0.8
1.0
τ = 0.99
(FPR=0.00, Rec=0.07)
τ = 0.50
(FPR=0.71, Rec=0.96)
(FPR=0.75, Rec=0.98)
D3 Native Operating Characteristic Curve
Chance Baseline