OIT-24VDC: 24 VDC THIN CLIENT / OIT PANEL (TABLE OF CONTENTS)		
FOLDER	**SHEET**	**TITLE**
VP-1	1	COVER SHEET
VP-1	2	24 VDC POWER DISTRIBUTION
VP-1	3	OPERATOR INTERFACE
VP-1	4	TERMINALS
VP-1	5	ENCLOSURE LAYOUT
VP-1	6	SUBPLATE LAYOUT
VP-1	7	BILL OF MATERIAL

NOTES:

1. Generated from the PanelForge model; sheets are derived outputs. Review copy, not released.
2. Device tags: House device tags read from CPME 1082-01 VFD200 schematics (CB1, HMI1, TB1-n), unverified; Todd to approve.


CPME USA
441 MILWAUKEE AVE STE 6
BURLINGTON W1 53105


PROJECT	OIT-24VDC
LOCATION	
NUMBER	
PANEL ID:	VP-1
PANEL DESC	24 VDC THIN CLIENT / OIT PANEL

VP-1
24 VDC THIN CLIENT / OIT PANEL
COVER SHEET

REVISION A
SHEET 1 OF 7

REV	DESCRIPTION	DATE	APPR. BY
A	REVIEW (GENERATED)	2026-11-04	

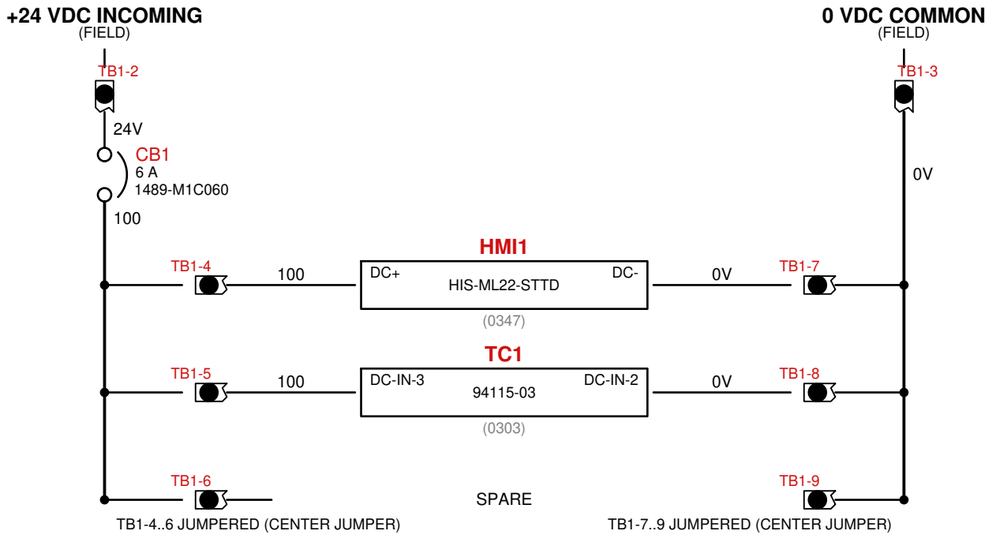

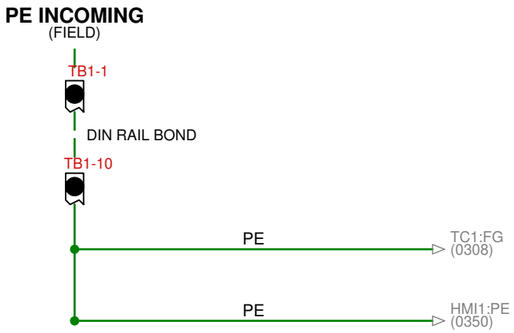

NOTE: Incoming 24 V, 0 V and PE field conductors are not modelled beyond the feed terminals.

A	REVIEW (GENERATED)	2026-11-04	
REV	DESCRIPTION	DATE	APPR. BY

CPME USA
441 MILWAUKEE AVE STE 6
BURLINGTON W1 53105

PROJECT	OIT-24VDC
LOCATION	
NUMBER	
PANEL ID:	VP-1
PANEL DESC	24 VDC THIN CLIENT / OIT PANEL

VP-1
24 VDC THIN CLIENT / OIT PANEL
24 VDC POWER DISTRIBUTION

REVISION A

SHEET 2 OF 7



NOTE: Port pins (squares) are cable connections; cables are proposals until a cable part is selected.

A	REVIEW (GENERATED)	2026-11-04	
REV	DESCRIPTION	DATE	APPR. BY

CPME USA
441 MILWAUKEE AVE STE 6
BURLINGTON W1 53105

PROJECT	OIT-24VDC
LOCATION NUMBER	
PANEL ID:	VP-1
PANEL DESC	24 VDC THIN CLIENT / OIT PANEL

VP-1
24 VDC THIN CLIENT / OIT PANEL
OPERATOR INTERFACE

REVISION A

SHEET 3 OF 7

TERMINAL STRIP TB1 (RAIL ORDER)

TERMINAL	PART	WIRE (1)	DESTINATION (1)	WIRE (2)	DESTINATION (2)
TB1-1	1492-JG4	PE	FIELD	PE	
TB1-2	1492-J4-BR	24V	FIELD	24V	CB1:L1
TB1-3	1492-J4-B	0V	FIELD	0V	TB1-7:1
TB1-4	1492-J4-BR	100	CB1:T1	100	HMI1:DC+
TB1-5	1492-J4-BR	100		100	TC1:DC-IN-3
TB1-6	1492-J4-BR	100		100	
TB1-7	1492-J4-B	0V	TB1-3:2	0V	HMI1:DC-
TB1-8	1492-J4-B	0V		0V	TC1:DC-IN-2
TB1-9	1492-J4-B	0V		0V	
TB1-10	1492-JG4	PE	TC1:FG	PE	HMI1:PE

JUMPERS AND BONDS

LINK	ID	TERMINALS
JUMPER	J-24v-positive	TB1-4, TB1-5, TB1-6
JUMPER	J-24v-return	TB1-7, TB1-8, TB1-9
BOND	B-PE-EARTH-1-rail	TB1-1 - TB1-10 through the DIN rail


REV	DESCRIPTION	DATE	APPR. BY
A	REVIEW (GENERATED)	2026-11-04	

CPME USA
441 MILWAUKEE AVE STE 6
BURLINGTON W1 53105

PROJECT: OIT-24VDC
LOCATION:
NUMBER:
PANEL ID: VP-1
PANEL DESC: 24 VDC THIN CLIENT / OIT PANEL


VP-1
24 VDC THIN CLIENT / OIT PANEL
TERMINALS

REVISION A
SHEET 4 OF 7

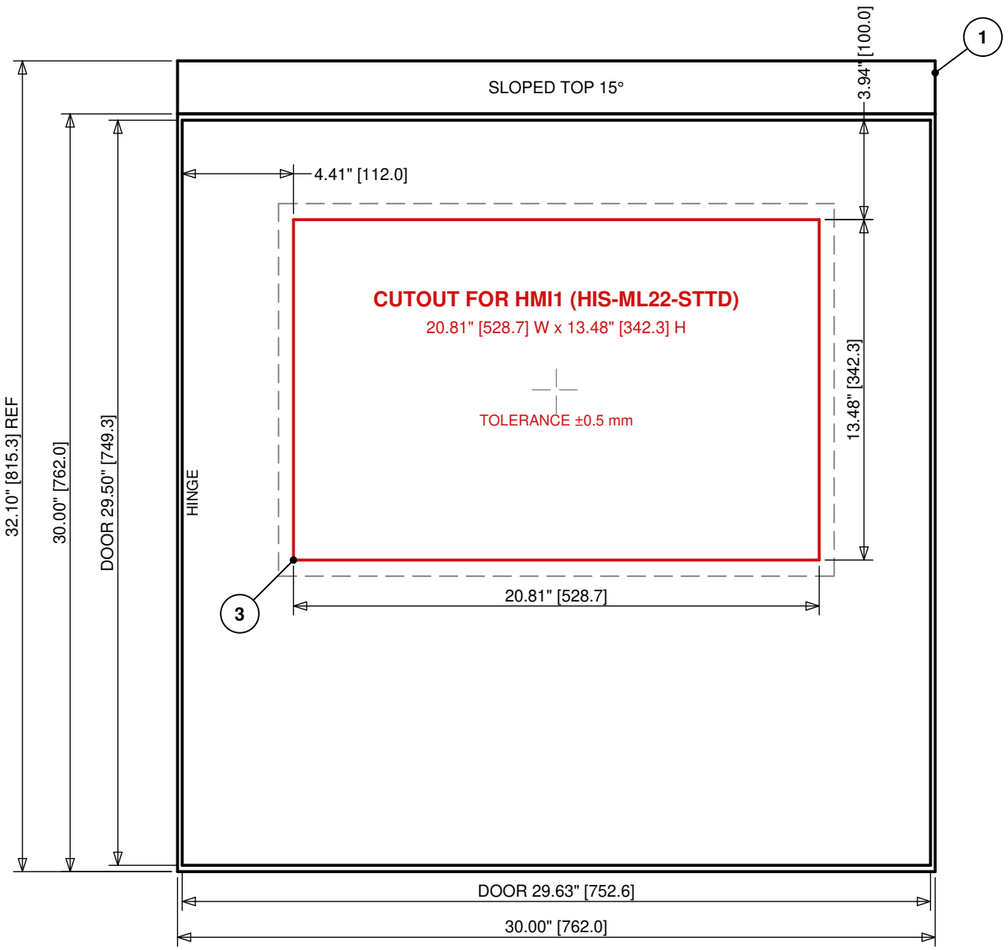


FRONT VIEW (DOOR CLOSED)

SCALE 1:6

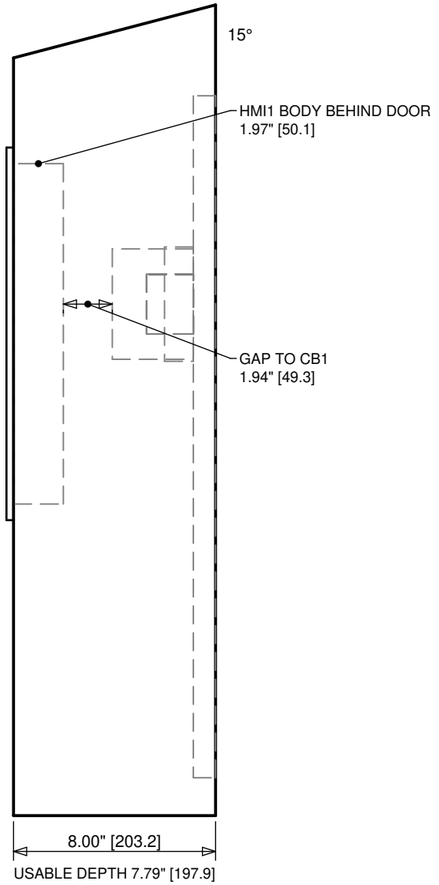

RIGHT SIDE VIEW

SCALE 1:6

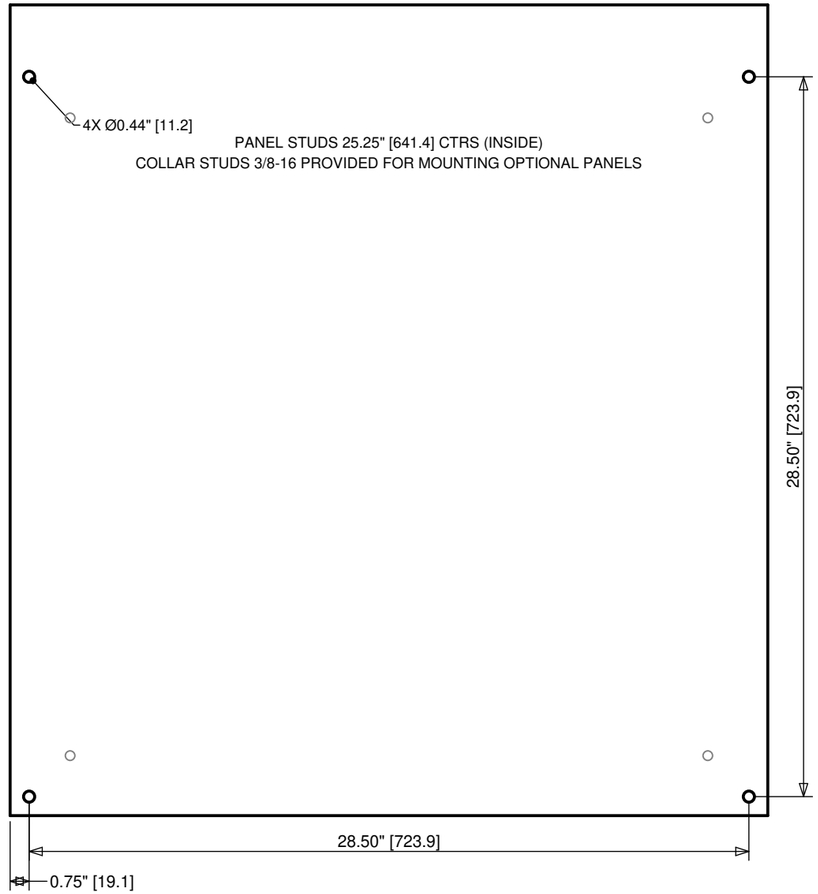

REAR VIEW (WALL MOUNTING)

SCALE 1:6

NOTES:

1. HMI1 cutout position on the door is assumed: Door device centred left to right, cutout top 100 mm below the door top: proportion read from the 2026-11-03 as-built door photo (one reference, assumed).
2. Door 29.63" [752.6] x 29.50" [749.3] from the catalogue (SCE-30EL3008SSST mechanical.door; provenance: "user"); door assumed centred on the front face.
3. Closed-door depth: HMI1 body 50.1 mm behind the door, deepest device behind it CB1 81.5 mm; gap 49.3 mm assuming the subplate (22.35 mm flange) sits on the back wall and the door's inside face is the front plane (door return and stand-off not catalogued).
4. Subplate and panel studs drawn centred on the 30.00 in front height (assumed; the sales drawing does not dimension the stud pattern from the body edges).

REV	DESCRIPTION	DATE	APPR. BY
A	REVIEW (GENERATED)	2026-11-04	

CPME USA
441 MILWAUKEE AVE STE 6
BURLINGTON W1 53105

PROJECT	OIT-24VDC
LOCATION NUMBER	
PANEL ID:	VP-1
PANEL DESC	24 VDC THIN CLIENT / OIT PANEL


VP-1

24 VDC THIN CLIENT / OIT PANEL

ENCLOSURE LAYOUT


REVISION A

SHEET 5 OF 7

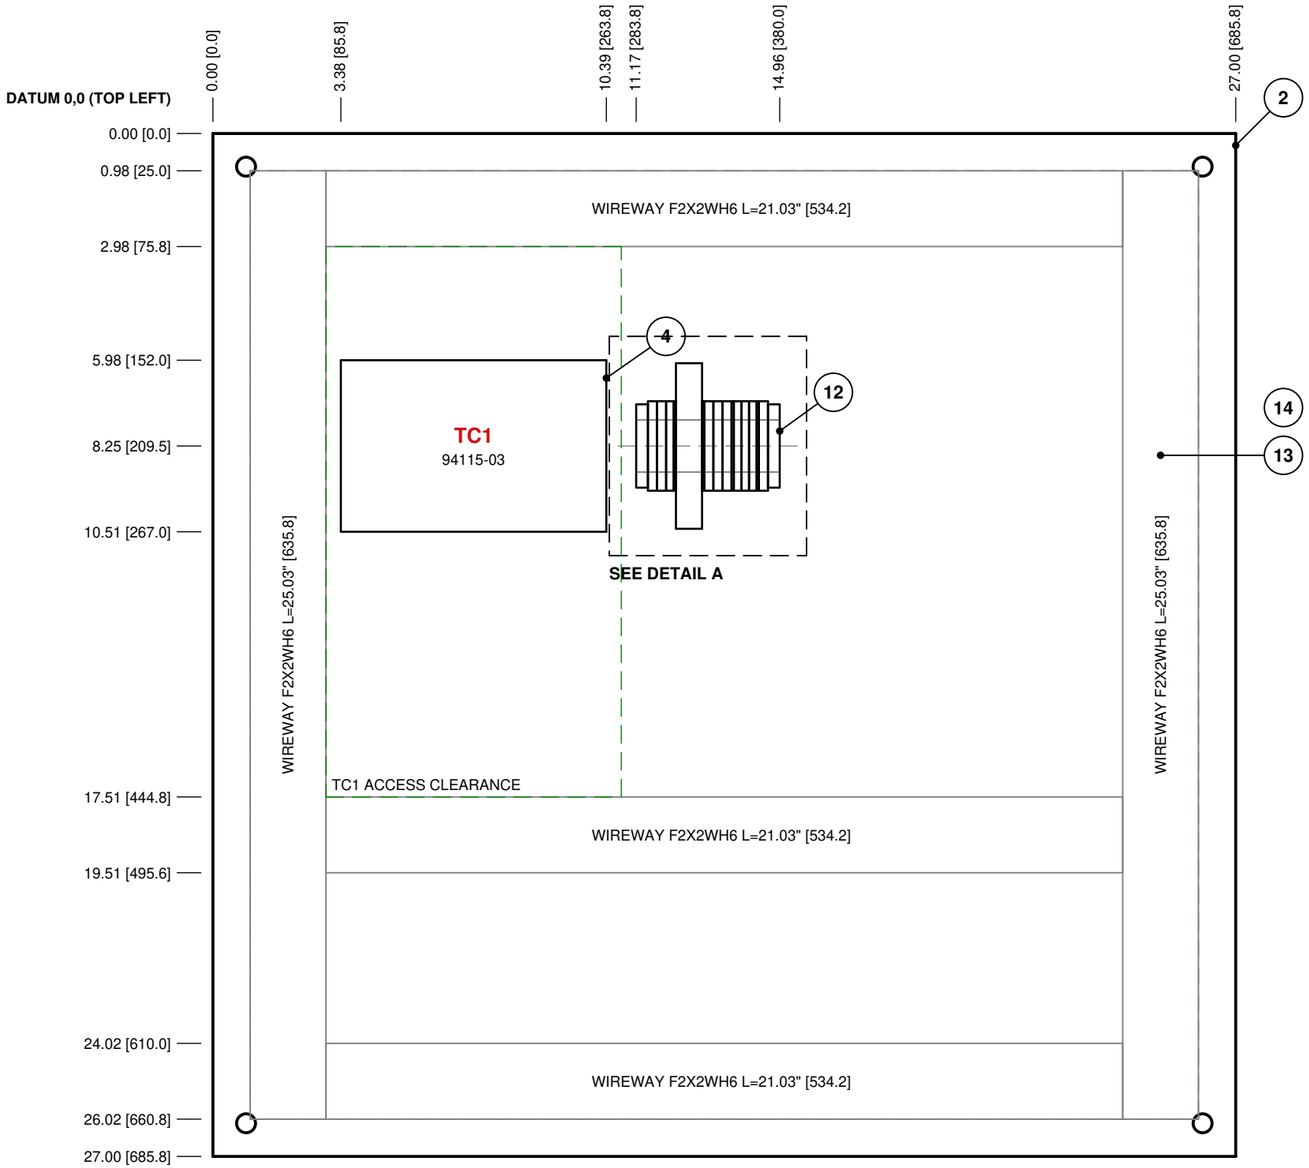

SUBPLATE SCE-30P30 (FRONT)

SCALE 1:4
Ordinates in inches [mm] from the top-left corner; X right, Y down.

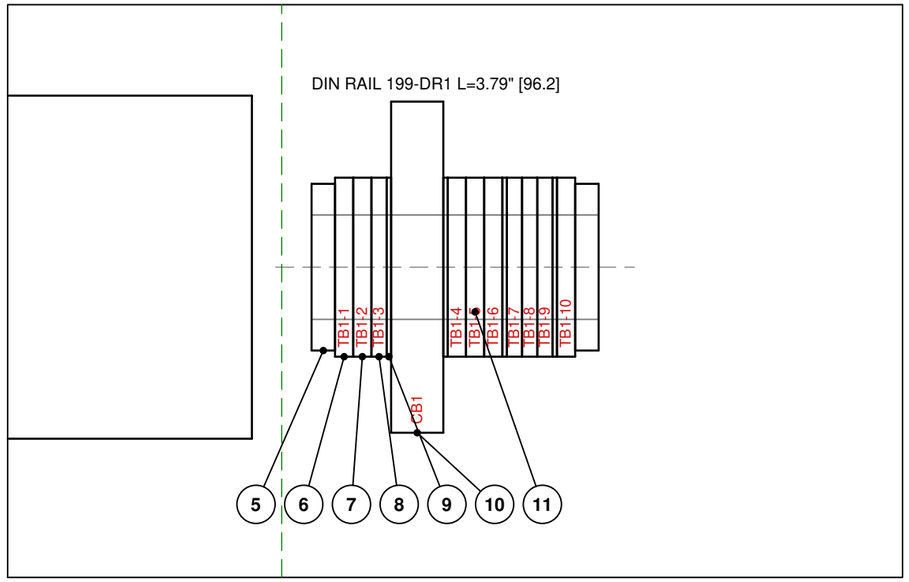

DETAIL A: DIN RAIL DC-ENTRY

SCALE 1:2

ITEM	QTY	PART	TAGS
1	1	SCE-30EL3008SSST	ENC-1
2	1	SCE-30P30	SUBPLATE-1
3	1	HIS-ML22-STTD	HMI1
4	1	94115-03	TC1
5	2	1492-EAJ35	
6	2	1492-JG4	TB1-1, TB1-10
7	4	1492-J4-BR	TB1-2, TB1-4..6
8	4	1492-J4-B	TB1-3, TB1-7..9
9	4	1492-EBJ16	
10	1	1489-M1C060	CB1
11	2	1492-CJJ6-3	
12	1 CUT	199-DR1	
13	5 CUT	F2X2WH6	
14	5 CUT	C2WH6	

NOTES:

1. Subplate mounting holes Ø0.5" (4) on 25.25" centres (vendor-punched; Saginaw sales drawing). Plate drawn 27.00" [685.8] square from the listing; the sales drawing shows 26.94" (flagged).

CPME USA	441 MILWAUKEE AVE STE 6 BURLINGTON W1 53105	PROJECT LOCATION NUMBER PANEL ID: PANEL DESC	OIT-24VDC VP-1 24 VDC THIN CLIENT / OIT PANEL
VP-1 24 VDC THIN CLIENT / OIT PANEL SUBPLATE LAYOUT		REVISION A	
		SHEET 6 OF 7	

REV	DESCRIPTION	DATE	APPR. BY
A	REVIEW (GENERATED)	2026-11-04	

ITEM	QTY	UOM	PART NUMBER	MANUFACTURER	DESCRIPTION	TAGS / CUTS
1	1	EA	SCE-30EL3008SSST	Saginaw Control & Engineering	S.S. EL Sloping Top Enclosure	ENC-1
2	1	EA	SCE-30P30	Saginaw Control & Engineering	Subpanel, Bent	SUBPLATE-1
3	1	EA	HIS-ML22-STTD	Hope Industrial Systems	22 in (16:10) panel-mount industrial monitor, Rev D, DC power model, stainless steel faceplate per the CPME build; single-touch resistive touch screen option	HMI1
4	1	EA	94115-03	CONTEC	CONTEC BX-T3020 Series (U.S. model) fanless box computer, ThinManager Ready BIOS, no storage device (thin client)	TC1
5	2	EA	1492-EAJ35	Allen-Bradley	1492 Terminal Block Accessories End Anchor, End Anchor.	RAIL-ANCHORS-1..2
6	2	EA	1492-JG4	Allen-Bradley	4 mm² IEC single-circuit feed-through GROUND terminal block (green/yellow), bonded to DIN rail	TB1-1, TB1-10
7	4	EA	1492-J4-BR	Allen-Bradley	Screw connection standard feed-through terminal block, 1492-J4, brown	TB1-2, TB1-4..6
8	4	EA	1492-J4-B	Allen-Bradley	Terminal Block, 5mm, 25A, BLUE, Screw Accepts (1)22-12AWG (PER UL) Single Feed-Through	TB1-3, TB1-7..9
9	4	EA	1492-EBJ16	Allen-Bradley	1492 Terminal Block Accessories , Grey (Standard)	TERMINAL-PARTITIONS-1..4
10	1	EA	1489-M1C060	Allen-Bradley	Bulletin 1489-M thermal-magnetic UL 489 circuit breaker, 1-pole, Curve C, 6 A, 277 V AC max (UL/CSA)	CB1
11	2	EA	1492-CJJ6-3	Allen-Bradley	Screw type center jumper, for use with 1492-J4, J4M	DC-JUMPERS-1..2
12	3.8	IN	199-DR1	Allen-Bradley	DIN Mounting Rail, Zinc Plated, Chromated Steel, 35mm x 7.5mm DIN Rail, 1 Meter (Pkg. Qty. 10)	1 x 3.79" (stock 39")
13	113.2	IN	F2X2WH6	Panduit	Panduit White Narrow Slot 2x2, Uses Cover C2WH6	3 x 21.03", 2 x 25.03" (stock 72")
14	113.2	IN	C2WH6	Panduit	Type C cover for nominal 2-inch wiring duct, white, 6-foot stock length	3 x 21.03", 2 x 25.03" (stock 72")

NOTES:

1. Physical wires awaiting selected purchasing material and sourced routed lengths (wire not yet itemised).
2. Item numbers match the balloons on the layout sheets. Item numbers follow the panel: enclosure, subplate, door devices, plate-mounted devices, rail devices in rail order with their accessories, then cut stock (rail, wireway, cover); Todd to approve.

CPME USA
441 MILWAUKEE AVE STE 6
BURLINGTON W1 53105

PROJECT	OIT-24VDC
LOCATION	
NUMBER	
PANEL ID:	VP-1
PANEL DESC	24 VDC THIN CLIENT / OIT PANEL

VP-1

24 VDC THIN CLIENT / OIT PANEL

BILL OF MATERIAL

REVISION A

SHEET 7 OF 7

REV	DESCRIPTION	DATE	APPR. BY
A	REVIEW (GENERATED)	2026-11-04	