


val/reconstruction\_mse

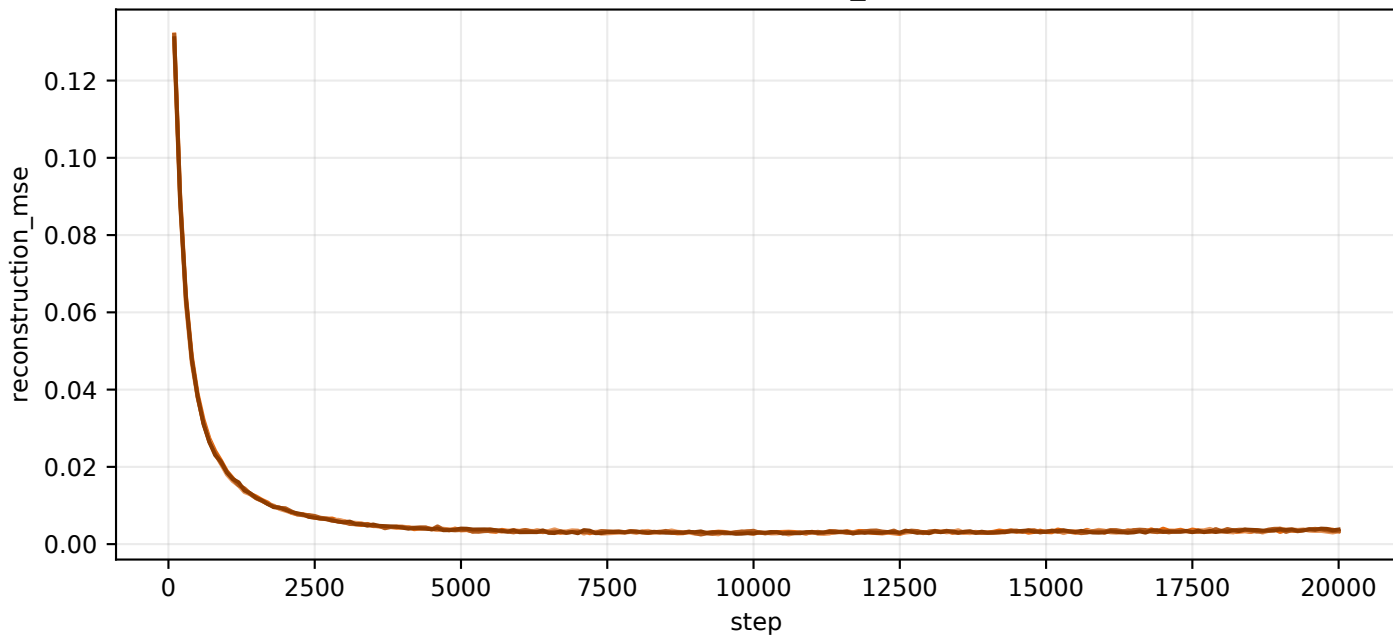

| run                                                                                                                           | min      | max    | end      | step  |
|-------------------------------------------------------------------------------------------------------------------------------|----------|--------|----------|-------|
|  dfaae_singlepass/mask00p-5000.0400.2000-00r | 0.002624 | 0.1319 | 0.003313 | 19999 |
|  dfaae_singlepass/mask00p-5000.0400.2000-20r | 0.002479 | 0.1293 | 0.003291 | 19999 |
|  dfaae_singlepass/mask00p-5000.0400.2000-40r | 0.002489 | 0.1318 | 0.003367 | 19999 |
|  dfaae_singlepass/mask00p-5000.0400.2000-80r | 0.002677 | 0.1309 | 0.003781 | 19999 |