


val/mse_reconstruction

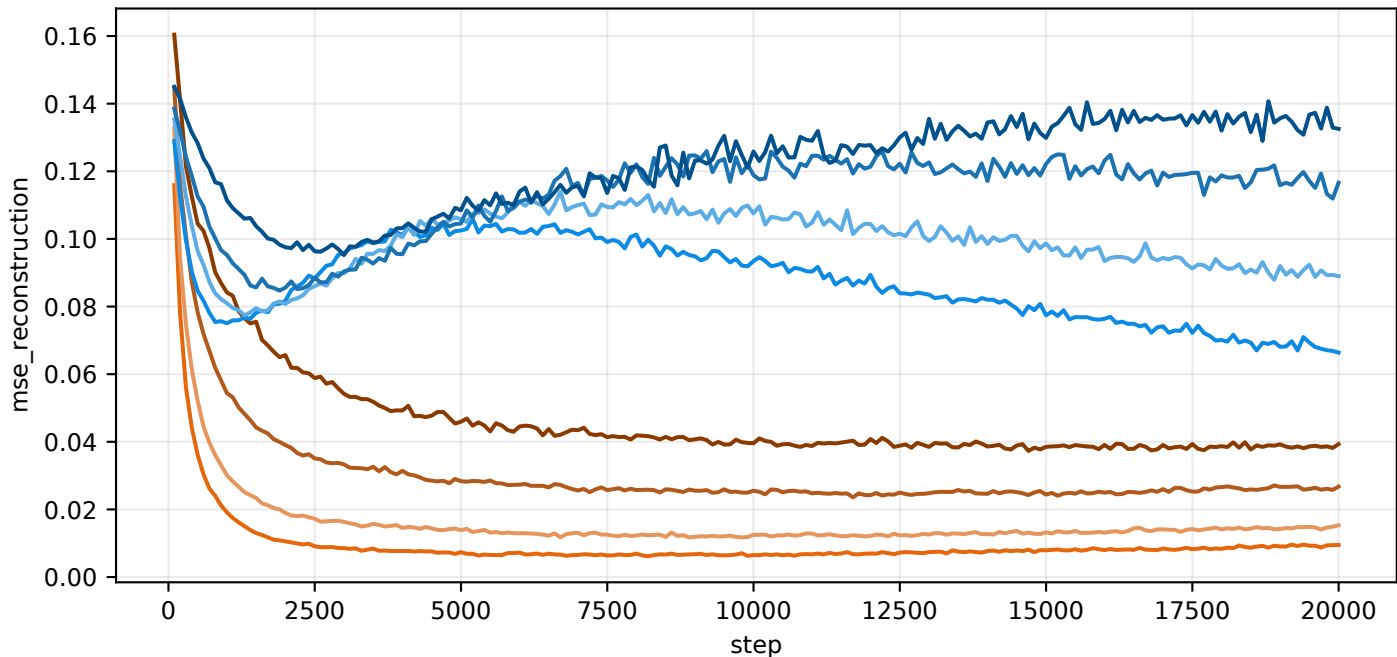

run	min	max	end	step
dfaae_group1/mask50p_5000.0400.2000_r00	0.006163	0.1159	0.009498	19999
dfaae_group1/mask75p_5000.0400.2000_r00	0.01171	0.1328	0.0153	19999
dfaae_group1/mask90p_5000.0400.2000_r00	0.02357	0.1446	0.02675	19999
dfaae_group1/mask95p_5000.0400.2000_r00	0.0373	0.1604	0.03932	19999
dfaae_group2/mask50p_5000.0400.0064_r00	0.06639	0.1289	0.06639	19999
dfaae_group2/mask75p_5000.0400.0064_r00	0.07741	0.1353	0.08897	19999
dfaae_group2/mask90p_5000.0400.0064_r00	0.08472	0.1385	0.1166	19999
dfaae_group2/mask95p_5000.0400.0064_r00	0.09521	0.145	0.1325	19999