


val/reconstruction_mse

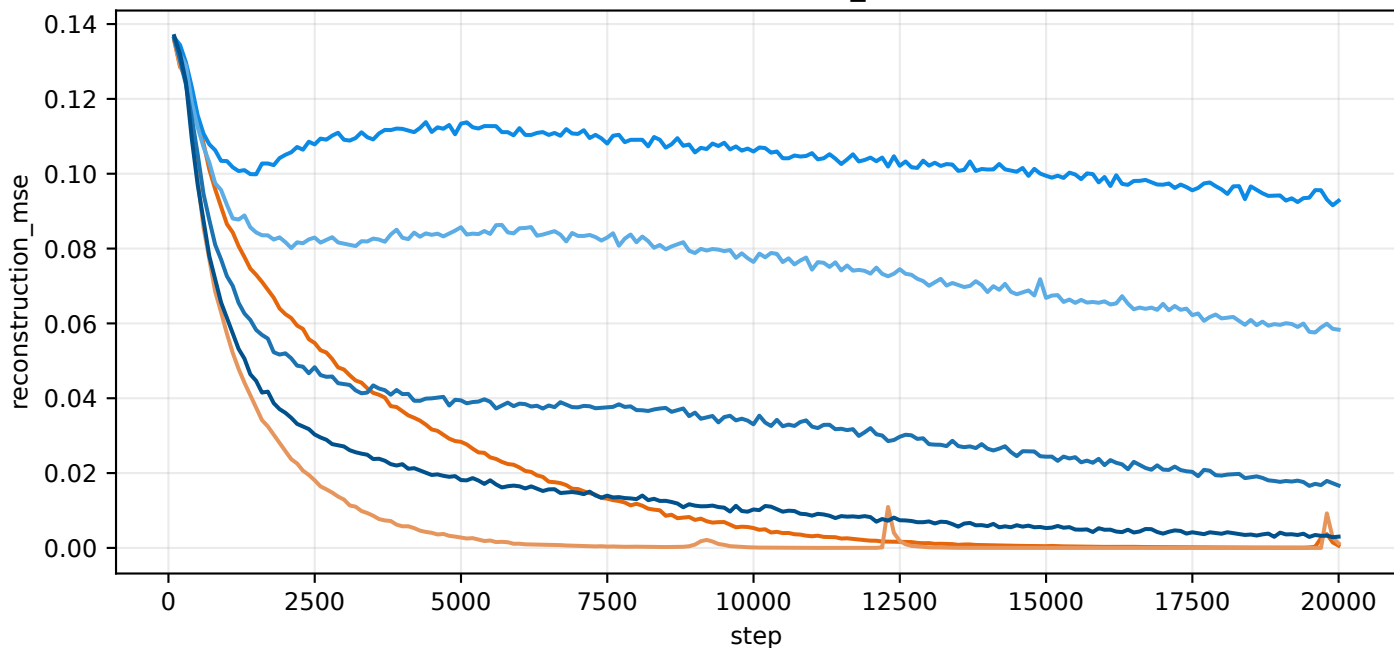

run	min	max	end	step
■ bpaes_singlepass/mask00p-5000.0400.0064-00r	6.556e-05	0.1356	0.0006149	19999
■ bpaes_singlepass/mask00p-5000.0400.2000-00r	6.83e-08	0.1356	0.001259	19999
■ dfaes_singlepass/mask00p-5000.0400.0064-00r	0.09156	0.1364	0.09278	19999
■ dfaes_singlepass/mask00p-5000.0400.0128-00r	0.05756	0.1362	0.05832	19999
■ dfaes_singlepass/mask00p-5000.0400.0250-00r	0.01657	0.136	0.01667	19999
■ dfaes_singlepass/mask00p-5000.0400.0500-00r	0.002853	0.1368	0.003006	19999