


train/patterns_active_rate

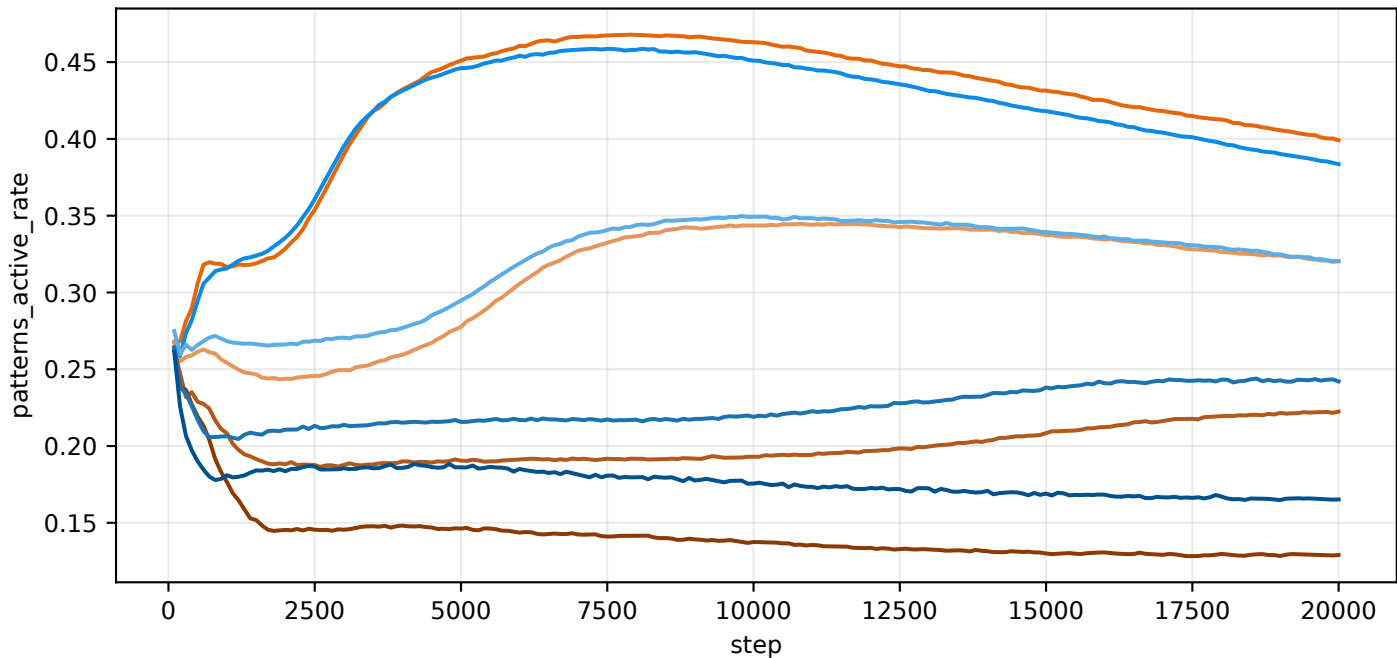

run	min	max	end	step
bpae_group1/mask50p_5000.0400.2000_r00	0.2677	0.4679	0.3992	19999
bpae_group1/mask75p_5000.0400.2000_r00	0.2434	0.3447	0.3205	19999
bpae_group1/mask90p_5000.0400.2000_r00	0.1864	0.2625	0.2224	19999
bpae_group1/mask95p_5000.0400.2000_r00	0.1283	0.2643	0.129	19999
bpae_group2/mask50p_5000.0400.2000_r05	0.2587	0.4587	0.3836	19999
bpae_group2/mask75p_5000.0400.2000_r05	0.2598	0.3498	0.3203	19999
bpae_group2/mask90p_5000.0400.2000_r05	0.2046	0.2635	0.2421	19999
bpae_group2/mask95p_5000.0400.2000_r05	0.1648	0.2613	0.1652	19999