


val/mse_masked

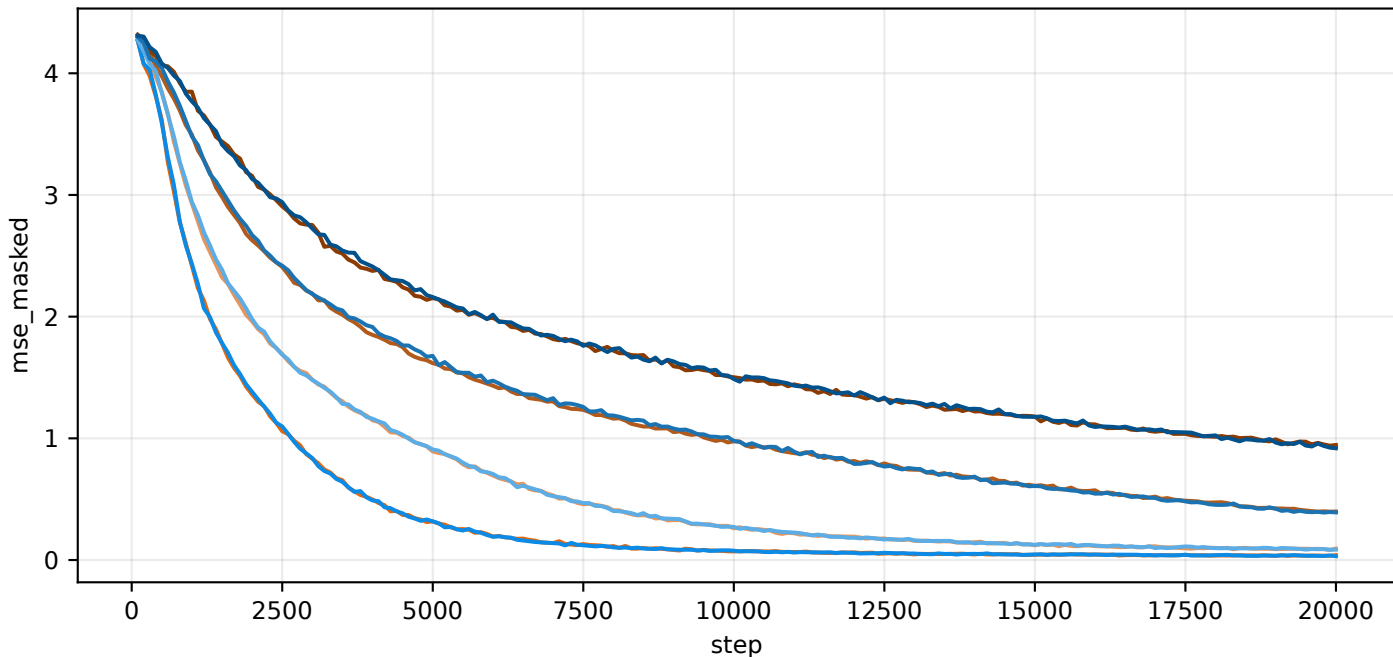

run

min

max

end

step

■	bpae_group1/mask50p_5000.0400.2000_r00	0.03428	4.273	0.03983	19999
■	bpae_group1/mask75p_5000.0400.2000_r00	0.08286	4.268	0.09367	19999
■	bpae_group1/mask90p_5000.0400.2000_r00	0.3972	4.31	0.3983	19999
■	bpae_group1/mask95p_5000.0400.2000_r00	0.9397	4.318	0.9454	19999
■	bpae_group2/mask50p_5000.0400.2000_r05	0.03136	4.269	0.03136	19999
■	bpae_group2/mask75p_5000.0400.2000_r05	0.08432	4.274	0.08556	19999
■	bpae_group2/mask90p_5000.0400.2000_r05	0.39	4.298	0.3915	19999
■	bpae_group2/mask95p_5000.0400.2000_r05	0.9183	4.308	0.9183	19999