


val/mse_reconstruction

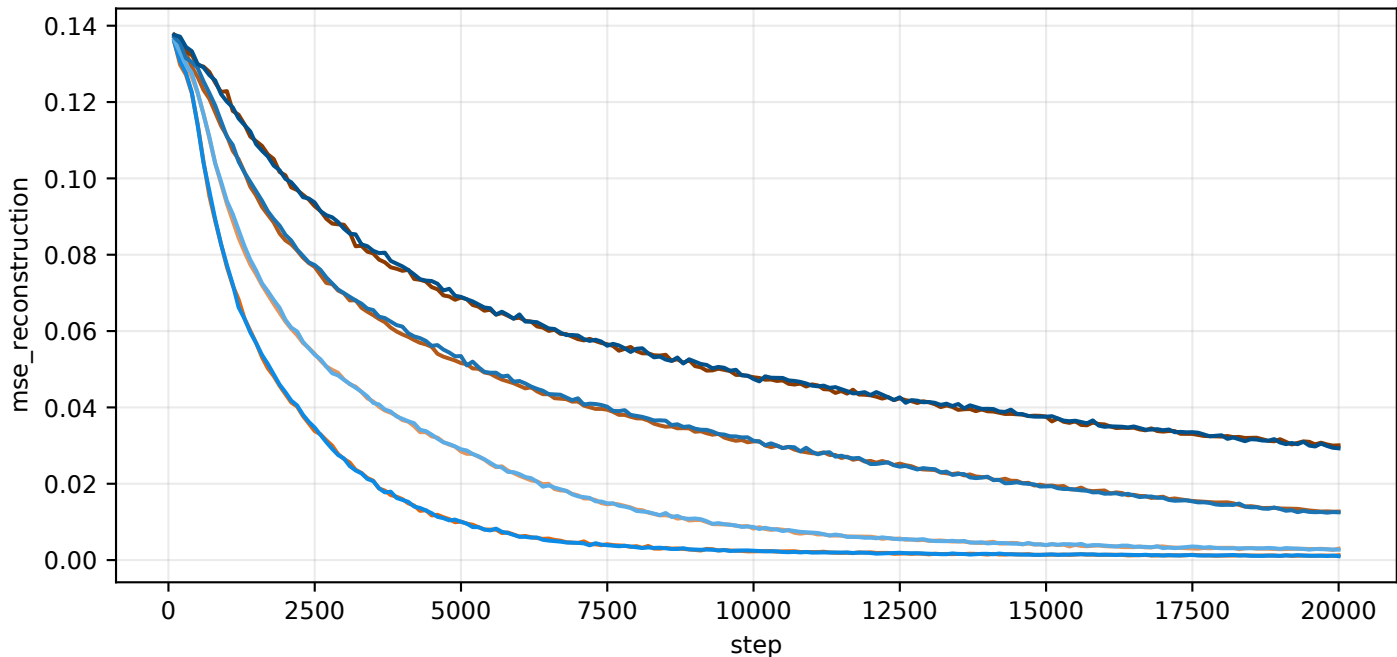

run	min	max	end	step
 bpa_group1/mask50p_5000.0400.2000_r00	0.001087	0.1358	0.001269	19999
 bpa_group1/mask75p_5000.0400.2000_r00	0.002656	0.1363	0.002991	19999
 bpa_group1/mask90p_5000.0400.2000_r00	0.01269	0.1375	0.01271	19999
 bpa_group1/mask95p_5000.0400.2000_r00	0.03	0.1377	0.03006	19999
 bpa_group2/mask50p_5000.0400.2000_r05	0.001018	0.1358	0.001018	19999
 bpa_group2/mask75p_5000.0400.2000_r05	0.002697	0.1362	0.002728	19999
 bpa_group2/mask90p_5000.0400.2000_r05	0.01242	0.137	0.01252	19999
 bpa_group2/mask95p_5000.0400.2000_r05	0.02928	0.1376	0.02928	19999