


val/patterns_active_rate

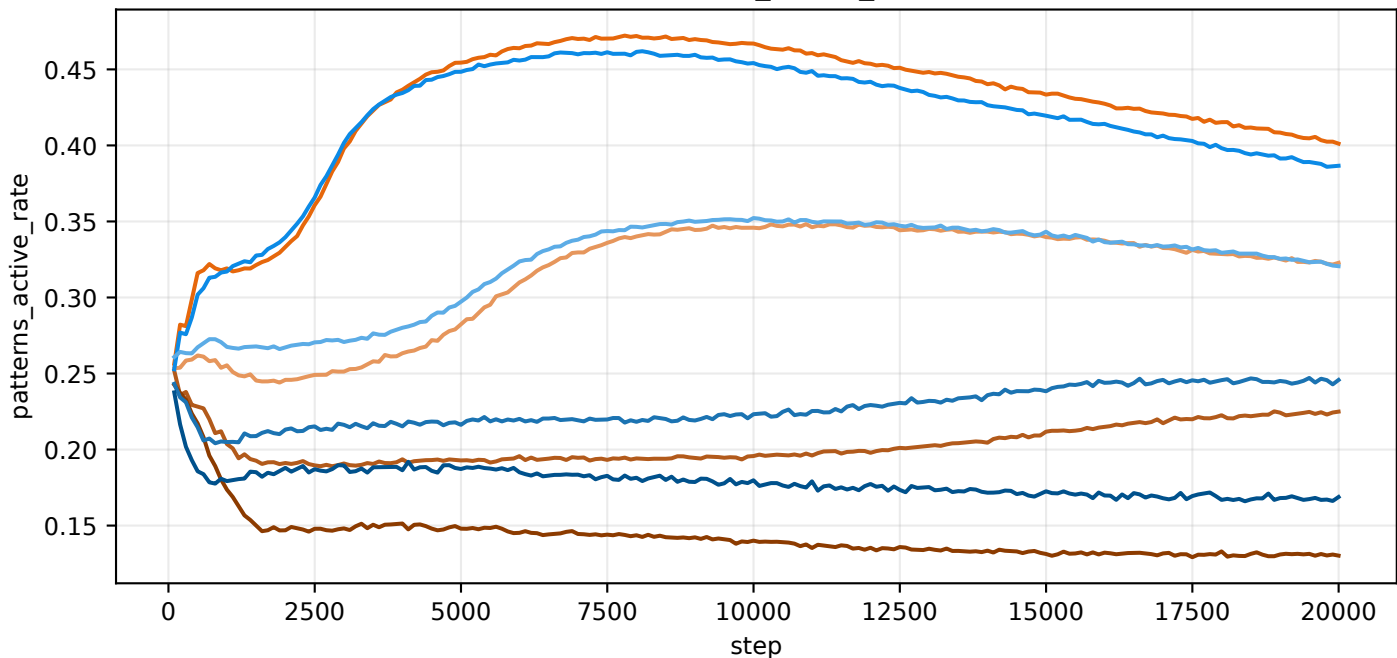

run	min	max	end	step
bpae_group1/mask50p_5000.0400.2000_r00	0.2564	0.4722	0.4012	19999
bpae_group1/mask75p_5000.0400.2000_r00	0.244	0.3483	0.3228	19999
bpae_group1/mask90p_5000.0400.2000_r00	0.189	0.2518	0.2249	19999
bpae_group1/mask95p_5000.0400.2000_r00	0.1292	0.2426	0.1302	19999
bpae_group2/mask50p_5000.0400.2000_r05	0.2528	0.4619	0.3866	19999
bpae_group2/mask75p_5000.0400.2000_r05	0.2609	0.3522	0.3206	19999
bpae_group2/mask90p_5000.0400.2000_r05	0.2041	0.2471	0.2458	19999
bpae_group2/mask95p_5000.0400.2000_r05	0.166	0.2376	0.1688	19999