


val/reconstruction_bce

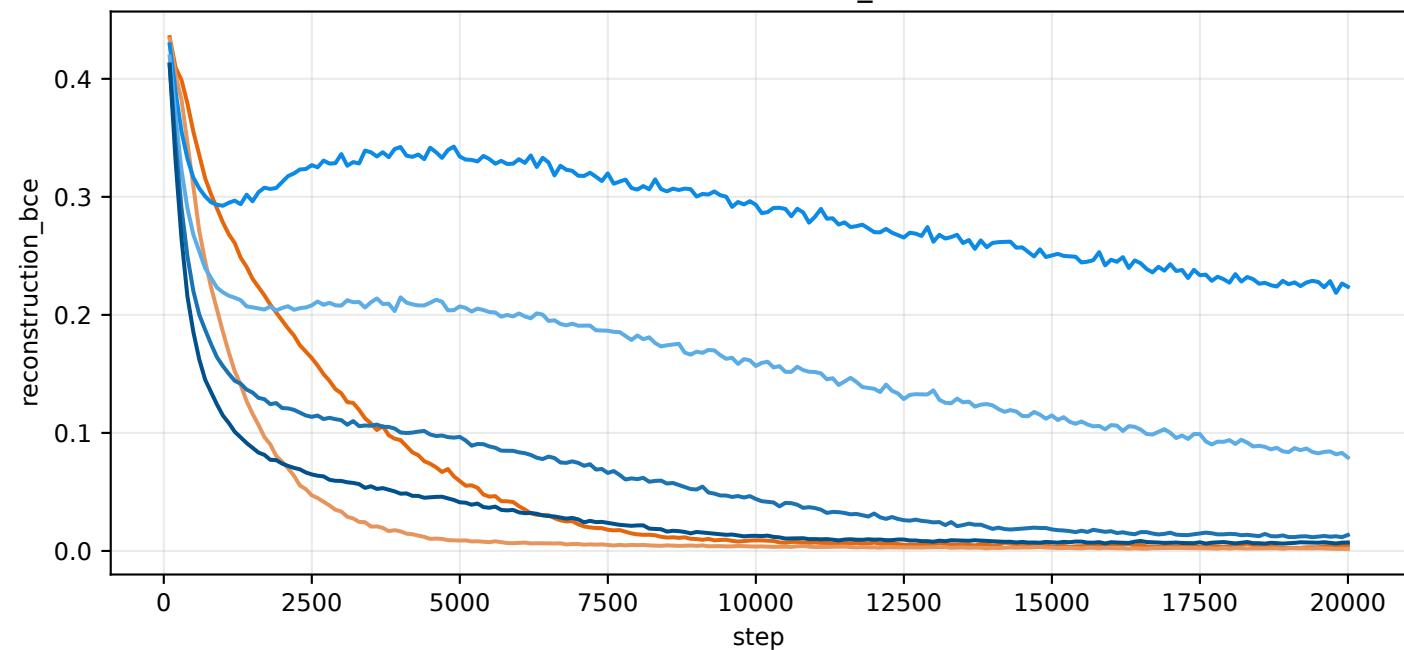

run	min	max	end	step
bpaes_baseline/mask00p-5000.0400.0064-00r	0.002424	0.4353	0.004501	19999
bpaes_baseline/mask00p-5000.0400.2000-00r	0.001713	0.4336	0.001713	19999
dfaes_singlepass/mask00p-5000.0400.0064-00r	0.2187	0.4292	0.2238	19999
dfaes_singlepass/mask00p-5000.0400.0128-00r	0.07914	0.419	0.07914	19999
dfaes_singlepass/mask00p-5000.0400.0250-00r	0.01162	0.4123	0.01354	19999
dfaes_singlepass/mask00p-5000.0400.0500-00r	0.006184	0.4118	0.007107	19999