


val/reconstruction_bce

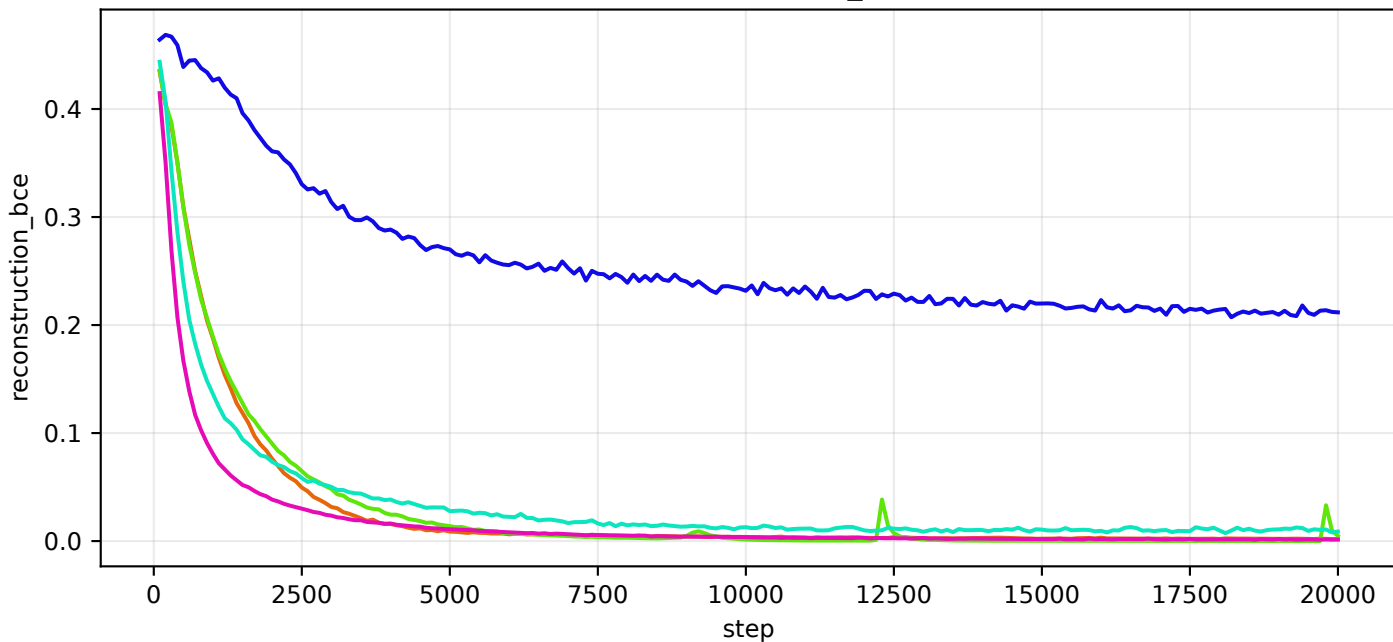

run	min	max	end	step
bpaee_baseline/mask00p-5000.0400.2000-00r	0.00177	0.4346	0.00177	19999
bpaee_singlepass/mask00p-5000.0400.2000-00r	5.216e-05	0.4356	0.004934	19999
dfaee_singlepass/mask00p-5000.0400.2000-00r	0.007365	0.4437	0.008805	19999
drtpae_singlepass/mask00p-5000.0400.2000-00r	0.2072	0.4687	0.2118	19999
hytaae_singlepass/mask00p-5000.0400.2000-00r	0.001231	0.4147	0.001435	19999