


val/mse_reconstruction

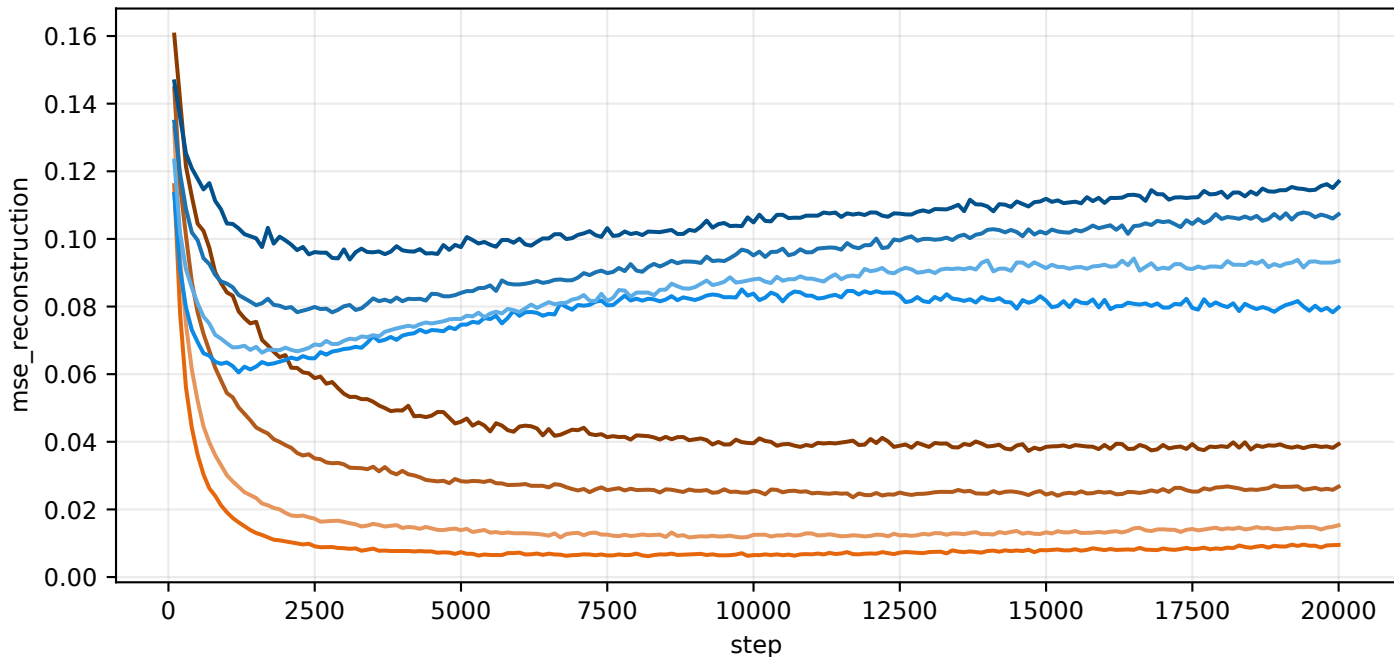

run	min	max	end	step
dfaae_group1/mask50p_5000.0400.2000_r00	0.006163	0.1159	0.009498	19999
dfaae_group1/mask75p_5000.0400.2000_r00	0.01171	0.1328	0.0153	19999
dfaae_group1/mask90p_5000.0400.2000_r00	0.02357	0.1446	0.02675	19999
dfaae_group1/mask95p_5000.0400.2000_r00	0.0373	0.1604	0.03932	19999
dfaae_group2/mask50p_5000.0100.2000_r00	0.06051	0.1133	0.07974	19999
dfaae_group2/mask75p_5000.0100.2000_r00	0.06635	0.1232	0.0935	19999
dfaae_group2/mask90p_5000.0100.2000_r00	0.07829	0.1347	0.1073	19999
dfaae_group2/mask95p_5000.0100.2000_r00	0.09391	0.1466	0.1169	19999