


train/mse_reconstruction_step

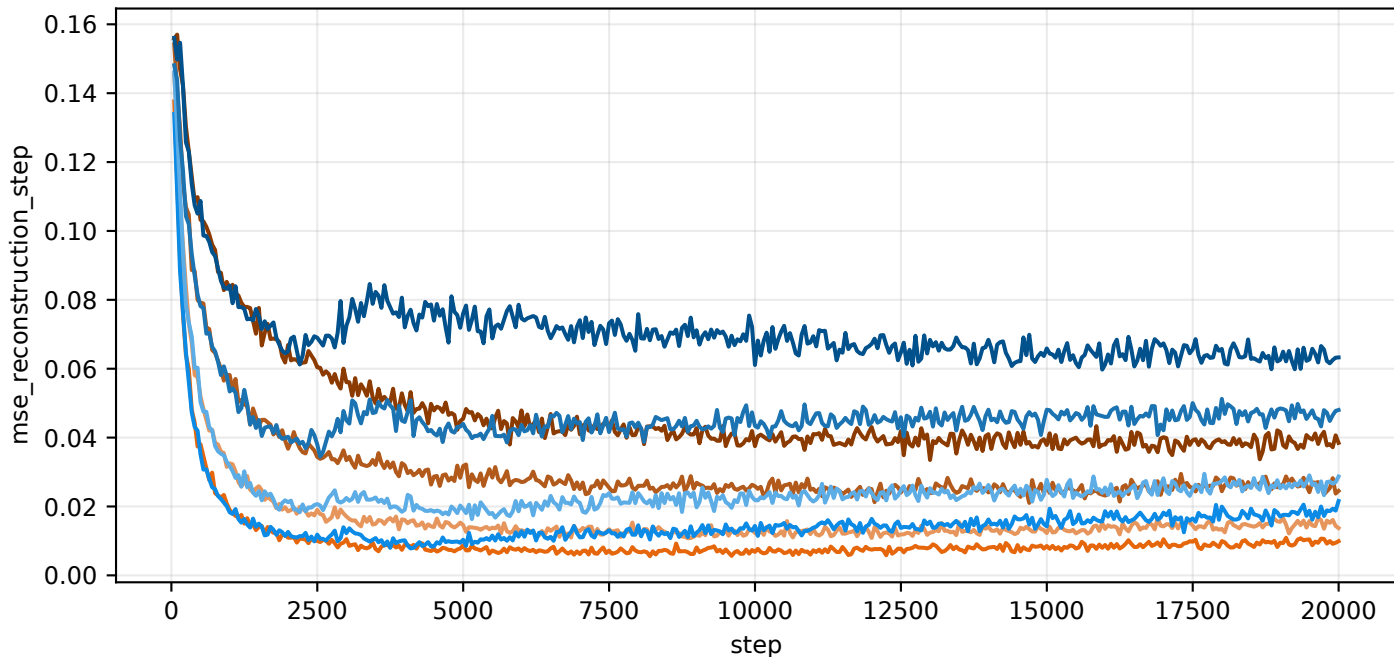

run	min	max	end	step
dfaae_group1/mask50p_5000.0400.2000_r00	0.005562	0.1376	0.009912	19999
dfaae_group1/mask75p_5000.0400.2000_r00	0.01076	0.1452	0.01373	19999
dfaae_group1/mask90p_5000.0400.2000_r00	0.02103	0.1541	0.02451	19999
dfaae_group1/mask95p_5000.0400.2000_r00	0.03349	0.157	0.03846	19999
dfaae_group2/mask50p_5000.0400.2000_r01	0.007817	0.134	0.02159	19999
dfaae_group2/mask75p_5000.0400.2000_r01	0.01634	0.146	0.0287	19999
dfaae_group2/mask90p_5000.0400.2000_r01	0.03443	0.1481	0.04801	19999
dfaae_group2/mask95p_5000.0400.2000_r01	0.05974	0.1561	0.06328	19999