


val/mse_reconstruction

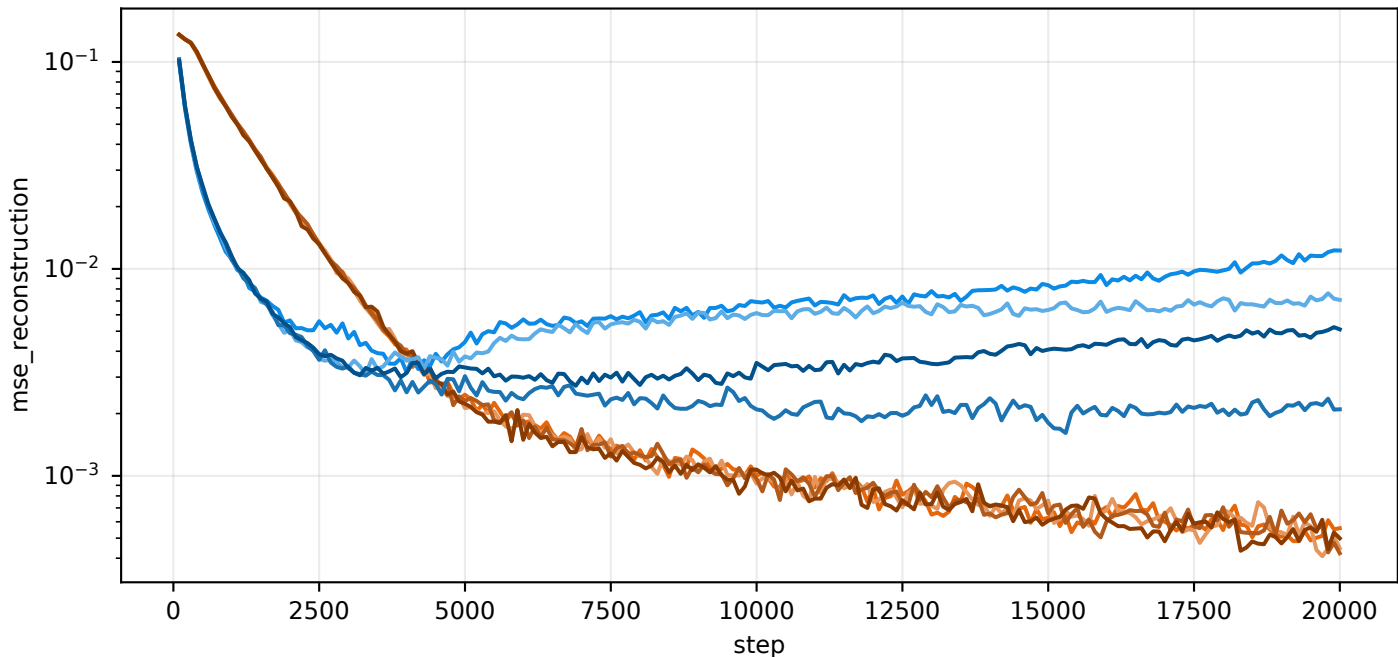

run	min	max	end	step
 bpaee_baseline/mask00p_5000.0400.2000_r00	0.0004835	0.1355	0.0005584	19999
 bpaee_baseline/mask00p_5000.0400.2000_r01	0.000409	0.1353	0.0004469	19999
 bpaee_baseline/mask00p_5000.0400.2000_r05	0.0004227	0.1355	0.0004227	19999
 bpaee_baseline/mask00p_5000.0400.2000_r25	0.0004344	0.1353	0.000499	19999
 dfaee_training/mask00p_5000.0400.2000_re2	0.003164	0.09948	0.01227	19999
 dfaee_training/mask00p_5000.0400.2000_re3	0.00309	0.1022	0.007082	19999
 dfaee_training/mask00p_5000.0400.2000_re4	0.001611	0.1031	0.002097	19999
 dfaee_training/mask00p_5000.0400.2000_re5	0.002724	0.101	0.005103	19999