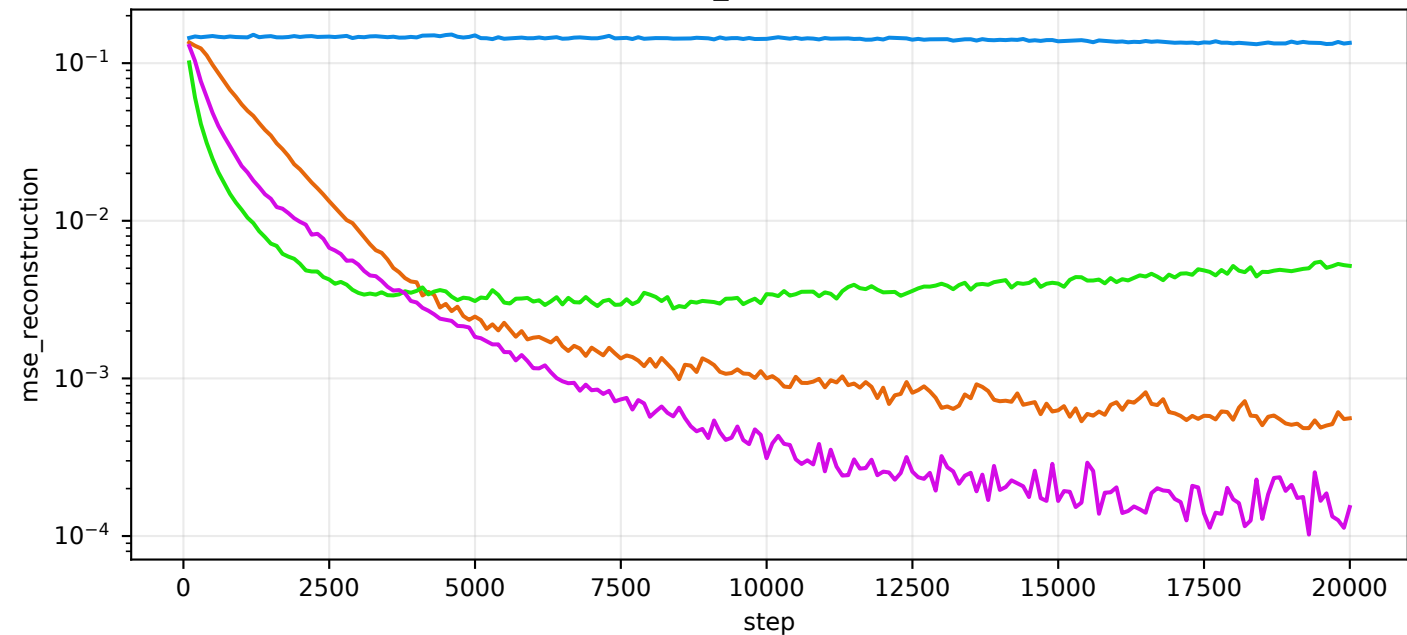


val/mse\_reconstruction

**run**

bpae\_baseline/mask00p\_5000.0400.2000\_r00

**min**

0.0004835

**max**

0.1355

**end**

0.0005584

**step**

19999



dfaae\_training/mask00p\_5000.0400.2000\_r00

0.002775

0.1011

0.005175

19999



drtpae\_training/mask00p\_5000.0400.2000\_r00

0.1319

0.1519

0.1345

19999



hytaae\_training/mask00p\_5000.0400.2000\_s20

0.0001022

0.1288

0.0001527

19999