


train/patterns_active_rate

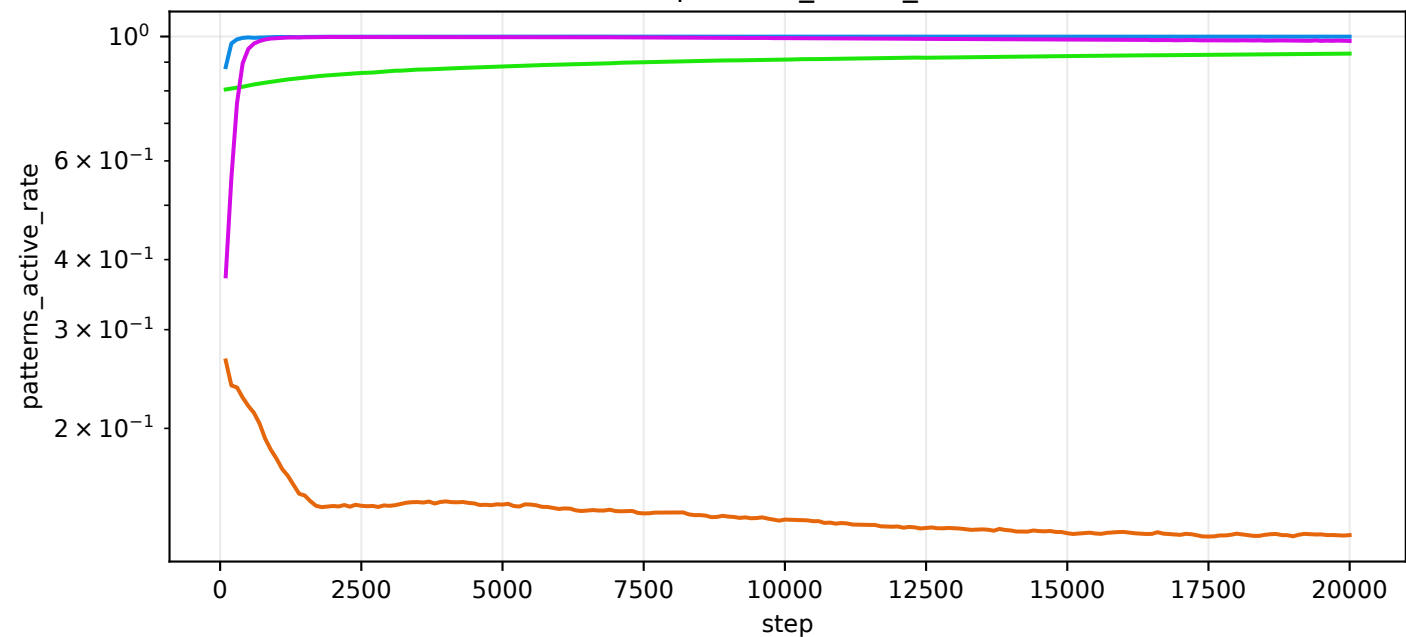

run	min	max	end	step
bpaee_baseline/mask95p_5000.0400.2000_r00	0.1283	0.2643	0.129	19999
dfaae_training/mask95p_5000.0400.2000_r00	0.8047	0.9322	0.9322	19999
drtpae_training/mask95p_5000.0400.2000_r00	0.8819	0.9999	0.9994	19999
hytaae_training/mask95p_5000.0400.2000_s20	0.3735	0.9986	0.9819	19999