


val/mse_reconstruction

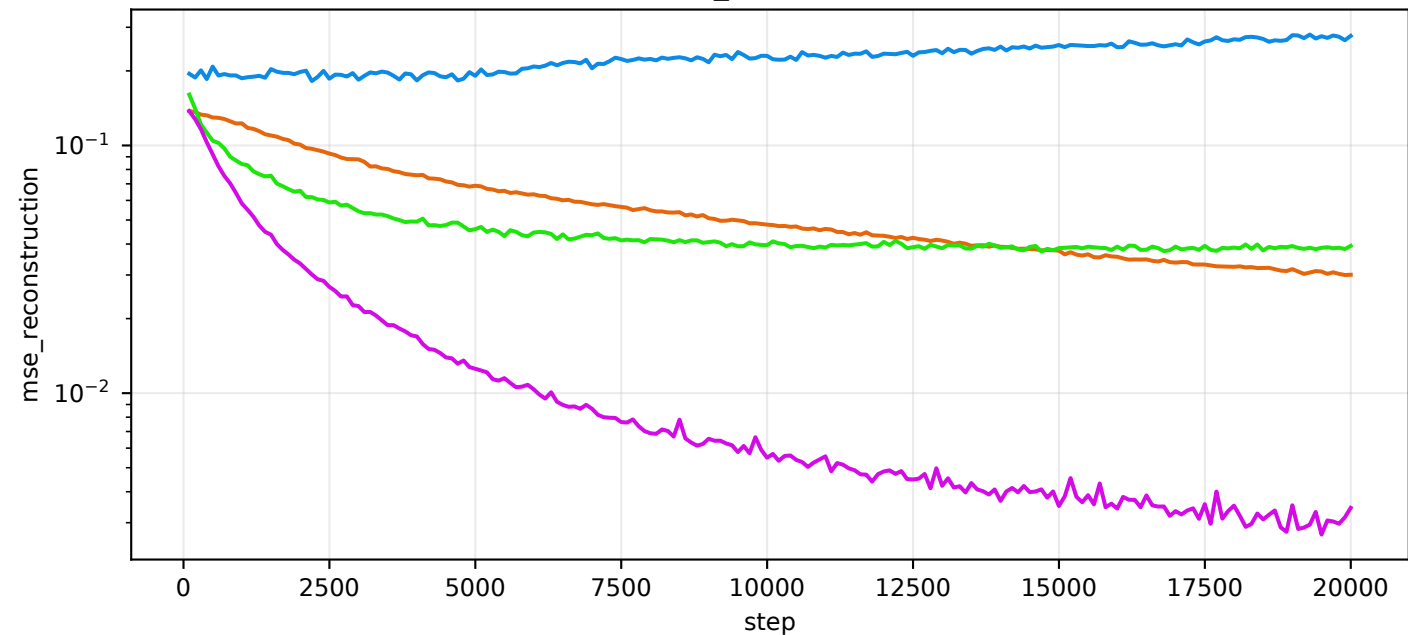

run	min	max	end	step
bpaе_baseline/mask95p_5000.0400.2000_r00	0.03	0.1377	0.03006	19999
dfaаe_training/mask95p_5000.0400.2000_r00	0.0373	0.1604	0.03932	19999
drtpae_training/mask95p_5000.0400.2000_r00	0.182	0.2804	0.2769	19999
hytaаe_training/mask95p_5000.0400.2000_s20	0.002687	0.1376	0.003443	19999