


val/reconstruction_bce

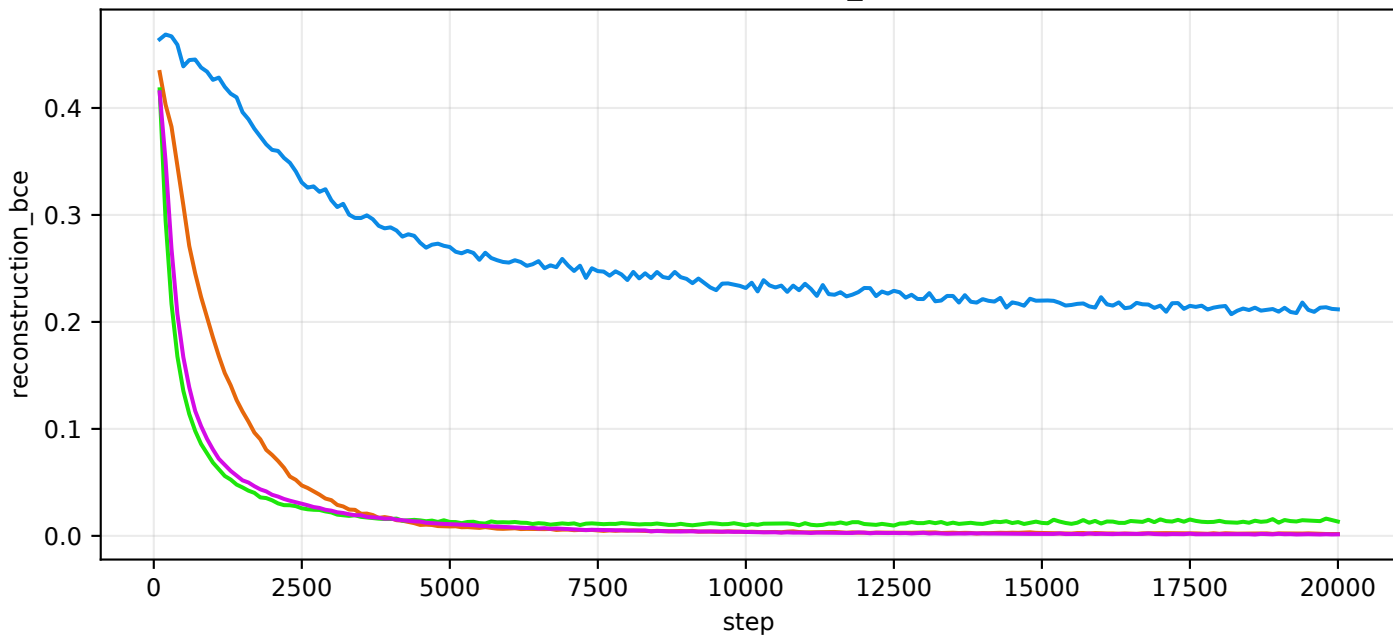

run	min	max	end	step
bpae_baseline/mask00p-5000.0400.2000-00r	0.001713	0.4336	0.001713	19999
dfaae_singlepass/mask00p-5000.0400.2000-00r	0.009644	0.4174	0.01338	19999
drtpae_singlepass/mask00p-5000.0400.2000-00r	0.2072	0.4687	0.2118	19999
hytaae_singlepass/mask00p-5000.0400.2000-00r	0.001231	0.4147	0.001435	19999