


val/reconstruction_mse

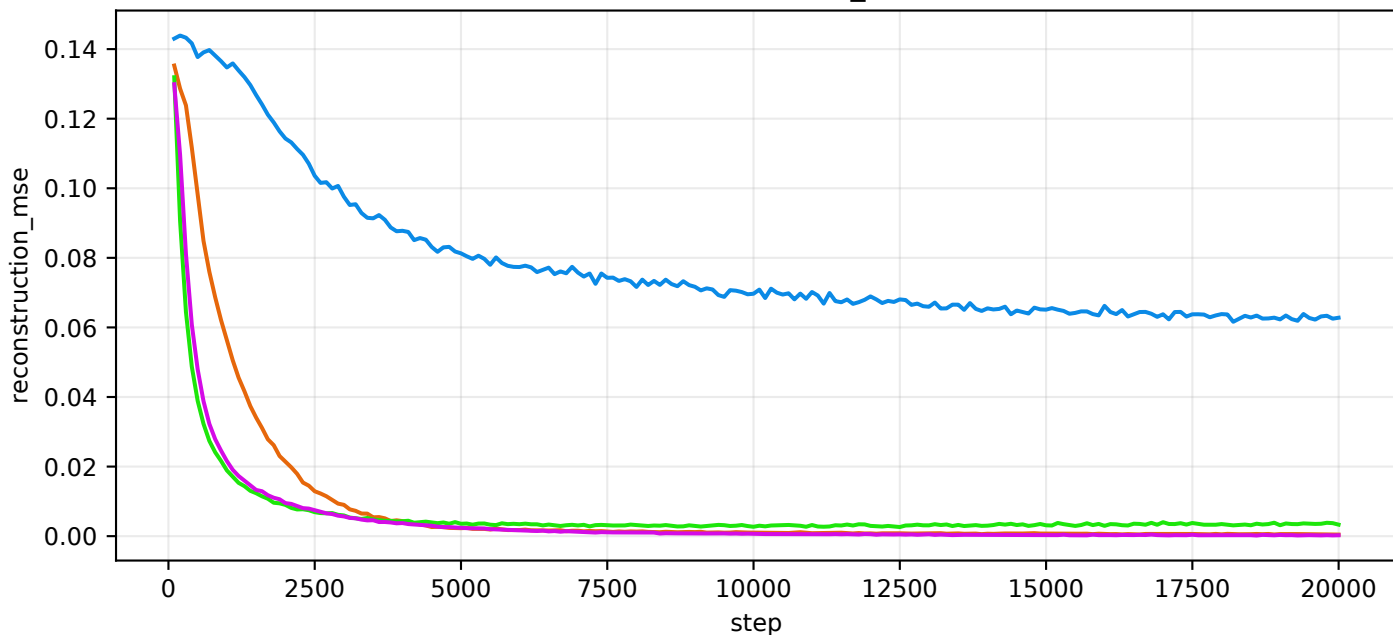

run	min	max	end	step
bpae_baseline/mask00p-5000.0400.2000-00r	0.0004526	0.1353	0.0004526	19999
dfaae_singlepass/mask00p-5000.0400.2000-00r	0.002624	0.1319	0.003313	19999
drtpae_singlepass/mask00p-5000.0400.2000-00r	0.06163	0.1439	0.06278	19999
hytaae_singlepass/mask00p-5000.0400.2000-00r	0.0001752	0.1299	0.0002563	19999